



LEGEND Digital Torque Amplifier SGDG User's Manual

Upon receipt of the product and prior to initial operation, read these instructions thoroughly, and retain for future reference.

Safety-Related Symbols


The following symbols are used in this manual according to the safety-related content. Be sure to observe text annotated with these safety symbols as their content is important.



Mis-operation may result in a hazardous condition with the possibility of death or serious injury.



Mis-operation may result in a hazardous condition with the possibility of serious or light injury as well as material damage.

Furthermore, the items annotated with a  may result in serious consequences depending on the situation. Be sure to observe these as they highlight important content.



YASKAWA manufactures component parts that can be used in a wide variety of industrial applications. The selection and application of YASKAWA products remain the responsibility of the equipment designer or end user. YASKAWA accepts no responsibility for the way its products are incorporated into the final system design.

Under no circumstances should any YASKAWA product be incorporated into any product or design as the exclusive or sole safety control. Without exception, all controls should be designed to detect faults dynamically under all circumstances. All products designed to incorporate a component part manufactured by YASKAWA must be supplied to the end user with appropriate warnings and instructions as to that part's safe use and operation. Any warnings provided by YASKAWA must be promptly provided to the end user.

YASKAWA offers an express warranty only as to the quality of its products in conforming to standards and specifications published in YASKAWA's manual. **NO OTHER WARRANTY, EXPRESS OR IMPLIED, IS OFFERED.** YASKAWA assumes no liability for any personal injury, property damage, losses, or claims arising from misapplication of its products.

Icon Display

The following icons were designed so as to aid in understanding the type of descriptive content. The icons are displayed where needed to aid in comprehension.



Major items which should be memorized. In addition, this can be a minor item which does not reach the level of damage to the machine, such as the generation of an alarm display.



This shows programming, operation examples, etc.



This shows supplemental information and convenient functions to remember.

Terminology?? This explains difficult-to-understand technical terminology and technical terms which have not been previously explained.

Outline of Manual

- Thank you for purchasing the LEGEND Digital torque amplifier.
- Use this product with a full understanding of conditions such as product specifications, usage limits, etc.
- This manual explains the following areas for users of the LEGEND Digital torque amplifier.
 - Methods for mounting and wiring servomotor and amplifiers
 - How to use the various functions
 - Ratings and specifications for standard device types
 - Maintenance and Inspection
- For additional information on Sigma II servomotor, please refer to the following documents:
 - Sigma II Servo System Product Catalog Supplement
(Doc.# G-MI#99001D-Sigma II)
 - Sigma II Series Servo System User's Manual
(Doc.# YEA-S800-32.2B)
 - Linear Servo Motor Product Catalog
(Doc.#KAE-S800-39.10)

Safety Notes

In this manual, we will describe important cautionary items which should always be observed regarding usage, inspection upon receipt of product, mounting, wiring, operation, and maintenance/inspection.

■ Inspection Upon Receipt of Product



- Use the servomotors/servomotors and amplifiers in the designated combinations. (See “3.5 Combinations” on page 39.)
Failure to do so may result in fire or unit failure.

■ Mounting



- Never use this product in an area where water may splash, in a corrosive or flammable atmosphere, or next to flammable items.
Doing so may result in electric shock or fire.

■ Wiring



- Be sure to connect the ground terminal of the digital torque amplifier to a grounding electrode (100Ω or less).
Failure to do so may result in electric shock or fire.



Wiring Precautions

- Do not bundle or run power and signal lines together in the same duct.
Keep power and signal lines at least 11.81” (30cm) apart.
- Use twisted pair or shielded multi-core twisted pair wires for signal and encoder (PG) feedback lines.
- The maximum lengths for signal lines are as follows:
 - Maximum of 9.84ft (300cm) for reference input lines.
 - Maximum of 65.6ft (20m) for PG feedback lines.
 - Use a cable type UL20276-SB for distances over 65.6ft (20m).

⚠ CAUTION

- Do not connect a three-phase power supply to the digital torque amplifier output terminals U, V, and W.
Doing so may result in injury or fire.
- Securely fasten the screws for the power terminals and motor terminals.
Failure to do so may result in fire.

■ Operation

⚠ WARNING

- To prevent unexpected accidents, test the motor with the motor shaft not connected to a machine or load.
- To prevent unexpected accidents, run with limit switches or stoppers attached to both ends of the magnet track.
Failure to do so may result in injury.
- Set parameters before operating the motor in connection with a machine.
Operating without making these settings may result in machine runaway and damage.
- After mounting on the machine, prior to the start of operation, make sure the emergency stop can be applied at any time.
Failure to do so may result in injury.
- Do not touch the heat sink while the unit is running.
The high temperature may result in burns.

■ Maintenance/Inspection

⚠ WARNING

- Never touch the inside of the digital torque amplifier.
Doing so may result in electrical shock.
- Be sure no wiring is exposed when power is turned ON.
Failure to do so may result in electrical shock.
- Do not touch the terminals for five minutes following power OFF.
Electrical shock may result due to residual voltage.

⚠ CAUTION




- Do not change the wiring while power is ON.
Doing so may result in electrical shock or injury.

■ General Cautionary Items

Cautionary Items Regarding Usage

- The figures contained in this manual may, for purposes of detailed explanation, be drawn with covers and safety shields removed. When operating this product, be sure to return all standard covers and shields to their original locations, and operate the product in accordance with this manual.
- The figures contained in this manual are representative examples, and may differ from the product received.
- Appropriate modifications may be made to this manual due to improvements or specification changes in the product, or to improve the ease of use of the manual itself. In the event of such changes, the document number of the manual will be updated, and issued as a revision.
- To order additional copies of this manual, contact your Yaskawa representative, or the nearest Yaskawa sales office printed on the back of this manual with the document number written on the cover.
- Yaskawa assumes no responsibility for products modified by the customer as they fall outside the warranty.

■ Warning Label

	危険 WARNING	通電中および電源オフ後、5分間端子部にさわるとな！感電のおそれあり Disconnect all power and wait 5 min. before servicing. May cause electric shock.
	注意 CAUTION	通電中はヒートシンクにさわるとな！火傷のおそれあり Do not touch heat sink when power is ON. May cause burn.
		必ずアース線を接続せよ Use proper grounding techniques.

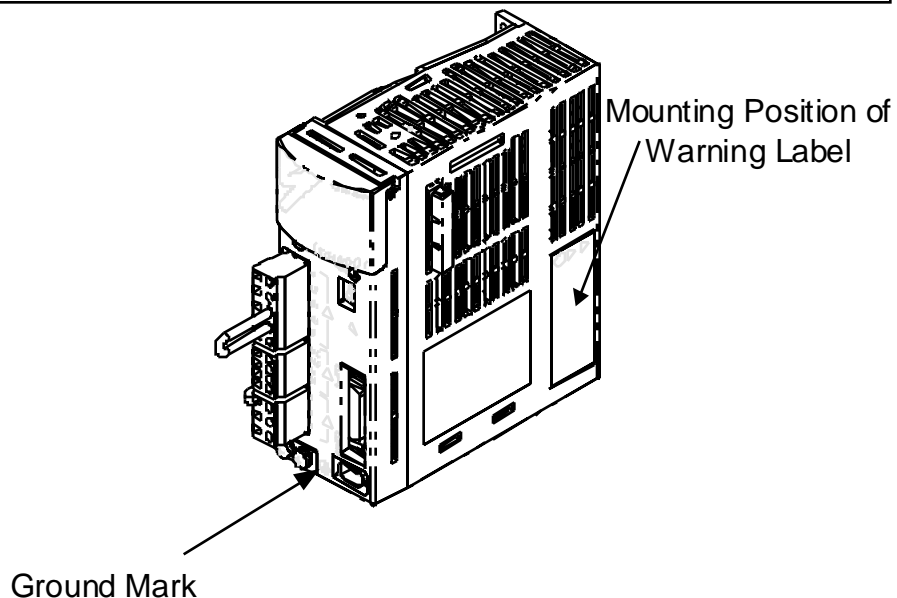


Figure A: Attachment Position of Warning Label and Ground Mark

Table Of Contents

Safety-Related Symbols	i
Icon Display	ii
Outline of Manual	iii
Safety Notes	iv
■ Inspection Upon Receipt of Product.....	iv
■ Mounting.....	iv
■ Wiring	iv
■ Operation.....	v
■ Maintenance/Inspection	v
■ General Cautionary Items	vi
■ Warning Label	vi
1. Interpretation of Model Number	1
1.1 Rotary Motor Type	1
1.2 Linear Motor Type	2
■ Motor Coils	2
1.3 Core-less Type	2
■ Motor Coil.....	2
1.4 T-Type Iron Core	3
■ Motor Coil.....	3
1.5 F-Type Iron Core	4
■ Motor Coil.....	4
1.6 Digital Torque Amplifier	5
1.7 Serial Converter Unit	6
2. Wiring	9
2.1 Main Circuit Wiring	9
■ Main Circuit Terminal Names and Functions	9
■ Example of Typical Main Circuit Wiring.....	12
■ Power ON Sequence Design	13
■ Power Line Size and Peripheral Devices	13
■ Digital Torque Amplifier Power Loss	13
■ Main Circuit Terminal Block Wiring Method	13
■ Power Terminal Processing	14
■ Peripheral Device Types and Capacities	15
2.2 Input Signals	16
■ Example of I/O Signal Connection	16
■ Connector (CN1) Terminal Array List.....	17
■ CN1 Specifications	17
■ I/O Signal Names and Their Functions	18


■	Command Input Circuit and Interface.....	20
■	Sequence Input Circuit and Interface.....	20
■	Output Circuits and Interfaces.....	21
2.3	Wiring to the Encoder	22
2.4	Cable Specifications and Peripheral Devices	24
2.5	Standard Connection Examples	26
■	Single-phase Power Specification (SGDG-01GT, SGDG-04GT).....	26
■	3-Phase Power Specification (SGDG-10GT, SGDG-15GT)	27
3.	Setup	29
3.1	Linear Motor Mounting	29
3.2	Rotary Motor Mounting	29
■	Storage Temperature	30
■	Mounting Location.....	30
■	Alignment	31
■	Mounting Direction	31
■	Shaft Tolerance Ranges.....	31
■	Oil and Water Countermeasures.....	32
■	Cable Stress.....	32
■	Vibration Resistance	33
3.3	Digital Torque Amplifier Installation	34
■	Storage Conditions.....	34
■	Mounting Conditions.....	34
3.4	Switch Settings	37
■	SW1 Function Selection Switch (dip switches)	37
■	SW2 Linear Scale Pitch Setting (rotary switch).....	37
■	SW3 PG Divider Setting (rotary switch)	38
3.5	Combinations	39
■	Combinations with Rotary Motors	39
■	Linear Motor Combinations	40
■	Serial Conversion Unit and Applicable Motors	40
4.	Description of Functions	41
4.1	Torque/Force Control	41
4.2	Protection Sequence Design	41
■	Servo ON Input.....	42
■	DB OFF Input	43
■	RUN Signal Output.....	43

4.3 Encoder Signal Output	44
■ I/O Signals	45
■ Output Phase Form	45
■ PG Divider Setting.....	46
4.4 Analog Monitor	47
4.5 Regenerative Resistor Selection	47
■ External Regen Resistors.....	48
■ Connecting the Regen Resistor	48
■ For Digital Torque Amplifiers of 400W Capacity or Less.....	48
■ For Digital Torque Amplifiers of 500W Capacity or More	48
■ Calculating Regen Energy.....	48
5. Servo System Maintenance/Inspection	49
5.1 Motor Inspection	49
5.2 Digital Torque Amplifier Inspection	50
■ Component Replacement Timeline.....	50
■ Use Conditions	50
5.3 Alarms	51
■ 7-Segment LED	51
■ Alarm List	51
Appendix A: Host Controller Connection Examples	53
A.1 Connecting the Galil IMC-1900/2900	53
A.2 Connecting the Delta Tau PMAC2	54
A.3 Connection the MEI PCX/DSP	55
A.4 Connection the Acroloop ACR-8010	56
Appendix B: Installation Conditions for EMC Directives	57
■ EMC Installation Conditions	57
■ The Cable Core	60
■ Cable Clamp.....	60
Index	63

Notes:

1. Interpretation of Model Number


1.1 Rotary Motor Type

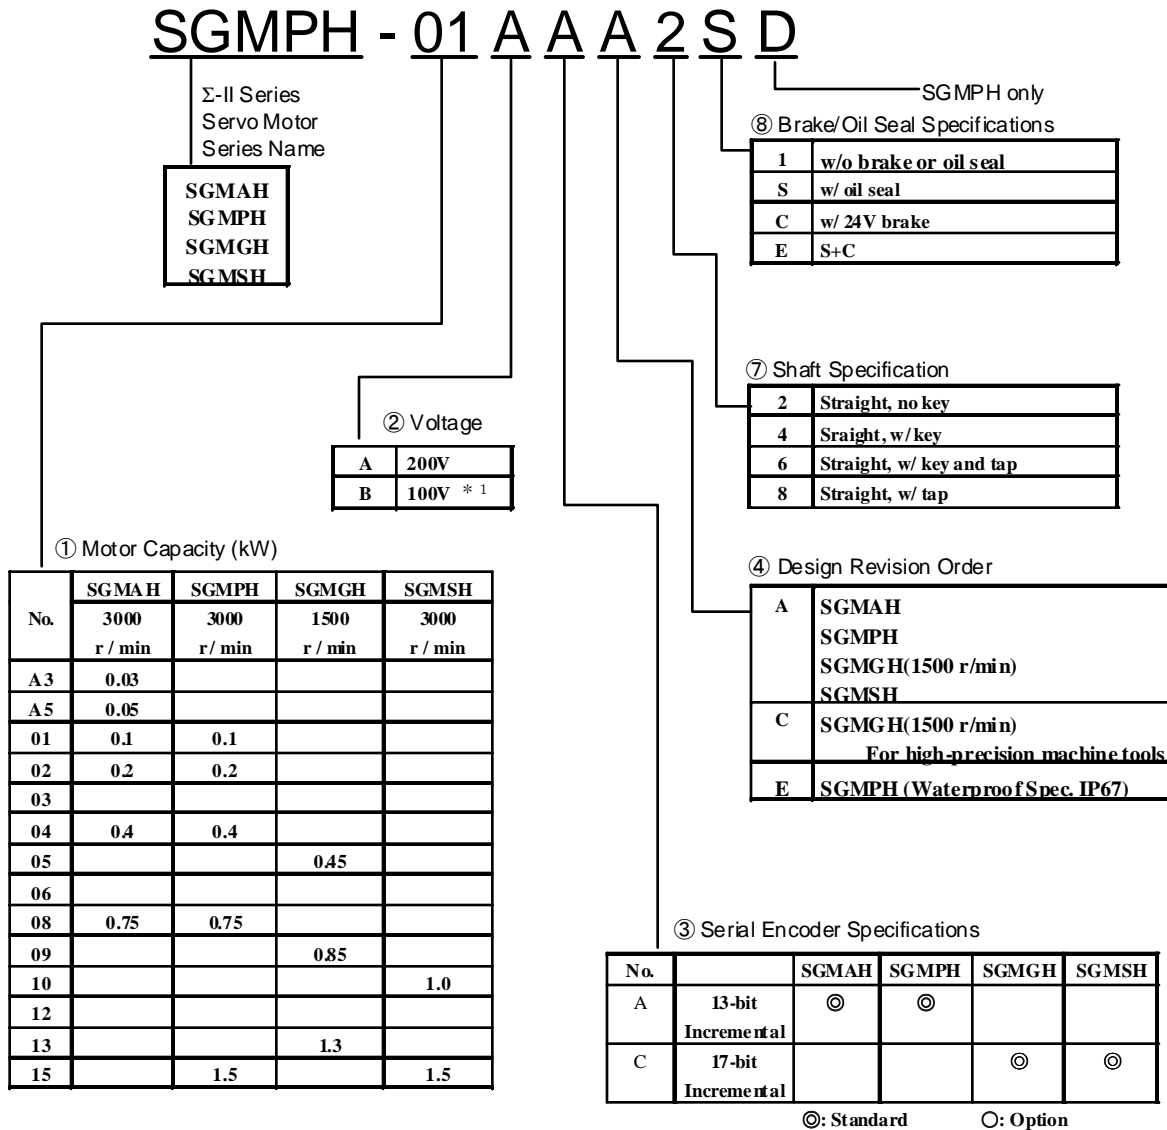

*1. 100V is only for use with SGMAH, SGMPH servo motors of 0.2kW or less.


1.2 Linear Motor Type

■ Motor Coils

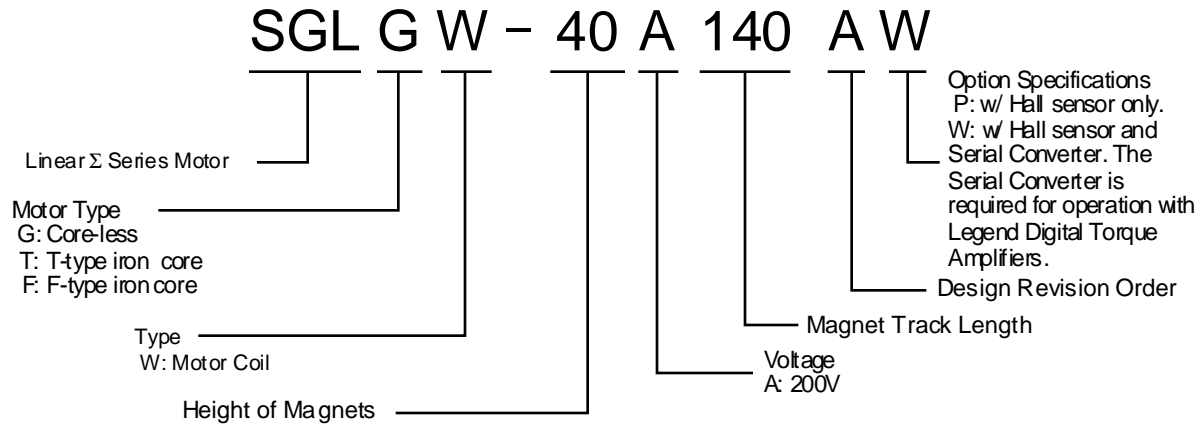

1.3 Core-less Type

■ Motor Coil

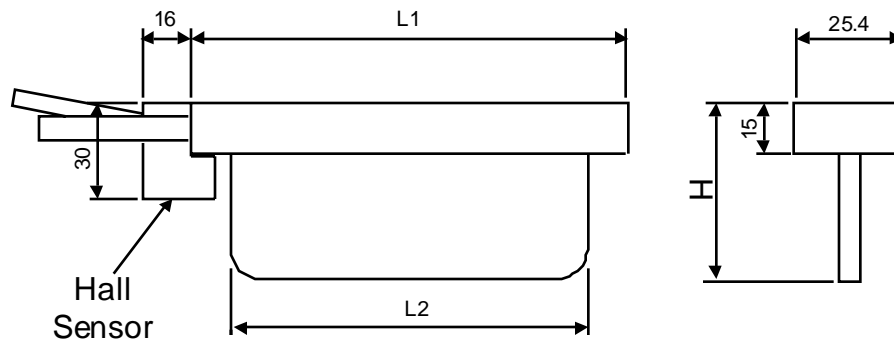


Model SGLGW-	Max. Thrust (N)	Cont. Thrust (N)	External Dimensions (mm)			Mass (kg)
			L1	L2	H	
40A140A(P)	140	47	140	125	63	0.39
40A253A(P)	280	93	252.5	237.5	63	0.65
40A365A(P)	420	140	365	350	63	0.91
60A140A(P)	220	73	140	125	83	0.47
60A253A(P)	440	147	252.5	237.5	83	0.80
60A365A(P)	660	220	365	350	83	1.13


1.4 T-Type Iron Core

■ Motor Coil

Type: SGLTW-20A □□□ A(P), SGLTW -35A □□□ A(P)

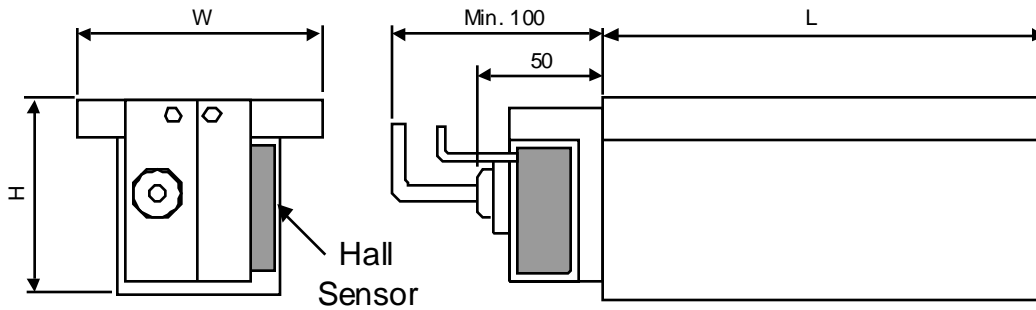


Type: SGLTW-40A □□□ A(P), SGLTW -80A □□□ A(P)

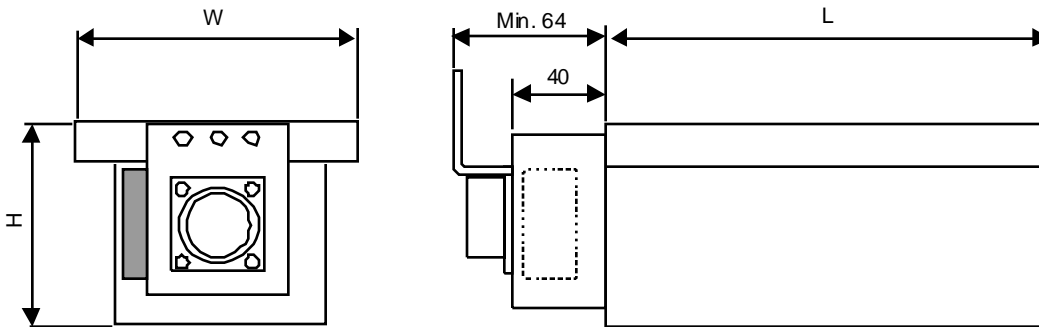

Model SGLTW-	Max. Thrust (N)	Cont. Thrust (N)	External Dimensions (mm)			Mass (kg)
			L	W	H	
20A170A(P)	380	130	170	100	51	2.6
20A320A(P)	760	250	315	100	51	4.8
20A460A(P)	1140	380	460	100	51	7
35A170A(P)	660	220	170	100	66	3.7
35A320A(P)	1320	440	315	100	66	6.8
35A460A(P)	2000	670	460	100	66	10
40A400A(P)	2000	670	395	150	78	20
40A600A(P)	3000	1000	585	150	78	30
80A400A(P)	4000	1300	395	150	115	30
80A600A(P)	6000	2000	585	150	115	43


1.5 F-Type Iron Core

■ Motor Coil

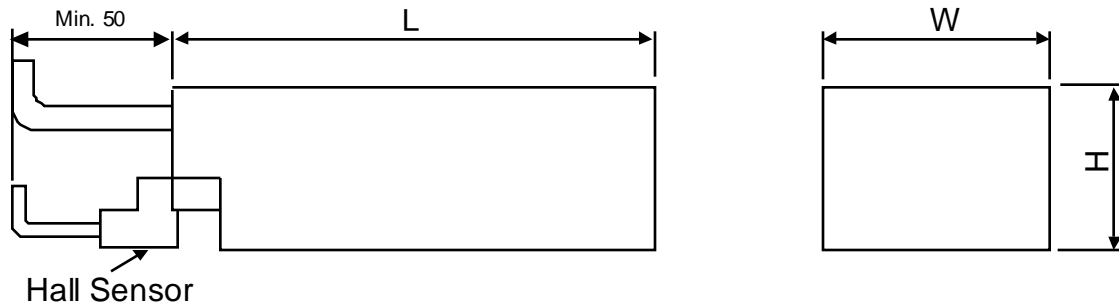

Model SGLFW-	Max. Thrust (N)	Cont. Thrust (N)	External Dimensions (mm)			Mass (kg)
			L	W	H	
20A090A(P)	86	25	91	40	34	0.7
20A120A(P)	125	40	127	40	34	0.9
35A120A(P)	220	80	127	55	34	1.3
35A230A(P)	440	160	235	55	34	2.3
50A200A(P)	600	200	215	71.5	43	3.7
50A380A(P)	1200	400	395	71.5	43	6.9
1ZA200A(P)	1200	400	215	119	43	6.4
1ZA380A(P)	2400	800	395	119	43	12.2

1.6 Digital Torque Amplifier

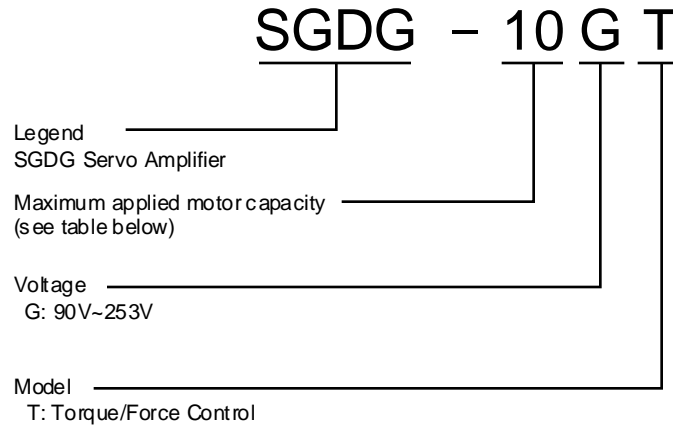

Maximum Capacity of Applied Motor

Applied Motor Maximum Capacity Symbol	Capacity (kW)
01	0.1
04	0.4
10	1.0
15	1.5

Note: Keep the following in mind in SGDG digital torque amplifier and SGD□H/SGL□W servomotor combinations:

The SGDG-01GT can drive motors of 30~200W rated output.

The SGDG-04GT can drive motors of 100~750W rated output.

The SGDG-10GT can drive motors of 300W~2kW rated output.

The SGDG-15GT can drive motors of 750W~3kW rated output.

Since LEGEND servo drives are applicable to a wider range motor and driver combinations, the output power of the drive will dictate the available maximum motor power even if the maximum output power of the motor is larger than that of the connected drive.

Specific speed/torque performance will vary depending on such power supply conditions as voltage, number of available phases, etc.






1.7 Serial Converter Unit

JZDP – A000 – △△△

Conversion unit type
(see table below)

Compatible Motor Numbers
Varies according to compatible motors
(see table below)

Serial Converter Unit Type Model Classifications

Model	Model	Usage Scale	Hall Sensor (Y/N?)
JZDP-A003		By Haidenhain	N
JZDP-A004 (Note) US Market-dedicated		By Renishaw	Y
JZDP-A005		By Renishaw	N
JZDP-A006		By Haidenhain	Y
JZDP-A008		By Renishaw	Y

Serial Converter Units and Applied Motors

Serial Converter Unit Model JZDP-A00 □ - □□□	Applied Motor	Serial Converter Unit Model JZDP-A00 □ - □□□	Applied Motor
001	SGLGW-40A140A(P)	013	SGLTW-20A460A(P)
002	SGLGW-40A253A(P)	014	SGLTW-35A170A(P)
003	SGLGW-40A365A(P)	015	SGLTW-35A320A(P)
004	SGLGW-60A140A(P)	016	SGLTW-35A460A(P)
005	SGLGW-60A253A(P)	017	SGLFW-20A090A(P)
006	SGLGW-60A365A(P)	018	SGLFW-20A120A(P)
007	SGLTW-40A400A(P)	019	SGLFW-35A120A(P)
008	SGLTW-40A600A(P)	020	SGLFW-35A230A(P)
009	SGLTW-80A400A(P)	021	SGLFW-50A200A(P)
010	SGLTW-80A600A(P)	022	SGLFW-50A380A(P)
011	SGLTW-20A170A(P)	023	SGLFW-1ZA200A(P)
012	SGLTW-20A320A(P)	024	SGLFW-1ZA380A(P)

Notes:

2. Wiring

2.1 Main Circuit Wiring

Here we will show representative examples of main circuit wiring, the functions of the main circuit terminals, as well as the power input sequence, etc. Observe the following cautionary items when wiring.

⚠ CAUTION
<ul style="list-style-type: none"> • Do not pass the power line and signal lines through the same duct or bundle them together. Keep the power line and signal lines at least 30cm apart when wiring. • Use a twist pair wire or multi-core twisted-pair bundled shield wire for the signal and encoder lines. The maximum wiring length is 3m for the command input line, and 20m for the encoder feedback line. • Do not touch the power terminal for 5 min. after power OFF as a high voltage may remain even after power OFF. Perform inspection work after checking that the CHARGE lamp has gone out. • Do not turn the power ON/OFF frequently. Limit ON/OFF repetition to one time per minute. Because the digital torque amplifier has a capacitor in its power unit, a large charging current (charging time: 0.2sec.) will be fed at power ON. For this reason, frequent power ON/OFF switching degrades the main circuit element within the digital torque amplifier.

■ Main Circuit Terminal Names and Functions


Table 2.1 shows the names of the main circuit terminals and their functions.

Table 2.1: Main Circuit Terminal Names and their Functions

Terminal Code	Name	Function
L1, L2 or L1, L2, L3	Main Circuit Power Input Terminal	100W/400W Single Phase 90~253 V 1.0kW~1.5kW Three Phase 90~253 V
U, V, W	Motor Connection Terminal	Connected to motor.
L1C, L2C	Control Power Input Terminal	Single Phase 90~253 V
⊕(2 places)	Ground Terminal	Perform “Ground Processing“ by connecting with the power grounding terminal and the motor grounding terminal.

Table 2.1: Main Circuit Terminal Names and their Functions (Continued)

Terminal Code	Name	Function	
B1, B2 or B1, B2, B3	External Regen Resistor Connection Terminal	100W/400W	Connection not normally needed. Connect an external regen resistor (provided by customer) between B1-B2 if regen capability is insufficient. (Note) There is no B3 terminal.
		1.0kW/1.5kW	B2-B3 is normally shorted (using the integrated regen resistor) If the capacity of the internal regen resistor is insufficient, connect an external regen resistor (provided by customer) between B1-B2 with B2-B3 open (wiring removed).
⊕1, ⊕2	High-Frequency Harmonic Suppressing DC Reactor Connection Terminal	This is normally shorted between ⊕1-⊕2. If harmonic frequency suppression is needed, connect a DC reactor between ⊕1-⊕2.	
⊖	Main Circuit Load Terminal	Connection is normally not needed.	

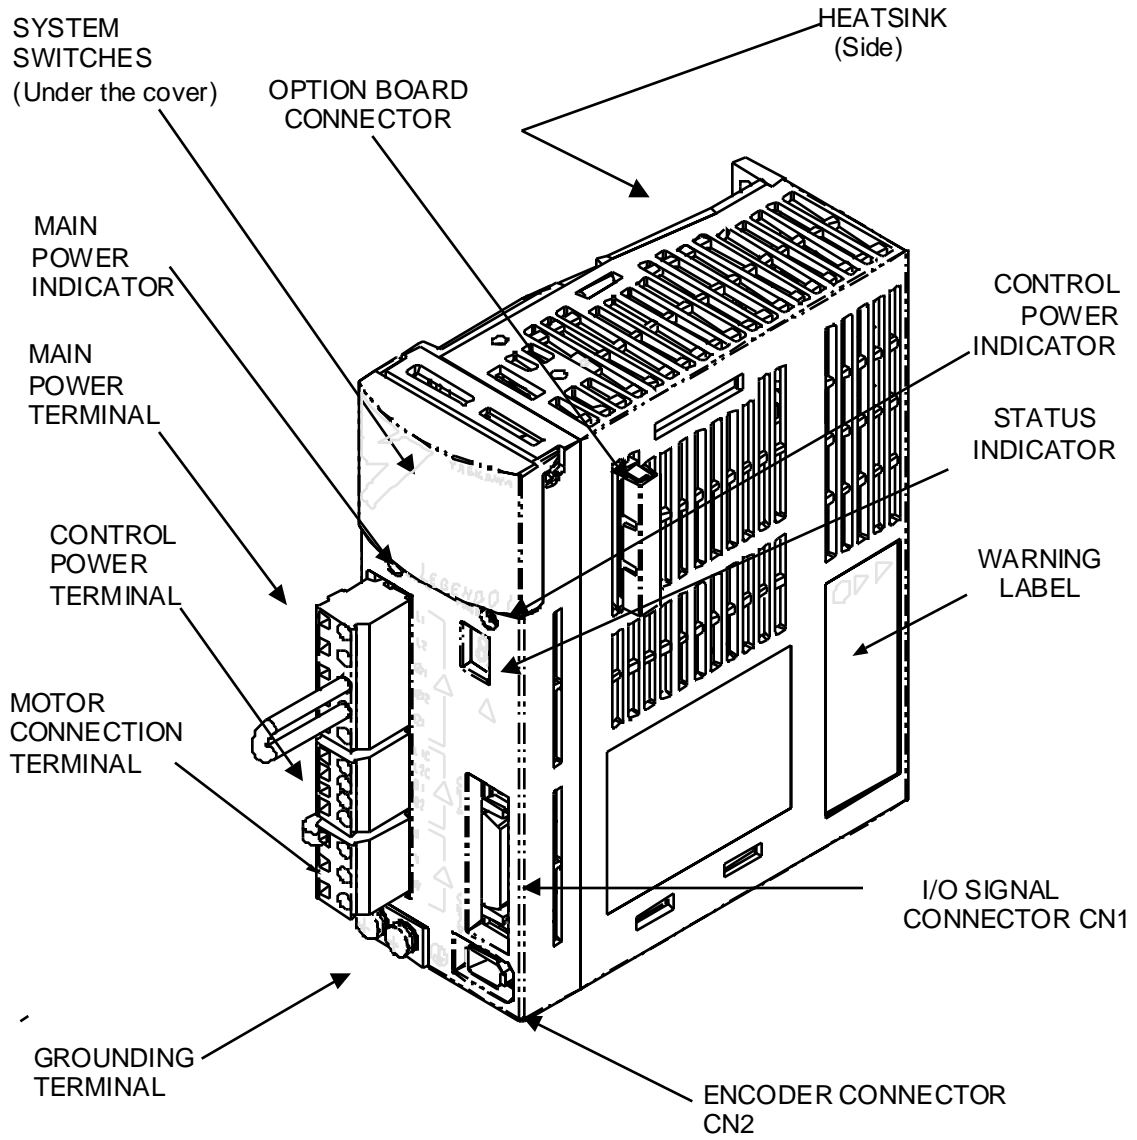

■ Example of Typical Main Circuit Wiring

A typical wiring example is shown in the figure below.


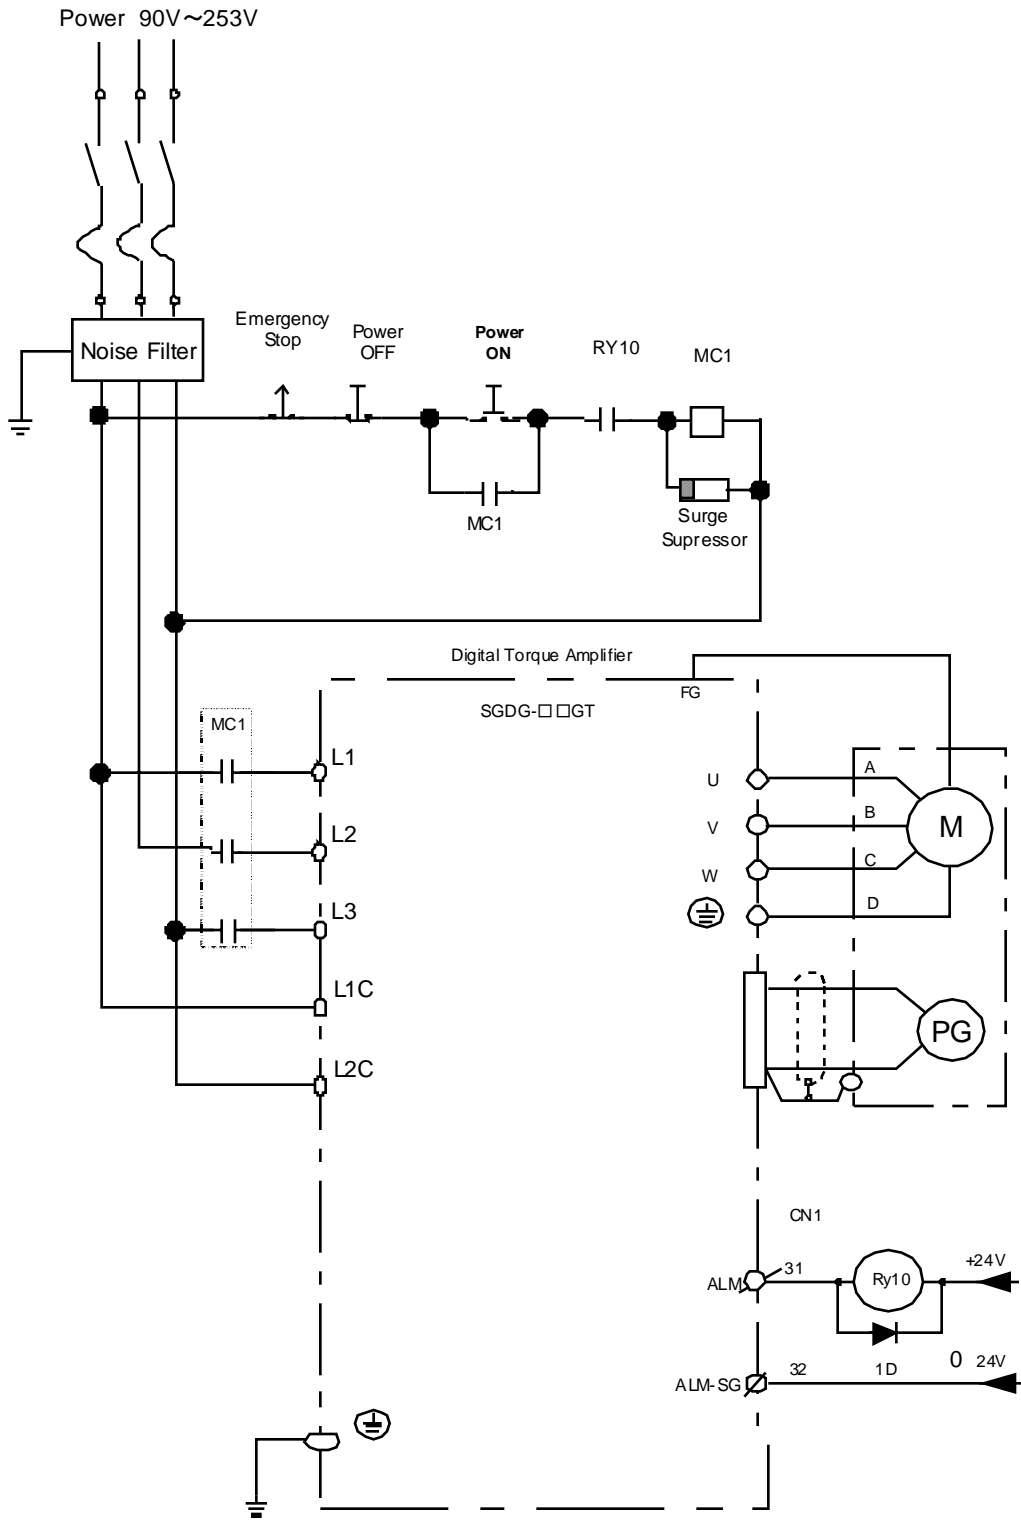


Figure A Main Circuit Wiring Example

■ Power ON Sequence Design

Keep the following in mind when designing a Power ON Sequence.

- Design the power feed sequence so that the power goes OFF if a “Servo Alarm” is output. See “Figure A Main Circuit Wiring Example” on page 12.
- Hold down the power ON button for at least two seconds. The digital torque amplifier will output a “Servo Alarm” signal for at most two seconds at power ON. This is necessary for digital torque amplifier initial setting.

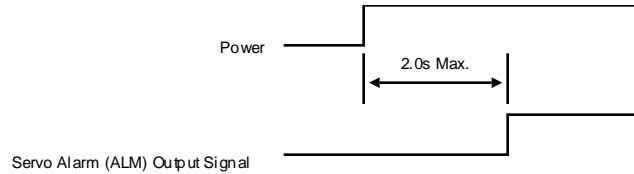

■ Power Line Size and Peripheral Devices

See the Σ -II Series Servo System User's Manual: Servo Selection and Data Sheet edition. (Document Number: YEA-SIA-S800-32.2x)

■ Digital Torque Amplifier Power Loss

The digital torque amplifier power loss at continuous output is shown in Table 2.2 below.

Table 2.2: Digital Torque Amplifier Power Loss at Continuous Output

Main Circuit	Max. Applied Motor Capacity	Digital Torque Amplifier Model	Output Current (actual) A	Main Circuit Power Loss W	Regen Resistor Power Loss W	Control Circuit Power Loss W	Total Power Loss W
Single-phase 200V	0.10	SGDG-01GT	0.91	6.7	–	13	19.7
	0.40	SGDG-04GT	2.8	20	–	13	33
3-phase 200V	1.0	SGDG-10GT	7.6	55	12	15	82
	1.5	SGDG-15GT	11.6	123	14	15	152

Note: The regen resistor power loss is the allowable power loss. Take the following measures if this value is exceeded. Remove the lead wire of the digital torque amplifier's integrated regen resistor. and install an external regen resistor. Furthermore, the external regen resistor is an option. For details on regen resistors, see “4.5 Regenerative Resistor Selection”.

■ Main Circuit Terminal Block Wiring Method

Observe the following cautionary items when wiring.


CAUTION

- Perform wiring after removing the terminal block from the digital torque amplifier unit.
- Insert one wire into each power line insertion aperture in the terminal block.
- When inserting the power lines, be sure that they do not short against the surrounding material due to exposed wire cores.
- Power lines that have been mistakenly pulled out by excessive force should be re-stripped then connected.

Servo amplifiers with capacities of 1.5kW or less consist of a connector-type terminal block for the main circuit. Wire the terminal block by the following procedure.

Connection Method

1. Strip the insulation of the power lines used.



2. Open the terminal block wiring insertion area with a tool. There are two opening methods as shown in figures A and B.
 - Figure A shows opening by prying with an accessory lever.
 - Figure B shows opening by forcibly pressing the driver insertion aperture with either a flathead screwdriver (head width 3.0~3.5mm (.118~.138 in.) or a 210-120J-type driver from Wago, Inc.The work can be done using either of the methods in Figure A: or Figure B:.

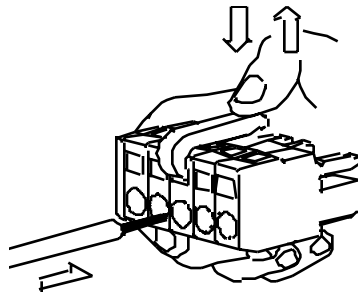


Figure A:

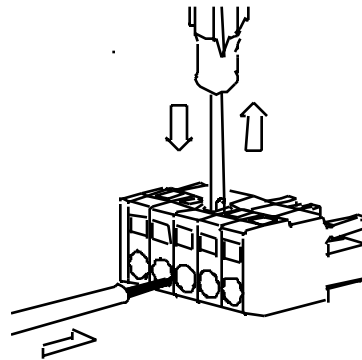


Figure B:

3. Insert the core of the power line into the opening. Release the lever or the pressure on the driver after insertion.

■ Power Terminal Processing

Strip the insulation on the power line. The useable line sizes are as follows:

- Solid Conductor .. $\phi 0.5\sim\phi 1.6\text{mm}$
- Stranded Conductor ..AWG28~AWG12

■ Peripheral Device Types and Capacities
 Table 2.3 Shows Servopack device Types and capacities

Table 2.3: Peripheral Device Types and Capacities


Main Circuit Power Supply	Model		Power Supply Capacity Per Amplifier (KVA)	MCCB or Fuse Capacity (Arms)	Recommended Noise Filter*		Magnetic Contactor
	Capacity (kW)	SGDG-			Model	Specifications	
Single-Phase 200V	0.1	01GT	0.10	4	FN2070-6/07	Single-Phase 250VAC 6A	HI-11J (20A) or Equivalent
	0.4	04GT	0.40	4	FN2070-10/07	Single-Phase 250VAC 10A	HI-15J (35A) or Equivalent
Three-Phase 200V	1.0	10GT	2.3	7	FN258L-16/07	Three-Phase 480V 16A	HI-15J (35A) or Equivalent
	1.5	15GT	3.2	10			

* The FN □□□□ noise filter is manufactured by Schaffner Corp.

2.2 Input Signals

■ Example of I/O Signal Connection

- A typical example of I/O signal connection is shown below.

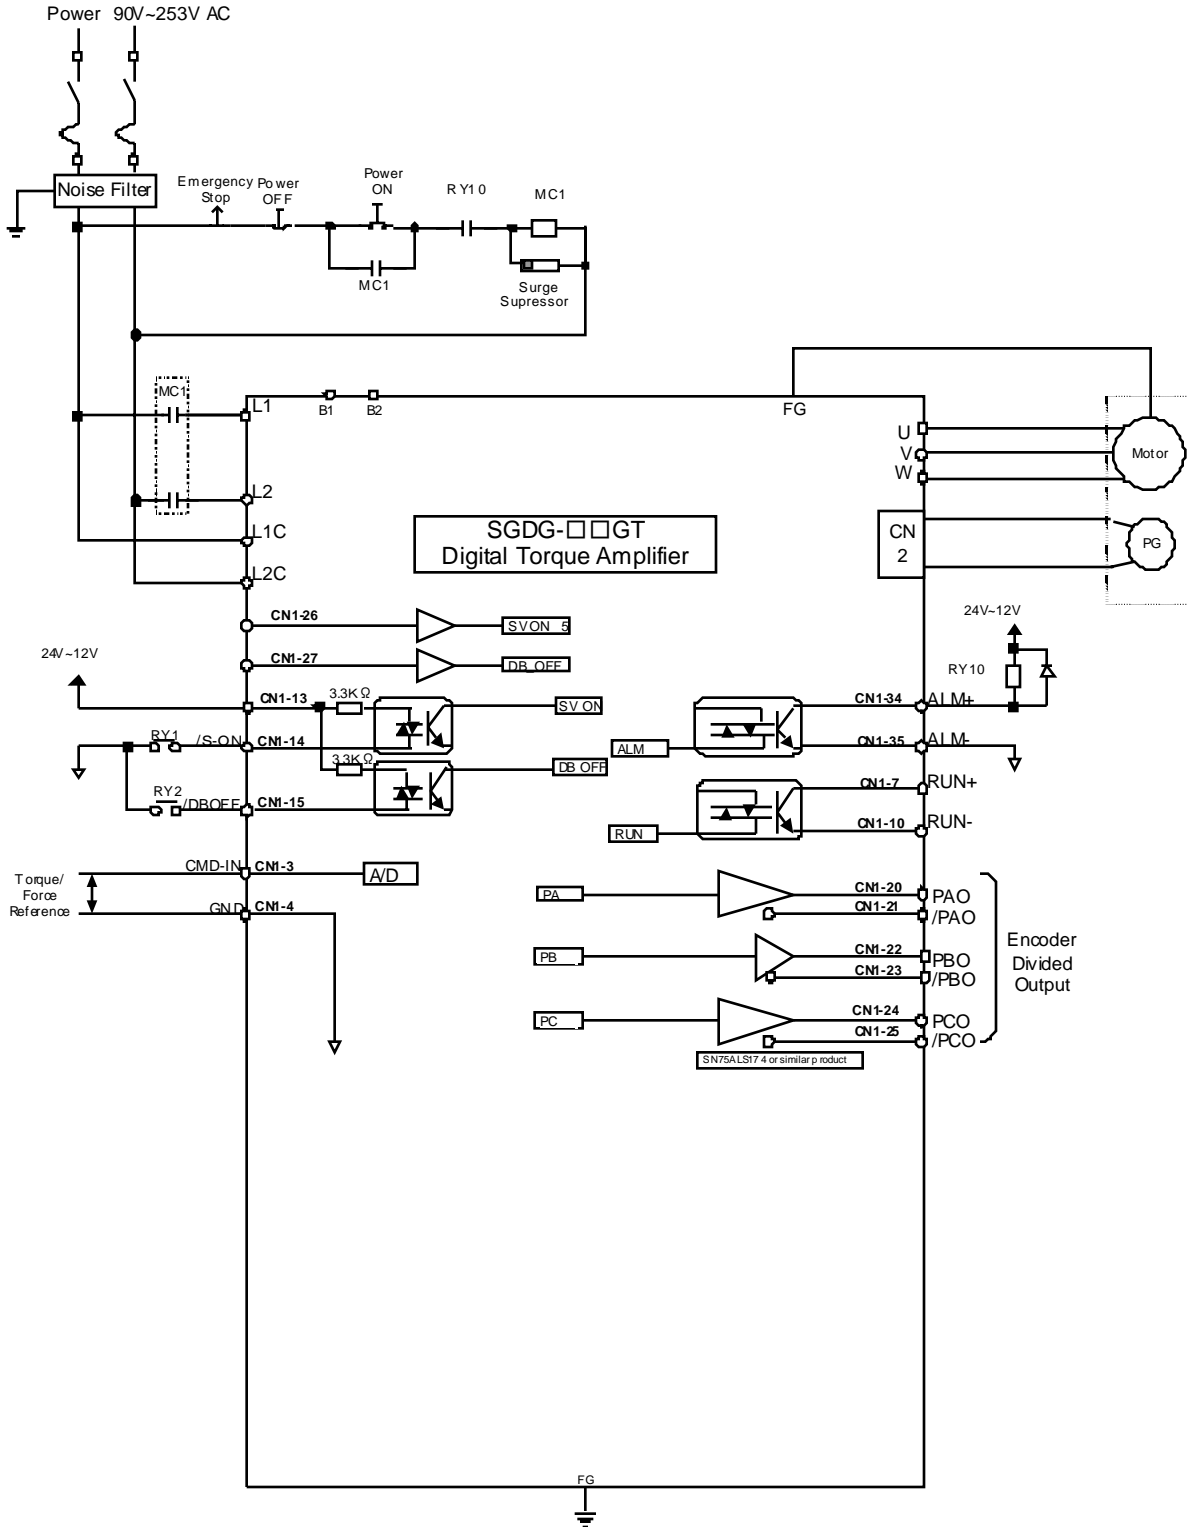

■ Connector (CN1) Terminal Array List

The CN1 terminal array and its specifications are shown below.

CN1 Terminal Layout

1	---	---				19	GND	GND			
3	CMD -IN	Torque/ Force Reference Input	2	GND	GND	21	*PAO	Encoder Dvided Output A- phase	20	PAO	Encoder Dvided Output A- phase
5	---	---	4	GND	GND	23	*PB0	Encoder Dvided Output B- phase	22	PBO	Encoder Dvided Output B- phase
7	RUN +	RUN Signal Output	6	GND	GND	25	*PCO	Encoder Dvided Output C-phase	24	PCO	Encoder Dvided Output C-phase
9	---	---	8	---	---	27	DB OFF5	DB OFF Signal Input	26	/S-ON5	Servo ON Input
11	---	---	10	RUN -	RUN Signal Output	29	Torque Mon	Torque Monitor 5V/Max. Torq.	28	SPD- MON	Speed Monitor 1V/1000 RPM
13	+24V	External Power Input	12	---	---	31	---	---	30	---	---
15	DB OFF	DB OFF Signal Input	14	/S-ON	Servo ON Signal Input	33	GND	GND	32	---	---
17	---	---	16	---	---	35	ALM -	Servo Alarm Output	34	ALM +	Servo Alarm Output
			18	---	---				36	---	---

Note 1 Do not use empty terminals for relays.

Note 2 Connect the I/O signal cable shield wire to the connector shell. This is connected to the frame ground on the digital torque amplifier side connector.

■ CN1 Specifications

Specification for Connector Used in Digital Torque Amplifier	Applied Receptacle Model		
	Soldering Type	Case	Manufacturer Name
10236-52A2JL-type Right Angle 36P	10136-3000VE	10336-52A0-008	Sumitomo 3M, Inc.

■ I/O Signal Names and Their Functions

The names and functions of the digital torque amplifier I/O signals are shown below.

Input Signals

Signal Name		Pin No.	Function
Common	/S-ON	14 26	Servo ON • The inverter output is enabled to provide power to the motor.
	DB — OFF	15	DB Release • A free run state has resulted by releasing the DB.
	+24VIN	13	Sequence signal control power input • +24V power supply provided by customer. ?
Torque	CMD-IN	3	Torque/Force Reference Input • -10~+10VDC

Output Signals

Signal Name		Pin No.	Function	
Common	ALM+	34	Servo Alarm : Turns OFF due to error detection.	
	ALM -	35		
	PAO	20	A-phase Signal	2-phase pulse (A-phase, B-phase) Conversion Encoder Output Signal and origin pulse (C-phase) signal
	*PAO	21	B-phase Signal	
	PBO	22		
	*PBO	23		
	PCO	24	C-phase Signal	
	*PCO	25		
	RUN+	7	Base Block Release Signal	
	RUN -	10	: Output during base block release	
	SPD-MON	28	Speed Monitor (1V/1000rpm), Linear Scale 1V/1000mm/sec	
	---	29	Reserved	
FG	Shell	The frame ground in connected upon connection of the I/O signal cable shield wire to the connector shell.		

Output Signals (Continued)

Signal Name		Pin No.	Function
Reserved		1	Open Terminal (Note) Do not use empty terminals for relays, etc.
		5	
		8	
		9	
		11	
		12	
		16	
		17	
		18	
		30	
		31	
		32	
		36	

■ Interface Circuit


An example is given below of connection of the digital torque amplifier I/O signals to an upper level device.

■ Command Input Circuit and Interface


Analog Input Circuit

The analog signal is the torque reference signal. The input impedance is as follows.

- Command Input (CMD-IN): Approx. 14kΩ
The maximum allowable voltage for the input signal is ±12V.

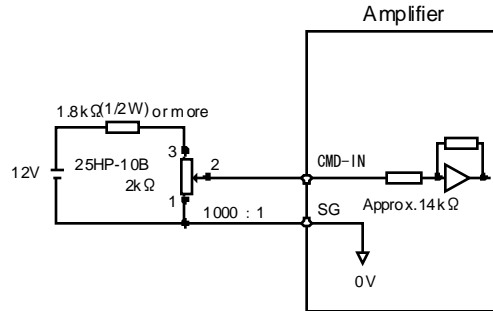

■ Sequence Input Circuit and Interface

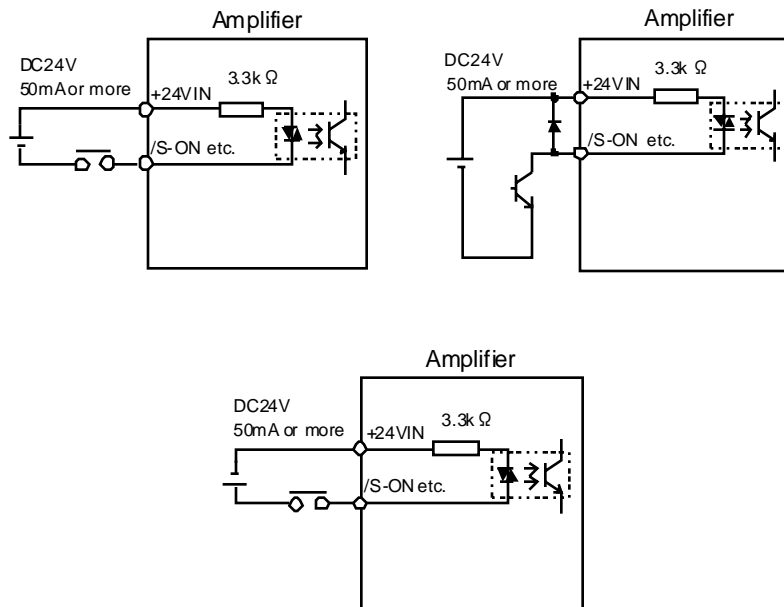


This is connected by a relay or open collector transistor circuit. Select minute current relay when connecting by relay. If no minute current relay is established, this will cause a connection fault.

■ Output Circuits and Interfaces

The output signal circuits of the digital torque amplifier are of the three types shown below. Configure the input circuit on the upper-level device to match each of these output circuits.

- **Connection with Line Driver Output Circuits**
The output signals (PAO, *PAO, PBO, *PBO) where the encoder serial data was converted to a 2-phase (A-phase, B-phase) pulse, and the origin pulse signal (PCO, *PCO) are output by the line driver circuit. The upper-level device receives these through the line receiver circuit.
See “2.3 Wiring to the Encoder” for an example of the connection circuit.
- **Connection with Photocoupler Output Circuit**
Servo alarms and other output signals for sequence use are configured in the photocoupler output circuit. They are connected through the relay and line driver circuits.

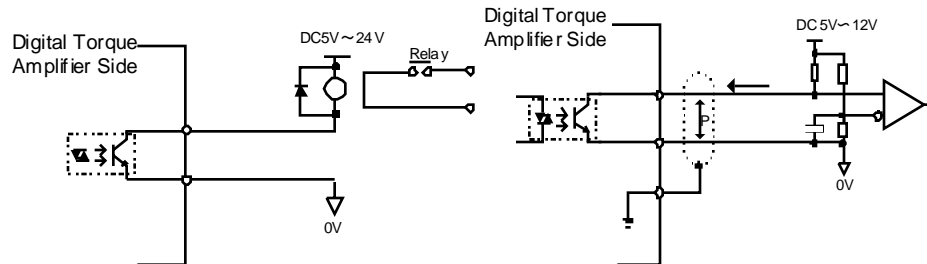


Note: The maximum allowable voltage and current capacity of the photocoupler output circuit are as follows:

- Voltage: DC30V(Max.)
- Current: DC50mA(Max.)

2.3 Wiring to the Encoder

The wiring of the digital torque amplifier to the encoder is described here.

- Connection to Encoder (CN2) and Output Signal Processing from Digital Torque Amplifier (CN1)

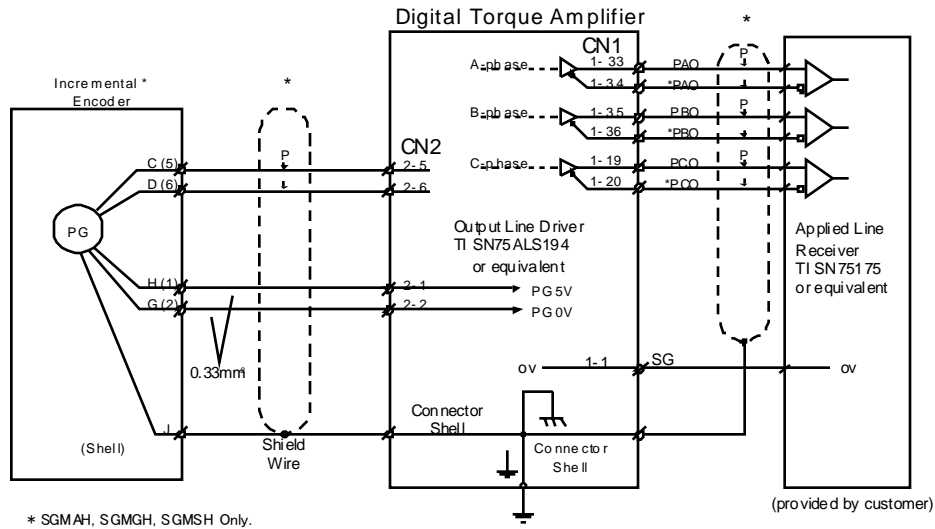

■ Encoder Connector (CN2) Terminal Array and Models

The CN2 terminal arrays and models are shown below.

CN2 Terminal Array

1	PG5V	Encoder Power +5V	2	PG0V	Encoder Power 0V
5	PS	Encoder Serial Signal Input	6	*PS	Encoder Serial Signal Input

CN2 Connectors

Model of Connector Used in Digital Torque Amplifier	Applied Plug (or socket) Model		
	Plug, soldered type (digital torque amplifier- side connector)	Socket, soldered type, (motor-side connector)	Manufacturer Name
53460-0611	55100-0600	54280-0600	Japan Molex, Inc.

Note: The plug and socket on the digital torque amplifier side are a set product FA1394 from Japan Molex, Inc.

Note: The motor-side socket is connected to the connector for the SGMAH, SGMPH servomotor encoder.

Note: The SGMGH and SGMSH servomotor encoder connectors are shown below.

- Plug L-type: MS3108B20-29S or
- Straight: MS3106B20-29S
- Cable Clamp: MS3057-12A




Yaskawa provides a dedicated cable for the encoder. For details, see the following document.

- Σ -II Servo System Product Catalog Supplement
(Doc.# G-MI#99001D-Sigma II)


2.4 Cable Specifications and Peripheral Devices

Ratings and specifications for peripheral devices, as well as cable specifications for digital torque amplifiers are summarized in the tables below.



<h3>Wiring Precautions</h3> <ul style="list-style-type: none"> • Do not bundle or run power and signal lines together in the same duct. Keep power and signal lines at least 11.81" (30cm) apart. • Use twisted pair or shielded multi-core twisted pair wires for signal and encoder (PG) feedback lines. • The maximum lengths for signal lines are as follows: <ul style="list-style-type: none"> • Maximum of 9.84ft (300cm) for reference input lines. • Maximum of 65.6ft (20m) for PG feedback lines. • Use a cable with 164 ft (50m) specifications for distances over 65.6ft (20m).

■ Cable Specifications

The following table provides wire size specifications:

External Terminal Name	SGDG Terminal Symbol	Wire Size AWG [in ² (mm ²)]	
		01GT	04GT
Main circuit power input terminals	L1, L2 (Single Phase)	16 AWG [HIV 0.002 (1.25)]	14 AWG [0.003 (2.0)]
Servomotor connection terminals	U, V, W	16 AWG [HIV 0.002 (1.25)]	
Control power supply terminals	L1C, L2C	16 AWG [HIV 0.002 (1.25)]	
Control I/O signal connector	CN1	Twisted pair or shielded twisted pair wires Core wire at least 28 AWG [0.0002 (0.12)], tinned, annealed copper twisted wires Finished cable dimensions: maximum Φ 0.63in (16mm) for CN1 and Φ 0.27in (6.8mm) for CN2.	
PG signal connector	CN2		
Ground terminal		14 AWG [HIV 0.003 (2.0)]	

Cable Specifications (cont'd)

External Terminal Name	SGDG Terminal Symbol	Wire Size AWG [in ² (mm ²)	
		10GT	15GT
Main circuit power input terminals	L1, L2, L3 (Three-phase)	14 AWG [HIV 0.003 (2.0)]	
Servomotor connection terminals	U, V, W		
Control power supply terminals	L1C, L2C	16 AWG [HIV 0.002 (1.25)]	
Control I/O signal connector	CN1	Twisted pair or shielded twisted pair wires Core wire at least 28 AWG [0.0002 (0.12)], tinned, annealed copper twisted wires Finished cable dimensions: maximum Φ 0.63in (16mm) for CN1 and Φ 0.27in (6.8mm) for CN2.	
PG signal connector	CN2		
Ground terminal		14 AWG [HIV 0.003 (2.0)]	

- Notes:
1. Wire sizes were selected for three cables per bundle at 40°C ambient temperature with the rated current.
 2. Use cables with a minimum withstand voltage of 600V for main circuits.
 3. If cables are bundled in PVC or metal ducts, consider the reduction ratio of the allowable current.
 4. Use heat-resistant cable under high ambient or panel temperatures where normal vinyl cable will rapidly deteriorate.

The following table shows types of cables. It is used in conjunction with the preceding tables.

Cable Type		Temperature Rating of Conductor °C
Name	Composition	
PVC	Standard polyvinyl chloride cable	—
IV	600V PVC cable	60
HIV	Temperature-resistant vinyl cable	75


The following table specifies the appropriate cables for CN1 and CN2 digital torque amplifier connectors.

Wire sizes were selected with the expectation of three cables per bundle, at an ambient temperature of 40°C, at the rated current level.


Connector Name	Signal	Description	Specification
Control I/O Signal Connector	CN1	Cable	Use twisted pair or shielded twisted pair wire.
		Applicable wire	(AWG): 24, 26, 28, 30
		Finished cable Dimension	Φ 0.63 (Φ 16.0) maximum
PG Signal Connector	CN2	Cable	Use Yaskawa cable, or shielded twisted pair wire.
		Applicable wire	(AWG): 24, 26, 28, 30 Use 22 AWG [0.0005in ² (0.34mm ²)] for the encoder power supply and 26 AWG [0.0002 in ² (0.14mm ²)] for other signals. These conditions permit wiring distances up to 65.6ft (20m).
		Finished cable Dimension	Φ 0.27 (Φ 6.8) maximum

2.5 Standard Connection Examples

■ Single-phase Power Specification (SGDG-01GT, SGDG-04GT)

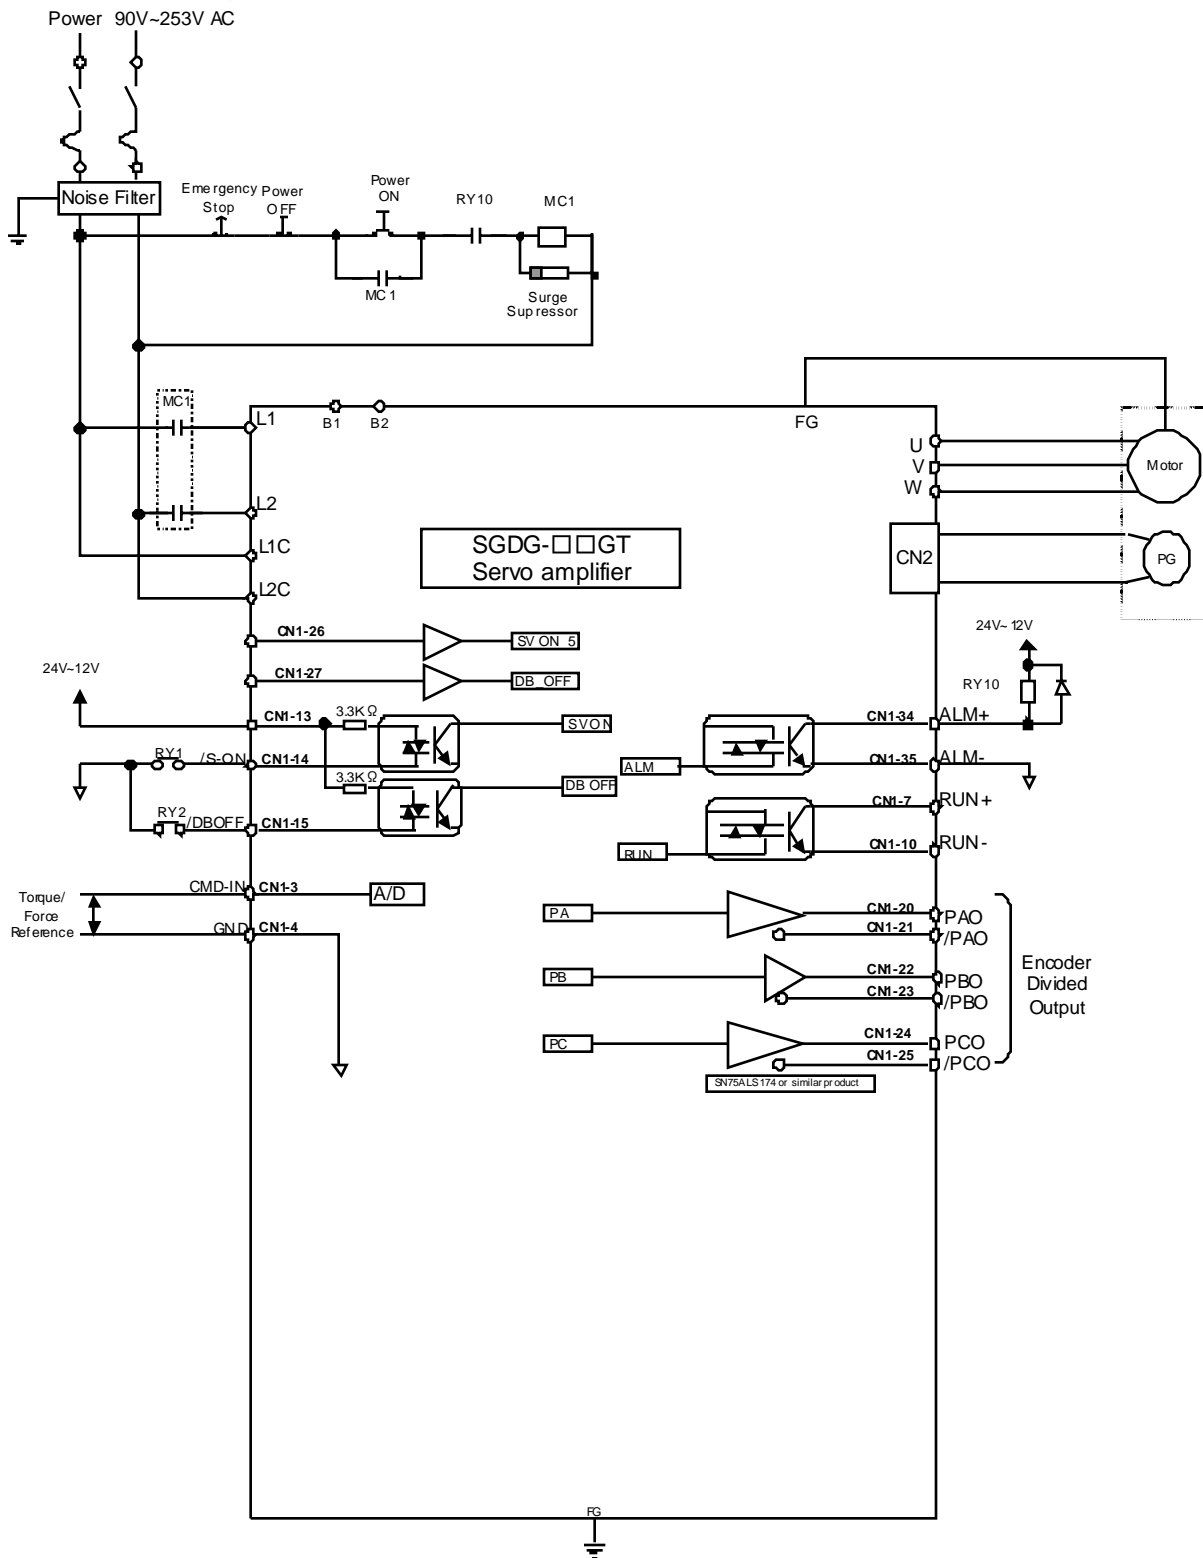

3-Phase Power Specification (SGDG-10GT, SGG-15GT)

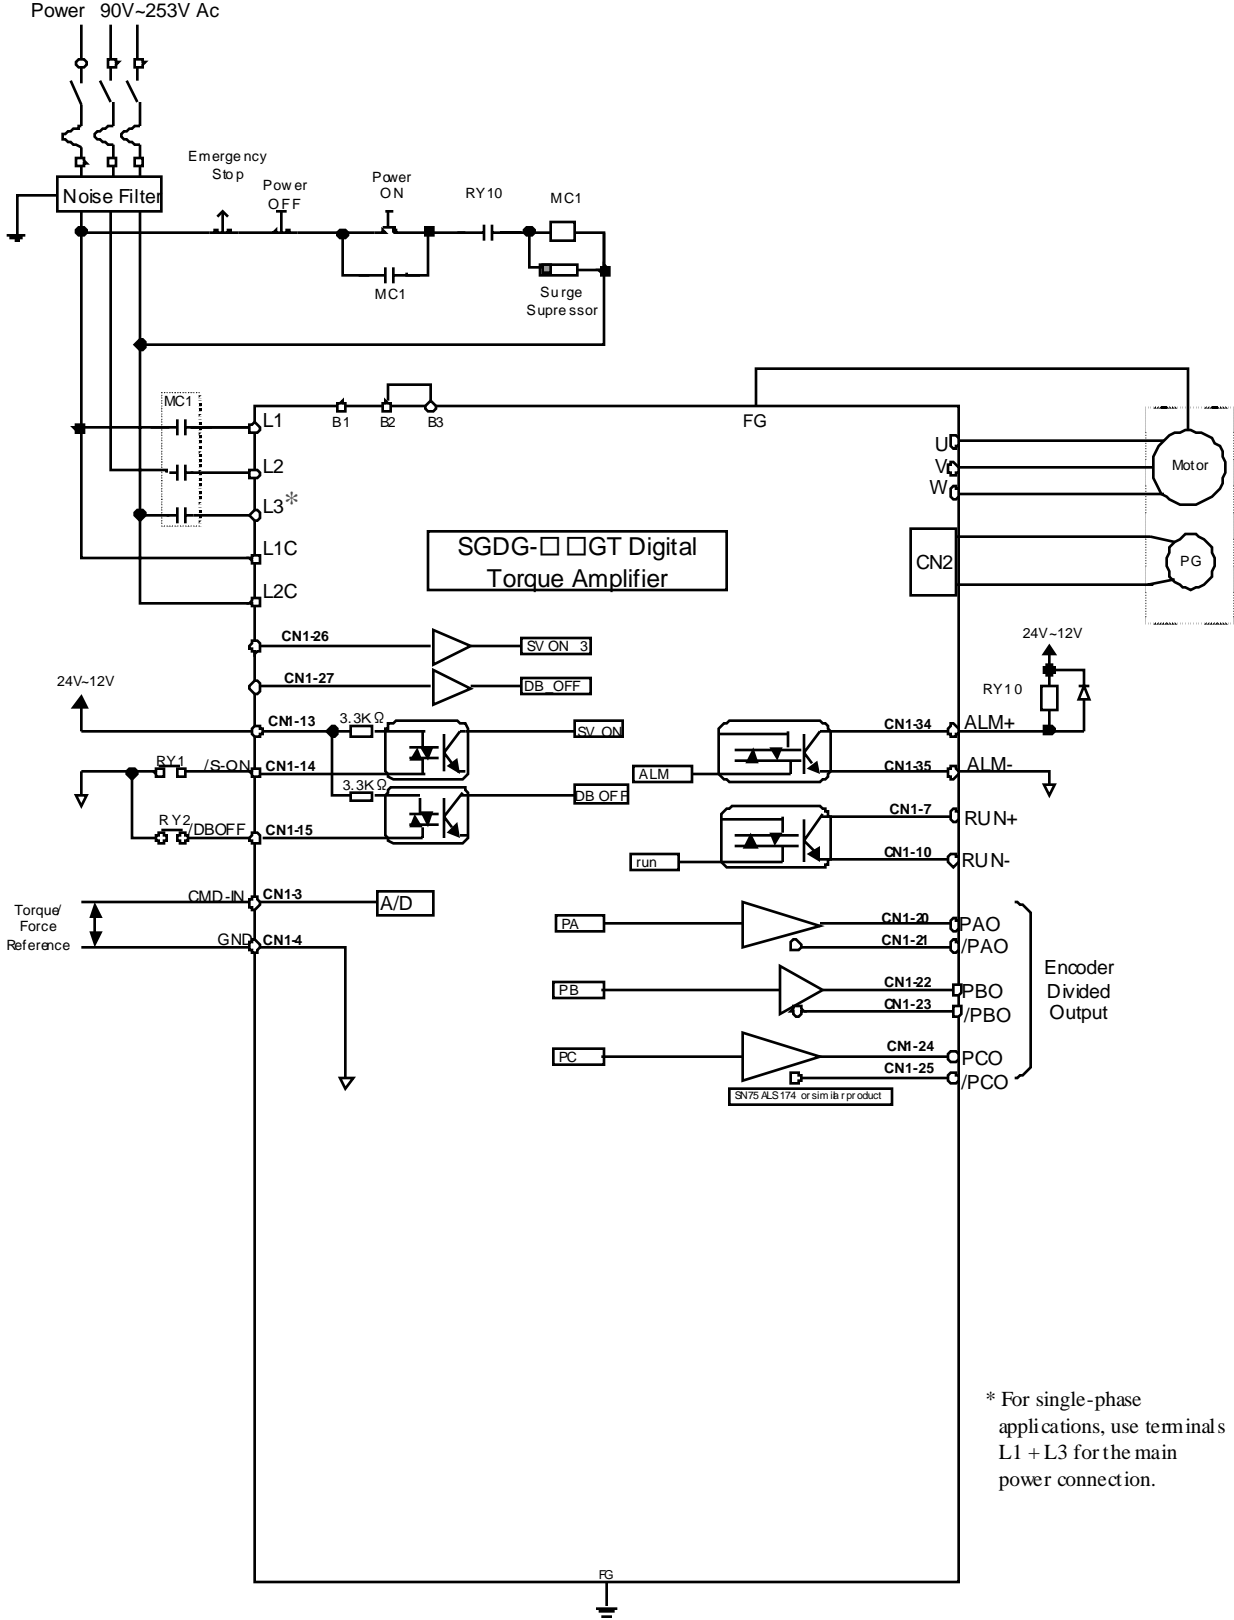

Notes:

3. Setup

3.1 Linear Motor Mounting

CAUTION

- In the case of linear motors, various changes can occur according to the direction of the motor mounting and the direction of the encoder mounting. Therefore, perform setup carefully.
Careless setup may result in injury.

■ Motor Mounting and Encoder Mounting

Mount so that the motor forward direction matches the encoder forward direction.

■ Setting the Linear Encoder Scale Pitch

Upon completing mounting and wiring, feed control power only, input (SW2) the correct linear scale pitch used by each application. Alarm 0 (SW setting error) is output at the initial power ON because the initial value is assumed to be "0". This ceases occurring if the correct value is set in SW2 and the power cycled.


3.2 Rotary Motor Mounting

The SGM□H servomotor can be mounted in both the horizontal or vertical direction. However, mistaking the mounting direction or mounting in an inappropriate location may shorten motor life or lead to unexpected accidents.

Correctly mount the motor according to the following cautionary items.

CAUTION

- Do not connect the servomotor directly to a commercial power source. This will damage the motor.
The servomotor will not run without a dedicated digital torque amplifier.

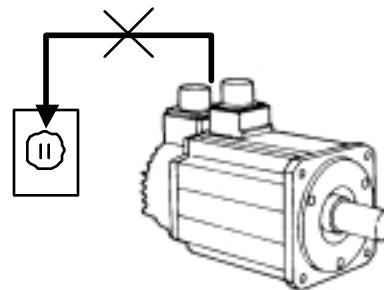




Before Mounting

The shaft end is treated with a rust-preventative agent. Before mounting the motor, wipe off this rust-preventative agent with a cloth soaked in thinner.

When removing the rust-preventative agent, be sure that the thinner does not contact any other parts of the servomotor.

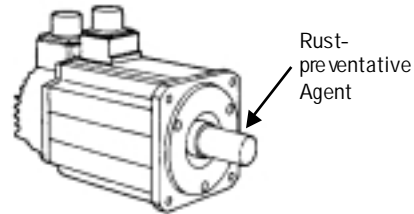

■ Storage Temperature

Store the servomotor within the temperature range below when storing without electrical feed.

-20 ~ +60°C Temperature Range


■ Mounting Location

The SGM□H servomotor is intended for use indoors. Use in an environment meeting the following conditions.

- Indoors, in a location free from corrosive or explosive gas.
- A location with good ventilation, with little dust, grime, or steam
- A location with an ambient temperature between 0~40°C
- A location with a relative humidity of 20%~80%, no condensation
- A location easy to inspect and clean

■ Alignment

Upon mating to the machine, make sure the motor shaft core and the machine shaft core are coupled in a straight line. Mount the servomotor so that it falls within the alignment accuracy in the figure below.

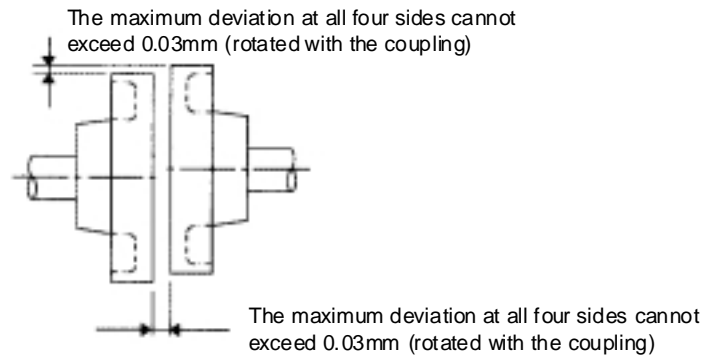

- (1) Improper alignment can lead to vibration, which risks damaging the shaft coupling.
- (2) When mounting the coupling, do not apply shock directly to the shaft. This may damage the encoder mounted on the shaft end opposite the load.

■ Mounting Direction

The SGM□H servomotor can be mounted in either the horizontal or vertical directions.

■ Shaft Tolerance Ranges

Design machine systems so that the thrust loads and radial loads¹ applied to the servomotor shaft during operation fall within the tolerances in Table 3.1.

The allowable radial loads shown in the table are the maximum loads that can be applied to the end of the output shaft.

1. Thrust Load, Radial Load:

Thrust Load (F_s): The shaft load applied parallel to the shaft core.

Radial Load (F_r): Shaft load applied at a right angle to the shaft core.

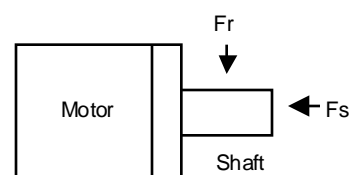




Table 3.4: Allowable MRadial Load/Allowable Thrust Load for Servo Motors

Motor Model		Allowable Serial Load Fr [N(kgf)]	Allowable Thrust Load Fs [N(kgf)]	LR [mm]	Reference Diagram
SGMAH-	A3	68(7)	54(5.5)	20	
	A5	68(7)	54(5.5)		
	01	78(8)	54(5.5)		
	02	245(25)	74(7.5)	25	
	04	245(25)	74(7.5)		
	08	392(40)	147(7.5)		
SGMPH-	01	78(8)	49(5)	20	
	02	245(25)	68(7)	25	
	04	245(25)	68(7)		
	08	392(40)	147(15)	35	
	15	490(50)	147(15)		
SGMGH-	05A □ A	490(50)	98(10)	58	
	09A □ A	490(50)	98(10)		
	13A □ A	686 (70)	343(35)		
SGMSH-	10A	686(70)	196(20))	45	
	15A	686(70)	196(20))		

■ Oil and Water Countermeasures

It is possible to take protective measures for motor operation in areas where water or oil may drip. However, use a motor with an oil seal attached when needed to set through to the shaft section¹.

In addition, mount the motor with the connectors facing downward.



■ Cable Stress

Do not bend or stretch the power line.

In particular, be careful to wire the signal cable so that they are not subject to stress because its core is very thin (0.2, 0.3mm).


1. Through Shaft Section

This refers to the gap where the shaft protrudes from the end of the motor.

■ Vibration Resistance


Mount the servomotor with the shaft positioned horizontally. The servomotor will withstand the following levels of vibration on all three axes: front-to-back (X), vertical (Y), and side-to-side (Z).

- SGMAH, SGMPH: 49m/s^2 (5G)
- SGMSH, SGMGH, SGMDH, and SGMUH: 24.5m/s^2 (2.5G)

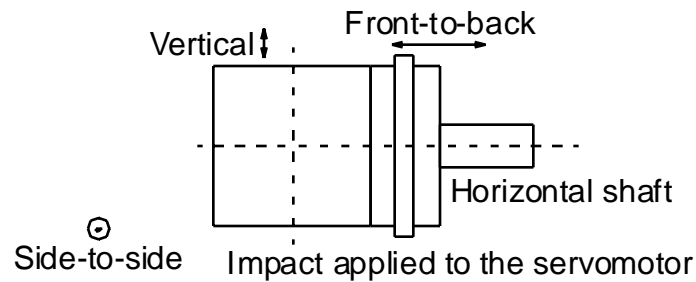

3.2.1 Vibration Class

The vibration class for SGM□H servomotors operating at rated speed is $15\mu\text{m}$ (maximum).

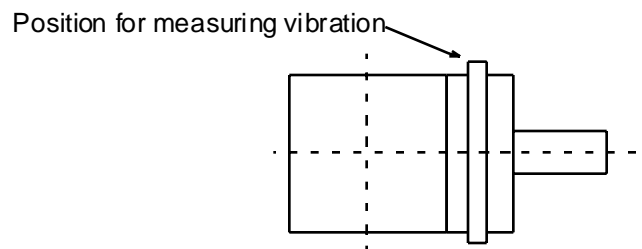


3.3 Digital Torque Amplifier Installation

The SGDGD digital torque amplifier is a base-mounted digital torque amplifier. Mount it properly according to the following cautionary items as mistakes in the mounting method can lead to failure of the unit.

■ Storage Conditions

Store the digital torque amplifier within the temperature range below when storing without electrical feed.

Temperature Range: -20~ +85°C

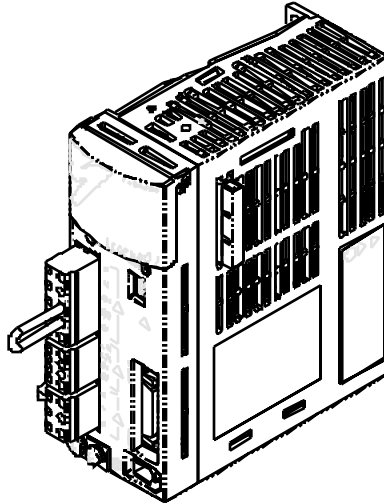

LEGEND SGDGD Digital Torque Amplifier

■ Mounting Conditions

Location

The following points should be kept in mind with regard to the mounting location.

Installation Conditions	Cautions on Mounting
Mounted in a Control Panel	Design the control panel size, digital torque amplifier installation, and cooling method so that the ambient temperature of the digital torque amplifier does not exceed 55°C.
Mounted Near a Heat-Generating Object	Suppress the temperature rise due to radiated heat and convection from the heat-generating object so that the ambient temperature of the digital torque amplifier does not exceed 55°C.
Mounted Near a Vibration Source	Attach vibration-preventative brackets to the digital torque amplifier mounting surface so that the vibrations are not communicated to the digital torque amplifier.
Mounted in a Location Exposed to Corrosive Gas	Take measures to prevent the influx of corrosive gas. The gas will have no immediate effect, but will lead to device failures in the electronic components and contact-related devices.

Installation Conditions	Cautions on Mounting
Others	Do not install in areas with high temperature or humidity, or where the atmosphere contains dust or iron particles.

Control Panel Environmental Conditions


- Digital Torque Amplifier Ambient Temperature: 0~55°C
- Humidity: 90% RH or less
- Vibration: 0.5G (4.9m/s²)
- Do not allow freezing or condensation to occur.
- Use an ambient temperature of 45°C or less to maintain long-term reliability.

Mounting Direction

Mount in a vertical direction on a wall as shown in the figure below.

Cool the digital torque amplifier either with natural convection or a fan. Be sure to maintain this direction.

Securely fix the digital torque amplifier to the mounting surface by using the mounting holes at 2~4 locations (the number of holes will differ depending on capacity).

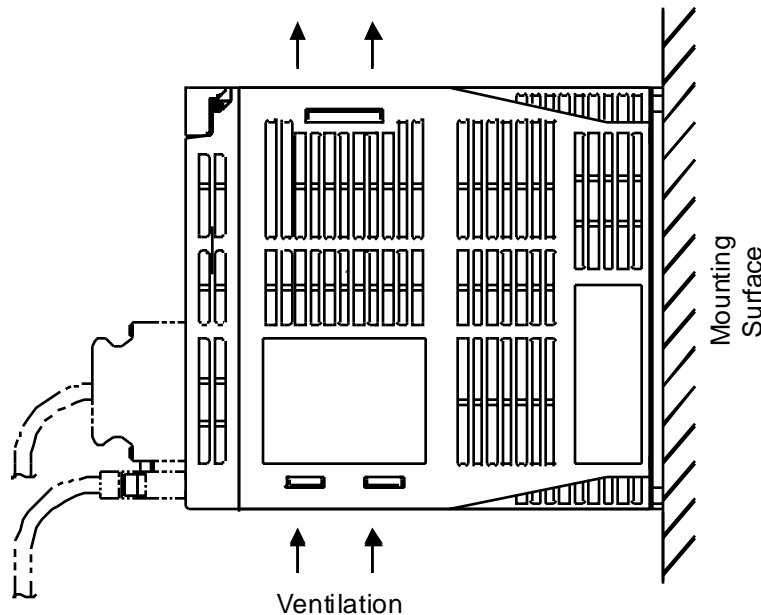


Cooling

Mount the amplifier with sufficient peripheral space around the digital torque amplifier consideration of the above figure so as to achieve sufficient cooling by either a fan or natural convection.

Digital Torque Amplifier Mounting Standards

Observe the standards for mounting into a control panel shown in the figure below, including those cases where multiple digital torque amplifiers are installed in parallel within a control panel (hereafter referred to as a “parallel platform”).

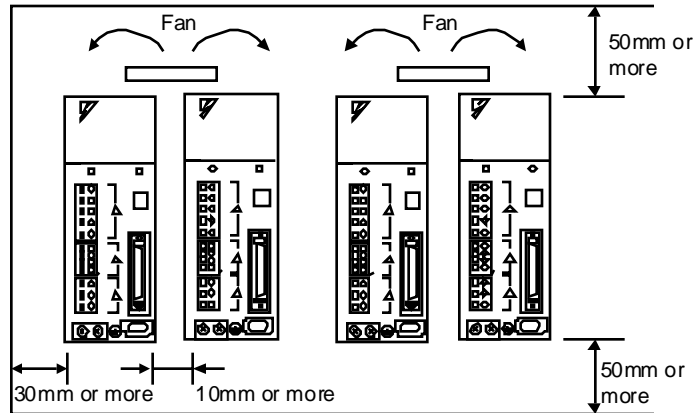

Mount the digital torque amplifier so that the front side faces the operator.

Side-by-side Installation

When installing digital torque amplifier side by side as shown in the figure above, allow at least 0.39in (10mm) between and at least 1.97in (50mm) above and below each digital torque amplifier. Install cooling fans above the digital torque amplifiers to avoid excessive temperature rise and to maintain even temperature inside the control panel.

3.4 Switch Settings

■ SW1 Function Selection Switch (dip switches)

Switch No.	Function	At OFF	At ON	Default Setting
1	Status After DB Stop During Base Block	Release DB after motor stop	Continue DB after motor stop	ON
2	Torque Reference Filter	No	Yes	ON
3	Input Power Selection	DC-Power Input Compatible	AC-Power Input Compatible	ON
4	Linear Scale Polarity Reversal	B-phase progression: U, V, W direction	A-phase progression: U, V, W direction	ON (enabled only when linear motor is used)
5	Regen Overload Alarm or Warning	No	Yes	ON
6	Feedback Pulse B-phase Reversal	Reversed	Not reversed	ON
7	Command Direction Reversal	Reversed	Not reversed	ON
8	Not used			ON

■ SW2 Linear Scale Pitch Setting (rotary switch)

Setting	Linear Scale Pitch Setting	Setting	Linear Scale Pitch Setting
0*	0 μ m	8	Not used
1	2 μ m	9	Not used
2	4 μ m	A	Not used
3	20 μ m	B	Not used
4	40 μ m	C	Not used
5	800 μ m	D	Not used
6	1000 μ m	E	Not used
7	Not used	F	Not used

* The default setting is 0 (0 μ m).

■ SW3 PG Divider Setting (rotary switch)

For a 13-bit Rotary Motor

Setting	PG Divider Setting**	Setting	PG Divider Setting**
0*	8192 P/R	8	3000 P/R
1	8000 P/R	9	2500 P/R
2	7200 P/R	A	2048 P/R
3	6000 P/R	B	2000 P/R
4	5000 P/R	C	1800 P/R
5	4096 P/R	D	1600 P/R
6	4000 P/R	E	1000 P/R
7	3600 P/R	F	Not used

* The default setting is 0 (2048×4).

** 4× at host controller

For a 17-bit Rotary Motor

Setting	PG Divider Setting**	Setting	PG Divider Setting**
0*	65,536 P/R	8	30000 P/R
1	64,000 P/R	9	24000 P/R
2	60,000 P/R	A	16000 P/R
3	50,000 P/R	B	131,072 P/R***
4	40,000 P/R	C	120,000 P/R***
5	36,000 P/R	D	100,000 P/R***
6	32,768 P/R	E	80,000 P/R***
7	32,000 P/R	F	Not used

* The default setting is 0 (16384×4).

** 4× at host controller

*** Overspeed alarm will activate at motor speeds of 2500rpm or higher.

For Linear Motors

Setting	PG Divider Setting	Setting	PG Divider Setting
0*	1/20	8	1/32
1	1/256	9	1/16
2	1/250	A	1/10
3	1/200	B	1/8
4	1/128	C	1/5
5	1/100	D	1/4
6	1/64	E	1/2
7	1/40	F	Not used

* The default setting is 0 (1/20).

3.5 Combinations

Digital Torque amplifier and motor combinations are shown below.

■ Combinations with Rotary Motors

SGMAH

Digital Torque Amplifier Model	Compatible Motor Models
SGDG-01GT	SGMAH-A3B SGMAH-A5B SGMAH-A3A SGMAH-A5A SGMAH-01A
SGDG-04GT	SGMAH-01B SGMAH-02B SGMAH-02A SGMAH-04A
SGDG-10GT	SGMAH-08A

SGMPH

Digital Torque Amplifier Model	Compatible Motor Models
SGDG-01GT	SGMPH-01A
SGDG-04GT	SGMPH-01B SGMPH-02B SGMPH-02A SGMPH-04A
SGDG-10GT	SGMPH-08A
SGDG-15GT	SGMPH-15A

SGMGH

Digital Torque Amplifier Model	Compatible Motor Models
SGDG-10GT	SGMGH-05 □ A SGMGH-09 □ A
SGDG-15GT	SGMGH-13 □ A

SGMSH

Digital Torque Amplifier Model	Compatible Motor Models
SGDG-10GT	SGMSH-10 □ A
SGDG-15GT	SGMSH-15 □ A

■ Linear Motor Combinations

Digital Torque Amplifier Model	Linear Motor Models
SGDG-04GT	SGLGW-40A140AP SGLGW-40A253AP SGLGW-40A365AP SGLGW-60A140AP SGLGW-60A253AP SGLGW-60A365AP SGLFW-20A090AP SGLFW-20A120AP SGLFW-35A120AP SGLTW-20A170AP
SGDG-10GT	SGLTW-20A320AP SGLTW-35A170AP SGLTW-35A320AP SGLFW-35A230AP SGLFW-50A200AP
SGDG-15GT	SGLFW-50A380AP SGLFW-1ZA200AP

■ Serial Conversion Unit and Applicable Motors


Serial Conversion Unit Model JZDP-A00 □ - □□□	Applicable Motors	Serial Conversion Unit Model JZDP-A00 □ - □□□	Applicable Motors
001	SGLGW-40A140A(P)	013	SGLTW-20A460A(P)
002	SGLGW-40A253A(P)	014	SGLTW-35A170A(P)
003	SGLGW-40A365A(P)	015	SGLTW-35A320A(P)
004	SGLGW-60A140A(P)	016	SGLTW-35A460A(P)
005	SGLGW-60A253A(P)	017	SGLFW-20A090A(P)
006	SGLGW-60A365A(P)	018	SGLFW-20A120A(P)
007	SGLTW-40A400A(P)	019	SGLFW-35A120A(P)
008	SGLTW-40A600A(P)	020	SGLFW-35A230A(P)
009	SGLTW-80A400A(P)	021	SGLFW-50A200A(P)
010	SGLTW-80A600A(P)	022	SGLFW-50A380A(P)
011	SGLTW-20A170A(P)	023	SGLFW-1ZA200A(P)
012	SGLTW-20A320A(P)	024	SGLFW-1ZA380A(P)

4. Description of Functions

4.1 Torque/Force Control

This is the torque/force control-dedicated mode.


This control mode inputs the torque/force reference from CMD-IN (CN1-3 & CN1-4).

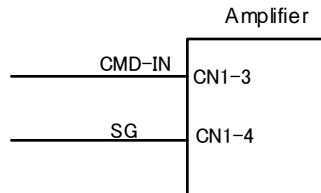

4.2 Protection Sequence Design

This section describes the methods for integrating a protective sequence for safety purposes using I/O signals from the digital torque amplifier.

Servo Alarm Output

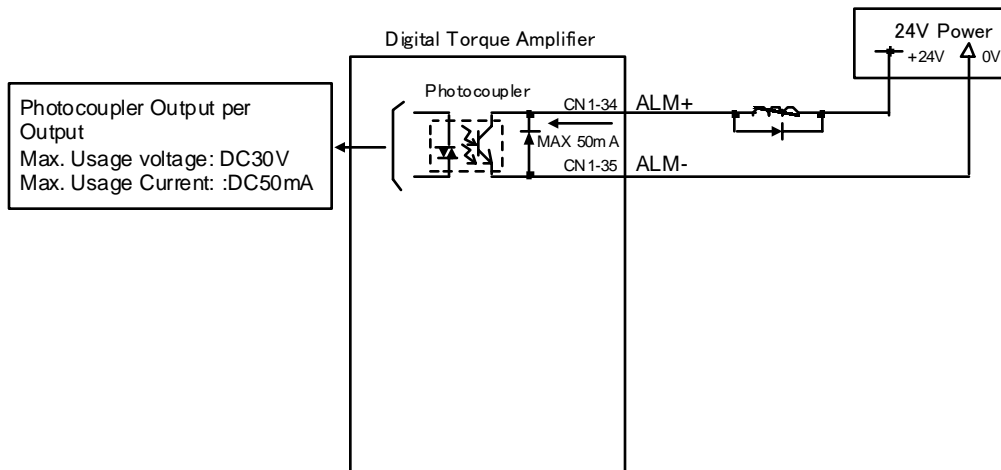

The basic method for continuing alarm-related “output signals” is shown below. Prepare an external 24V usage power source. No 24V power source is integrated in the digital torque amplifier.

The photocoupler output signal is handled as follows:

Output → ALM+ CN1-34	Servo Alarm Output
Output → ALM- CN1-35	Signal ground for servo alarm output


The output is “ON” when the digital torque amplifier detects an error.

Be sure to configure the external circuit so that the main power to the digital torque amplifier goes OFF at alarm output.

ON State	CN1-34, 35 is “closed”, CN1-34 is level “Low”	Normal State
OFF State	CN1-34, 35 is “open”, CN1-34 is level “High”	Alarm State

■ Servo ON Input

Serial Input Signal: The basic connection method and for Servo ON (/S-ON) is displayed below. This is used to forcibly stop the servomotor in a “non-powered” state.

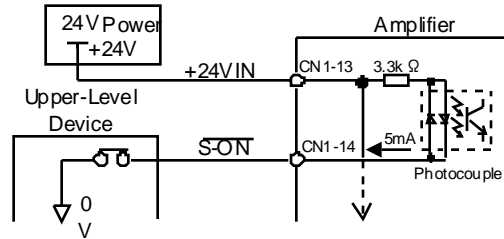

→ Input/S-ON CN1-14 Servo ON

Switches the motor between a powered and a non-powered state.


When ON CN1-14 is “L” level	Sends power to the motor. This is the normal RUN state. (this is called the 4state)	Servo ON Motor “Powered” State The motor runs according to the input signals
When OFF CN1-14 is “H” level	Sets the motor to a “non-powered” state. Operation is not possible (this is the <u>Servo OFF</u> state). Do not perform <u>Servo OFF</u> while the motor is running except during an emergency stop.	Servo OFF Motor Non-Powered State Operation is not possible



Do not start/stop the motor by using the (/S-ON) signal. Always start/stop the motor with an input command.

■ DB OFF Input

Sequence Input Signal: The basic connection and handling method for the (DB OFF) signal is shown below. This is used to forcibly release the “DB stop state” during Servo OFF from the upper-level device.

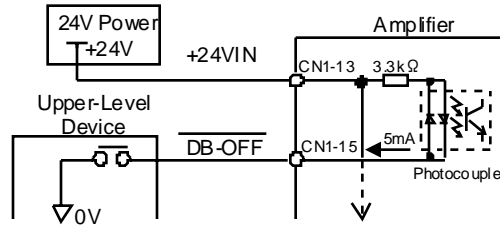


→ Input/S-ON CN1-15 DB OFF

Switches the motor between a powered and a non-powered state.

When ONCN1-15 is “L” level	DB stop at Servo OFF	DB ON	DB Stop State DB stop at Servo OFF
When OFFCN1-15 is “H” level	Releases the DB stop and goes to free run at Servo OFF	DB OFF	DB Stop Release Release DB stop according to an input signal

■ RUN Signal Output

Photocoupler Output Signal: The basic connection method and handling method for the “RUN” signal is shown below. The output signal displays the base block release.

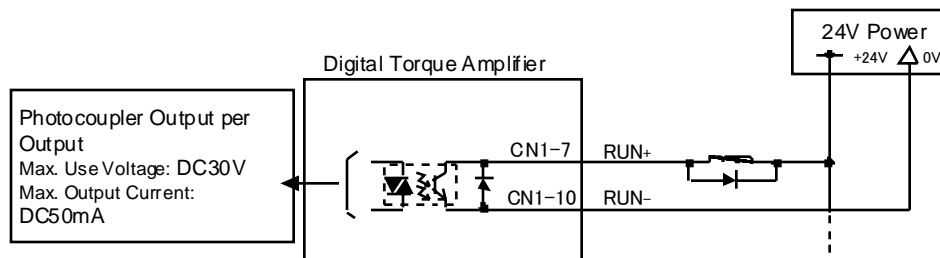


Output → / V-CMP CN1-7 RUN Signal Output


ON State	CN1-7, 10 is “closed” CN1-7 is level “L”	Base Block Released
OFF State	CN1-7, 10 is “open” CN1-7 is level “H”	Base Block State

4.3 Encoder Signal Output

The output signal following division within the digital torque amplifier of the encoder output¹ can be output to an external device.

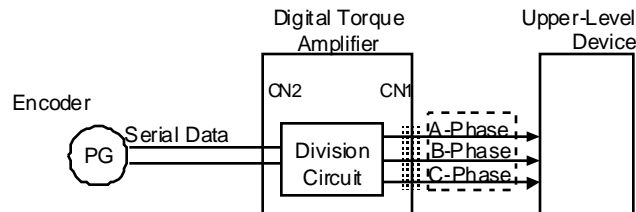

The output circuit is a line driver output. Connect in consideration of the following circuit.

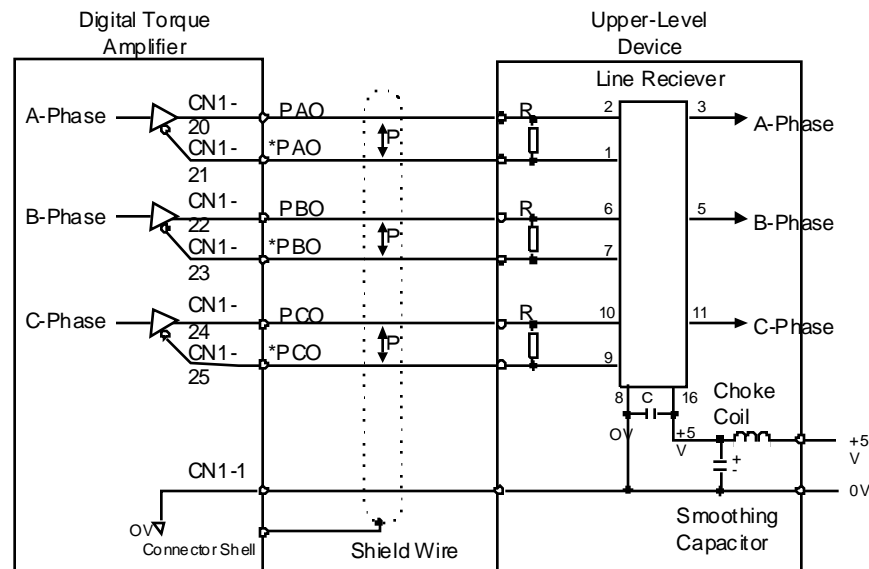

↕P: Shows a twist-pair wire.

Applied Line Receiver: TI SN75175 or MC3486-equivalent

R (Termination Resistance): 220–470 Ω

C (Decoupling Capacitor) : 0.1 μ F

1. After Division: This means the output converted to the set pulse ratio based on the pulse data from the encoder mounted on the motor. The unit here is “No. of Pulses/Rotation”.

■ I/O Signals

The details on the output signal are as follows:


Output → PAO CN1-20	Encoder Output A-phase
Output → *PAO CN1-21	Encoder Output /A-phase
Output → PBO CN1-22	Encoder Output B-phase
Output → *PBO CN1-23	Encoder Output /B-phase
Output → PCO CN1-24	Encoder Output C-phase
Output → *PCO CN1-25	Encoder Output /C-phase

The divided encoder signal is output.

The division ratio is set in the following switches.

Encoder Division Ratio Setting	SW3
--------------------------------	-----

■ Output Phase Form

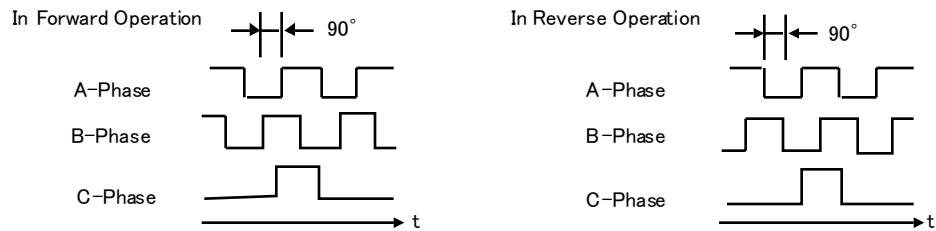

Output → SG CN1-2	Signal Ground
--------------------------	----------------------


Signal Ground: Connect to “0V” on the upper-level device.

■ PG Divider Setting

Set the pulse division ratio by the following switches.

SW3	PG Divider Setting	Unit P/R	Setting Range	Delivery Setting
			16,000~131,072 (Rotary 17-bit)	65,536
			1000~8192 (Rotary 13-bit)	8192
			1/256~1/2 (Linear Motor)	1/20

Set the number of output pulses output by the encoder output signals (PAO, *PAO, PBO, *PBO).

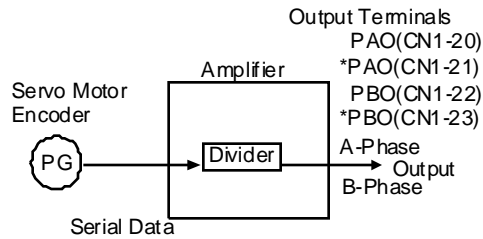

This divides the pulses from the motor encoder (PG) by the number of pulses set there, then outputs it.

The setting value is the number of output pulses per motor rotation. Set this to match the command unit of the machine controller.

The setting range differs according to the encoder used.

4.4 Analog Monitor

The following signals can be monitored in the analog voltage form.

1CN Pin No.	Signal Name	Content
28	Analog Monitor 1	Motor speed : 1V/1000r/min or 1V/1000mm/sec
29	Analog Monitor 2	Torque = 5V/Max. Torque

The analog monitor output voltage is 8VDC (Max.). The output voltage will invert if it exceeds 8VDC.

4.5 Regenerative Resistor Selection

When the servomotor is operated in electrical generator mode, the servo amplifier will absorb electrical power. This is called regenerative power. Although the regenerative power is absorbed by charging the smoothing capacitor of the digital torque amplifier, the regenerative power will be further consumed by the regen resistor if the chargeable energy limit of the capacitor is exceeded.

The servomotor is operated in the regen (electrical generator) mode in the following situations:

- Deceleration to stop time during acceleration/deceleration operation
- Vertical axis load
- Continuous operation where the servomotor continues rotating from the load side (overhauling load)

The capacity of the regenerative resistor integrated within the digital torque amplifier is designed for short-term operation only, such as the deceleration to stop period. Operation is not possible with an overhauling load.

Install an external regen resistor if the regen power exceeds the processing capability of the digital torque amplifier. The specifications of regen resistors integrated in digital torque amplifiers and the regen power they can process (average) are shown below.

Applied Digital Torque Amplifier	Integrated Regen Resistor Specifications		Regen Power Processed by Integrated Resistor (W)	Minimum Total Resistance (Ω)
	Resistance (Ω)	Capacity (W)		
SGDG-01GT/-04GT	—	—	—	40
SGDG-10GT	50	60	12	40
SGDG-15GT	30	70	14	20

* The regen capacity (average) which can be processed is a 20% rating of the regenerative resistor capacity integrated within the digital torque amplifier.

When installing an external regen resistor, make the resistance the same as that of the resistor integrated within the digital torque amplifier.

When using several resistors with small resistance combined in a group to increase the capacity (W) of the regen resistor, select resistors so that the value including the resistance error is equal to or greater than the “minimum allowable resistance” in the above table.

■ External Regen Resistors

Important


- (1) If the power resistor is used at the rated load rate, resistor temperatures will reach 200°C~300°C. Be sure to derate before using. Check with the manufacturer for the load characteristics of the resistor. Use at a load rating of 20% or less when using natural cooling (natural convection cooling), and at 50% or less when forced air cooling is used.
- (2) For safety reasons, we recommend the use of resistors with thermostatic switches.

■ Connecting the Regen Resistor

The connection method for the regen resistor is shown below.


■ For Digital Torque Amplifiers of 400W Capacity or Less

Connect the regen resistor between terminals B1-B2 on the digital torque amplifier.

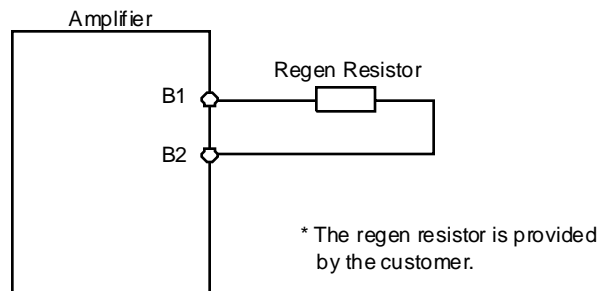

■ For Digital Torque Amplifiers of 500W Capacity or More

Open terminals B2-B3 on the digital torque amplifier (remove the wire), and connect the regen resistor between terminals B1-B2.

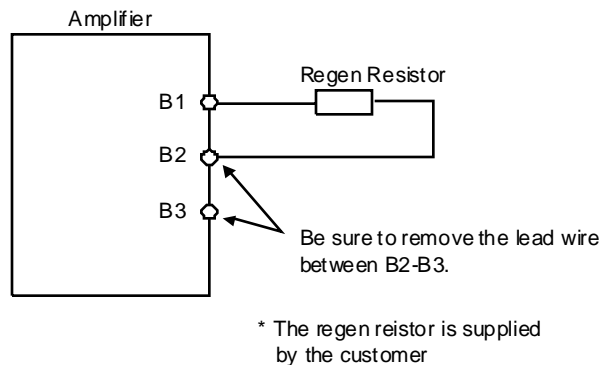

Important

The regen resistor reaches high temperatures. Use wires with high-temperature insulation, and make sure the wires do not come into contact with the regen resistor.

■ Calculating Regen Energy

For the procedure to calculate regen resistor capacity, please refer to Chapter 5 of the Sigma II Series Servo System User's Manual (Doc.# YEA-S800-32.2x).

5. Servo System Maintenance/ Inspection

5.1 Motor Inspection

The procedures for simple daily maintenance of the servomotor are shown in Table 5.1. Because AC servomotors are brushless, simple daily inspection is sufficient. The inspection periods in the table are standard scales. Determine the usage conditions and environment, and then decide an appropriate inspection period.



Do not disassemble the servomotor for maintenance/inspection. Contact your Yaskawa representative or sales office if the servomotor is to be disassembled.

Table 5.1: Servomotor Inspection

Inspection Item	Inspection Period	Inspection/Work Content	Notes
Check for vibration or noise	Daily	Inspect by touch or hearing.	The level should not be greater than normal.
External Inspection	According to soiling conditions	Clean with cloth or air.	—
Changing the oil seal	Once every 5,000 hours minimum	Remove from machine and replace.	Only for motors with oil seals.
Comprehensive Inspection	Every 20,000 hours or 5 years, minimum	Contact your Yaskawa service department.	The customer should not disassemble/clean the servomotor.

5.2 Digital Torque Amplifier Inspection

Digital torque amplifier inspection is summarized in the table below. Although there is no need for daily inspection, perform inspections at least once per year.

Table 5.2: Digital Torque Amplifier Inspection

Inspection Item	Inspection Period	Inspection Content	Measures Taken at Error
Unit, Board Cleaning	Once per year minimum	There should be no grime, dust, or oil on the unit.	Clean with air or cloth.
Loose Screws	Once per year minimum	There should be no looseness in the terminal block and connector mounting screws.	Tighten
Component Fault in Unit or Board	Once per year minimum	There should be no changes in coloration due to heat, damage, or wire breakage.	Consult Yaskawa.

■ Component Replacement Timeline

The components in the table below are subject to mechanical wear or degradation over time. Inspect these periodically for purposes of preventative maintenance.

Digital torque amplifiers overhauled by Yaskawa are shipped with their system switches returned to their factory default settings. Be sure to verify these switches before operating.

Table 5.3: Periodic Inspection of Components

Component Name	Standard Replacement Period	Replacement Method, Other
Cooling Fan	4 ~ 5 Years	Replace with a new item.
Smoothing Capacitor	7 ~ 8 Years	Replace with a new item. (determine by inspection)
Relays	—	Determine by inspection
Fuses	10 years	Replace with a new item.
Discharge Capacitor on Printed Circuit Board	5 years	Replace with a new board. (determine by inspection)

■ Use Conditions



- Ambient Temperature: Yearly average 30°C
- Load Ratio: 80% or less
- Operation Rate: 20 hours or less per day

5.3 Alarms








POWER ON: Green LED turns ON at control power ON.








CHARGE LED: Red LED turns ON at main circuit power ON.

■ 7-Segment LED

Normal Status	Base Block	
	Servo ON	

■ Alarm List

Alarm Display	Alarm Name	Content
	Switch Setting Error	SW2, SW3 are not set during linear motor combination
	Overcurrent	Overcurrent flowed to IGBT
	Regen Circuit Error	<ul style="list-style-type: none"> • Regen resistor disconnection • Regen transistor short
		The regen energy exceeds the capacity of the regen resistor*#.
	Overvoltage	The main circuit voltage exceeds 420V*.
	Overspeed	Detected when the motor speed exceeds the maximum speed*.
	Undervoltage	The main circuit voltage is below 70V*.
	Overload	Operation for several seconds or tens of seconds at a torque/force greatly in excess of the rating*#.
		Continuous operation above the rated torque/force*.

Alarm Display	Alarm Name	Content
	Encoder Communication Error	Communication error between encoder and digital torque amplifier.
		Communication between the encoder and digital torque amplifier failed three times in succession.
	Runaway Detection	Motor runaway*.
	Encoder Failure	Checksum error in EEPROM within encoder
		Error in the number of pulses in encoder rotation
		Error in EEPROM within encoder
		Error in communication data between encoder and digital torque amplifier.
	Main Circuit Power Error	DC input with AC input settings for main circuit power or AC input with DC input settings.
		Main circuit power was frequently tuned ON/OFF*.
	Combination Error	Improper combination of motor and digital torque amplifier capacities.
		Improper motor combination.
	Digital Torque Amplifier Fault	Failure of A/D converter used in command input
		Servo amplifier system error
	Linear Motor Scale Polarity Error	Polarity setting of the linear motor scale A, B-phases is reversed.

* Reset at S-ON signal ON.


LED will blink at warning before alarm.

Appendix A: Host Controller Connection Examples

This appendix provides examples of SGD G digital torque amplifier connection to typical host controllers. Please refer to the manuals of the host controllers for more details before actually connecting to them.

A.1 Connecting the Galil IMC-1900/2900

Legend - Galil, Minimum Servo Interface

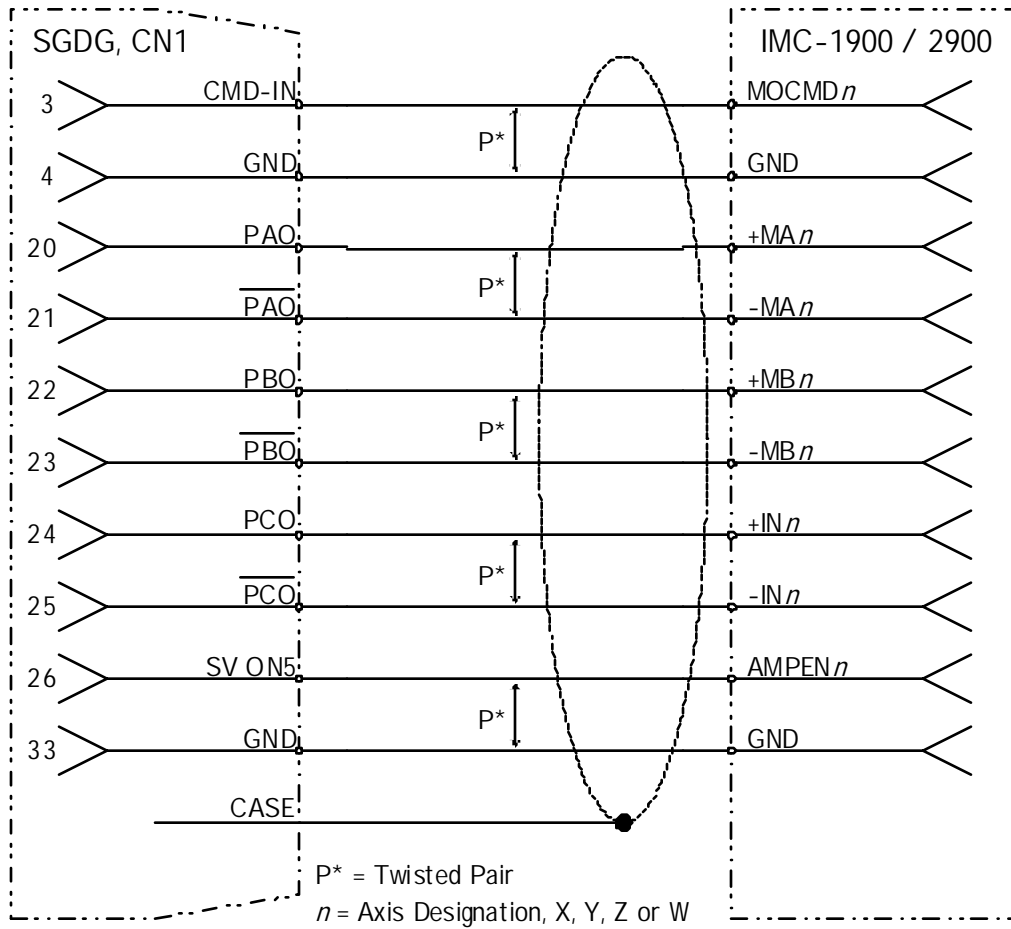


Caution:

Galil motion controllers allow to reverse the loop and encoder polarity with the MT and CE commands. Check applicable Galil product manuals for the appropriate procedure on proper loop and encoder phasing. ***Incorrect phasing may cause the motor to "run away!"***

A.2 Connecting the Delta Tau PMAC2

Legend - Delta Tau PMAC2, Minimum Servo Interface

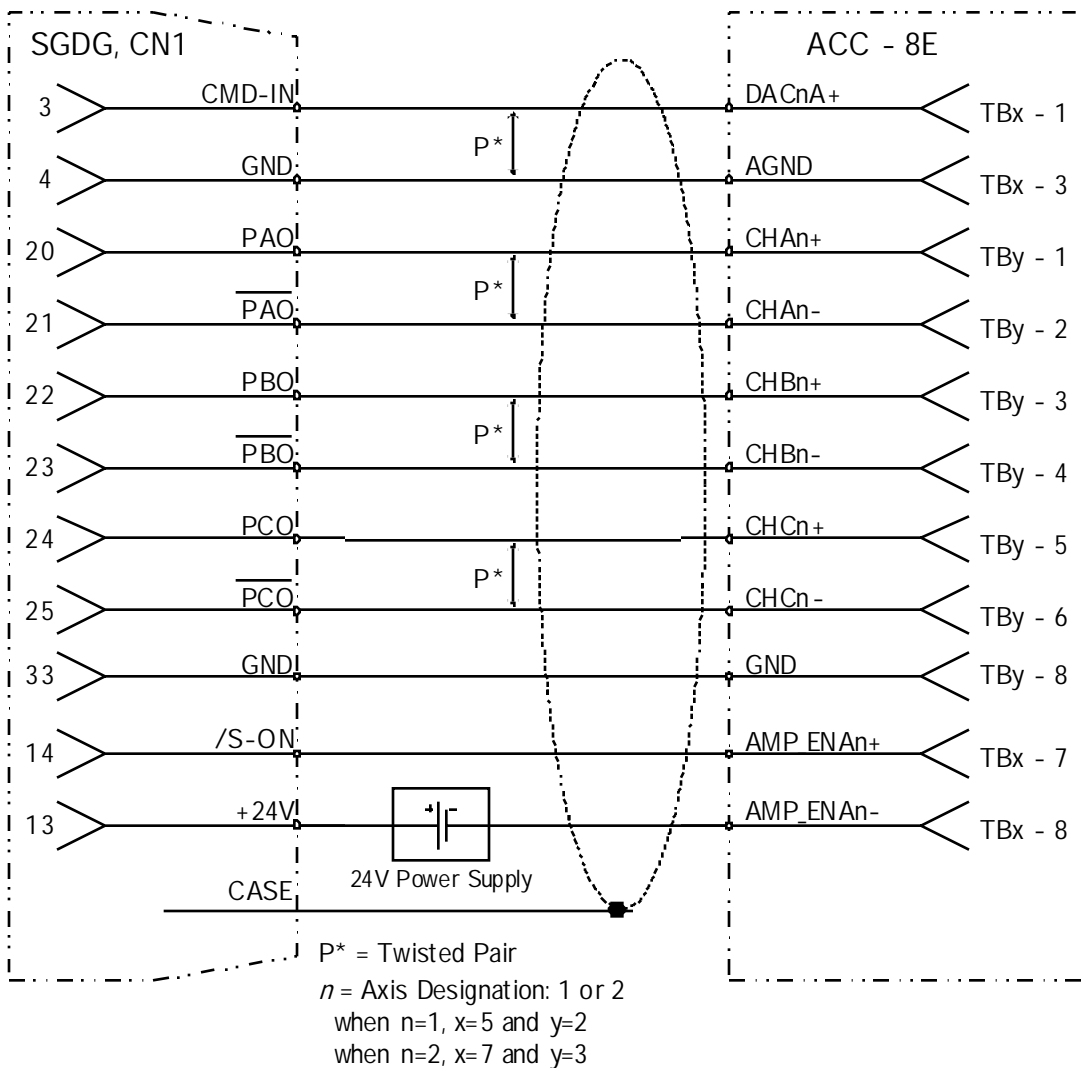


Note:

Jumper pin 1 to 2 on E1 to power ACC-8E digital 5V circuitry from PMAC2 through flat cable on JMACH port.

Jumper pin 1 to 2 on E4 (axis n=1) and on E7 (axis n=2) for normally open relay contact between AMP_ENAn+ and AMP_ENAn-.

A.3 Connection the MEI PCX/DSP


Legend - MEI PCX/DSP, Minimum Servo Interface

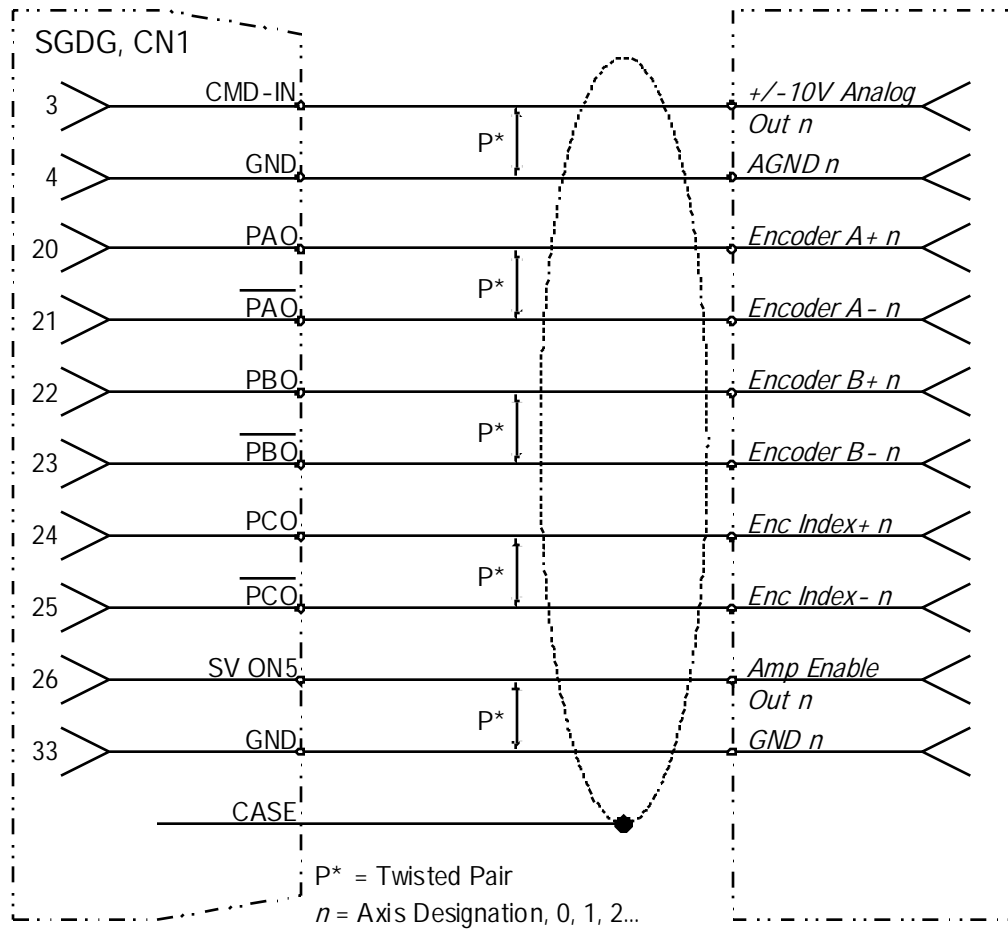

Signals may be from different connectors on MEI controller
 Consult *MEI DSP Series Motion Controller Installation Guide* for details.

A.4 Connection the Acroloop ACR-8010

Legend - Acroloop (ACR-8010), Minimum Servo Interface

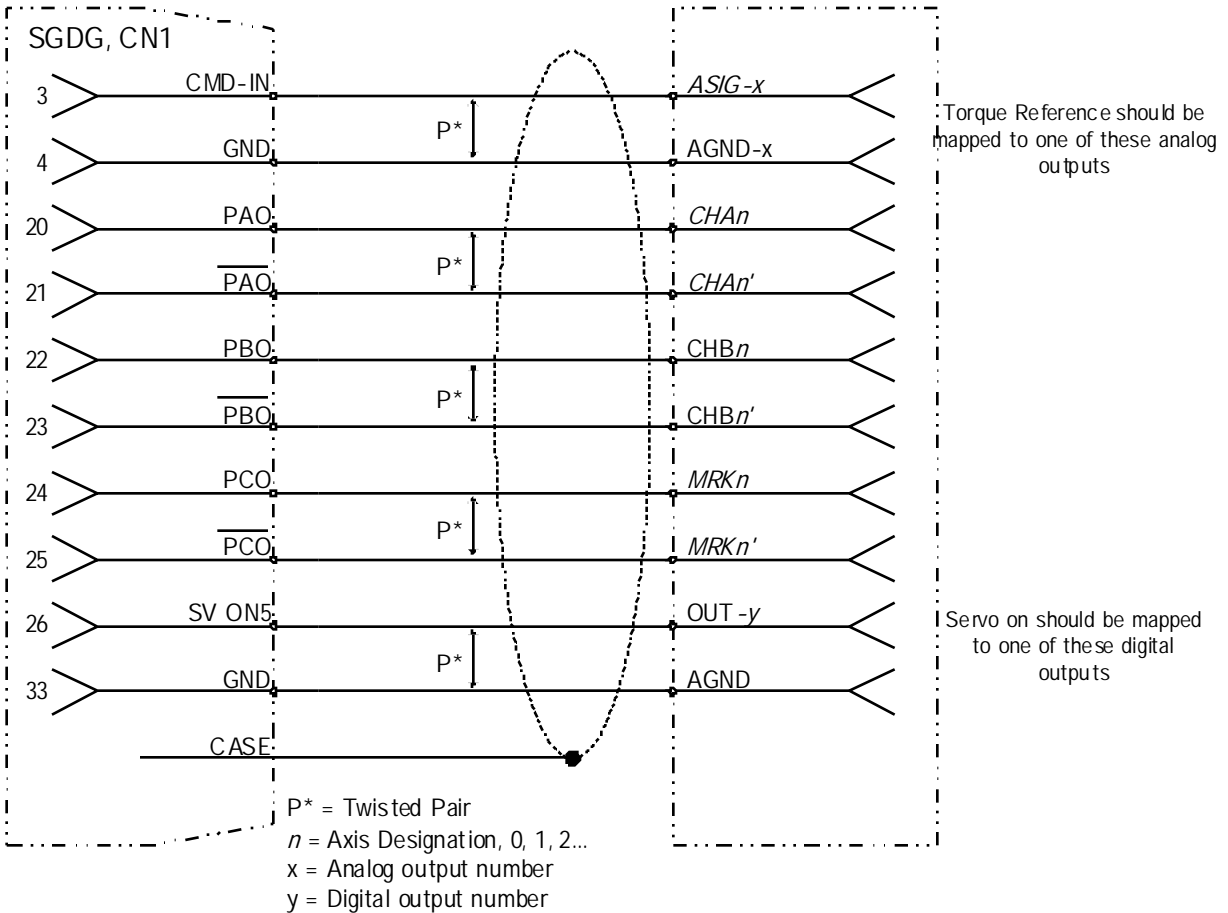

Encoder type is Differential Line Driver (+5 Volt Outputs) so Pullups should be removed
 Encoders 0-3 are on P1A connector
 Encoders 4-7 are on P1B connector
 ASIG-0 and AGND-0 through ASIG-7 and GND-7 are on P2 connector
 AGND is on P2 connector
 OUT-32 through OUT-63 are on P3 connector

Appendix B: Installation Conditions for EMC Directives


The following conditions must be satisfied to adapt a combination SGM□H servomotor and an SGDГ digital torque amplifier to EMC directives (EN55011-2, and EN61000-6-2).

■ EMC Installation Conditions


This section describes the installation conditions that satisfy EMC guidelines for each model of the SGDГ digital torque amplifier. The conditions required for standard type (base mounted) digital torque amplifiers are described.

This section describes the EMC installation conditions satisfied under test conditions prepared by Yaskawa. The actual EMC level may differ depending on actual system configuration, wiring, and other conditions.

SGDG-01GT
SGDG-04GT

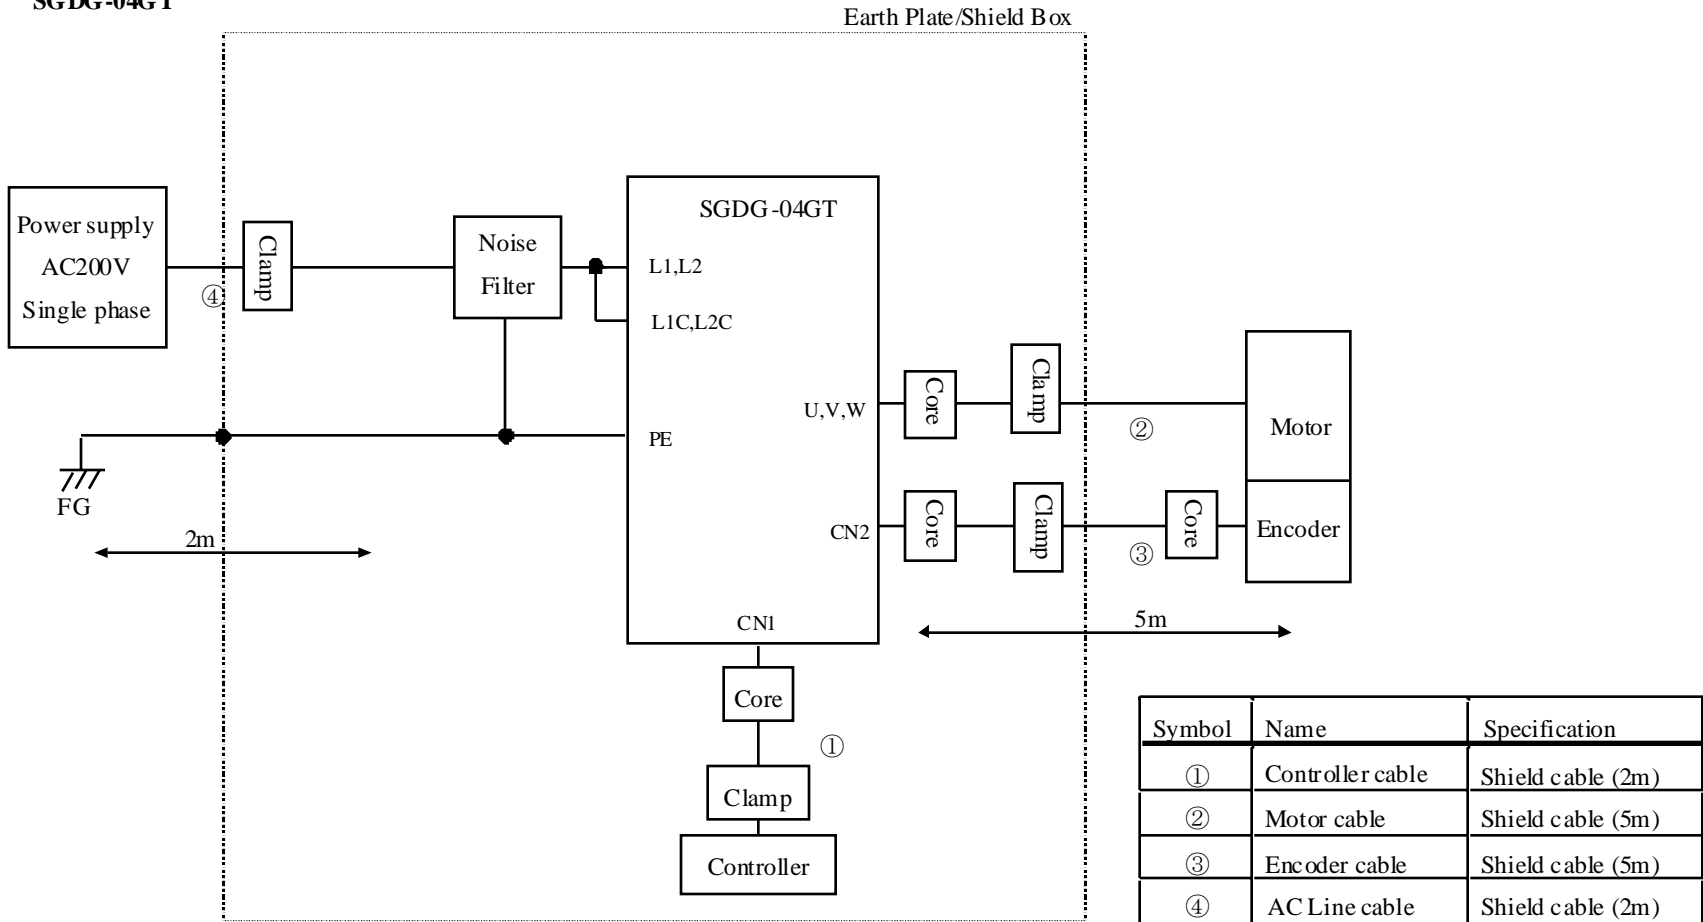

Clamps : Fix and ground the cable shield using a piece of conductive metal.

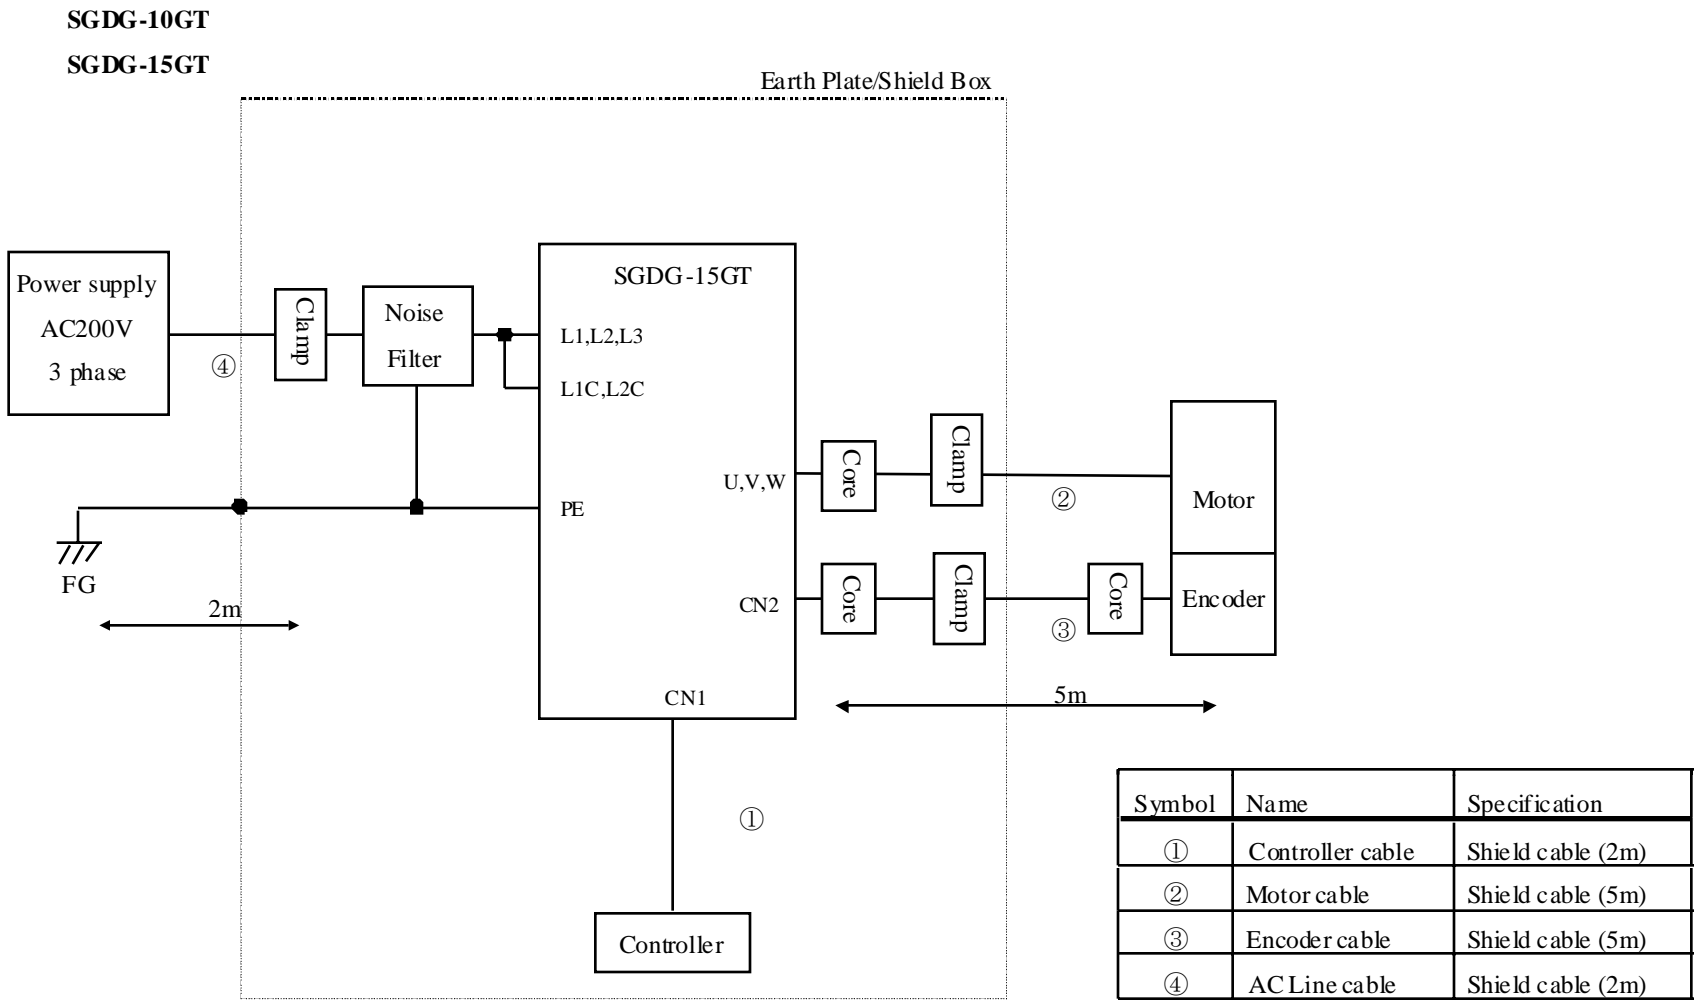


Clamps : Fix and ground the cable shield using a piece of conductive metal.

■ Cable Core and Cable Clamp

■ The Cable Core

Attach the core on the cable as shown below:

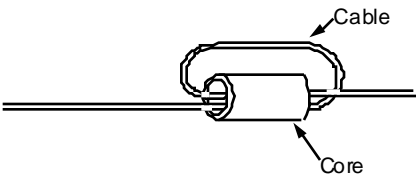Cable Model	ESD-SR-25	Note: The diagram shows two turns of the cable 
Quantity	1	
Turn	2	
Manufacturer	Token Corp.	



The table below shows the cable and position where the core is attached.

Cable Name	Mounting Position of the Core
Controller Cable	Near the controller and digital torque amplifier.
Servomotor Cable	Near the digital torque amplifier and the servomotor.
Encoder Cable	Near the digital torque amplifier and the servomotor.

■ Cable Clamp

The table below shows the cable shield using a piece of conductive metal.

<Example of Cable Clamp>

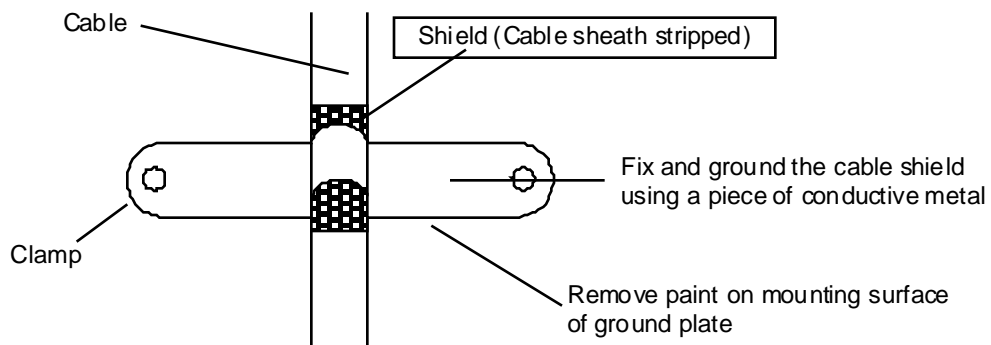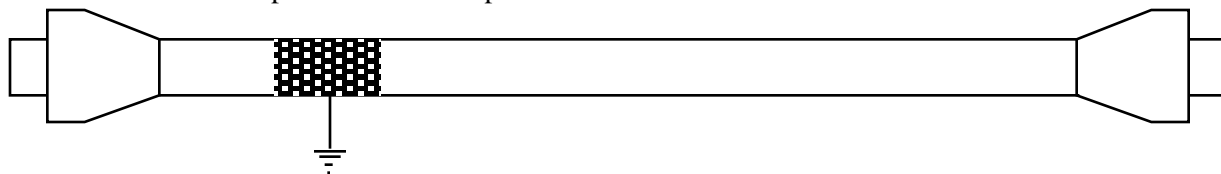

■ Noise Filter for Brake Power Supply

FN2070-6/07 (Made by Schaffner) for servomotors of 0.4kW or less.

■ Cable Specifications

Shielded cables should be used for the following cables:

- AC power input line cable (between the power supply and the noise filter)
- Servo motor cable (between the digital torque amplifier and the servomotor)
- Encoder cable (between the digital torque amplifier and the servomotor)
- Controller cable (between the digital torque amplifier and the controller)

■ Recommended Ferrite Cores

Cable Name		Ferrite Cores	Manufacturer
Controller Cable		ESD-SR-25	Tokin
Encoder Cable			
Servo Motor Cable	400W or lower	ESD-SR-25	Tokin
	1kW or higher	PC40T90×13.5×74	TDK

■ Shielded Box

A shielded box, a closed metallic enclosure, should be used for shielding electromagnetic interference. The structure of the box should allow the main body, door, cooling unit, etc., to be attached to the ground. The box opening should be as small as possible.

Notes:

Index

- A**
 - Acroloop ACR-801056
 - Alarms
 - 7-Segment LED51
 - Analog Monitor47
- B**
 - Brake Power
 - Noise Filter61
- C**
 - Cable61
 - Ferrite Cores61
 - Cable Clamp60
 - Cable Core
 - Attachment60
 - Cables
 - Specifications24
 - Capacity
 - SGDG-04GT5
 - SGDG-10GT5
 - SGDG-15GT5
 - Combination
 - Linear Motor40
 - Serial Conversion Unit40
 - SGMSH40
 - Combination Error52
 - Combinations
 - SGMAH39
 - SGMGH39
 - SGMPH39
 - Connection
 - Examples
 - 3-Phase Power27
 - Single Phase26
 - Connector
 - Encoder
 - Terminal Array23
 - Specification17
 - Terminal Array17
 - Control Panel
 - Environment35
 - Cooling Fan
 - Replacement50
 - Core-less Type
 - Magnet Track2
 - D**
 - Delta Tau PMAC254
 - Digital Torque Amplifier
 - Amplifier Fault52
 - Component Replacement50
 - Cooling35
 - Inspection50
 - Cleaning50
 - Component Fault50
 - Screws50
 - Installation34
 - Model Number5
 - Mounting Direction35
 - Mounting Location34
 - Mounting Standards36
 - Power Loss13
 - Storage34
 - Use Conditions50
 - Discharge Capacitor
 - Replacement50
 - E**
 - EMC Directives57
 - SGDG-01GT, 04GT58
 - SGDG-10GT, 15GT59
 - Encoder Communication Error52
 - Encoder Failure52
 - Encoder Signal
 - Output44
 - Encoder Signals
 - I/O Signals45
 - Output Phase Form45
 - PG Divider46
 - F**
 - F-Type Iron Core
 - Magnet Track4
 - Fuses
 - Replacement50
 - G**
 - Galil IMC-1900/290053
 - I**
 - Input Circuits
 - Command20
 - Sequence20
 - Input Signals
 - Connection16
 - DB OFF43
 - Functions18
 - Names18
 - Servo ON42
 - L**
 - Linear Motor Model
 - F-Type Iron Core4
 - Magnet Track2
 - T-Type Iron Core3
 - Linear Motors
 - Encoder
 - Scale Pitch29
 - Mounting29
 - Encoder29
 - Motor29
 - Liner Motor Model
 - Core-less Type2
 - M**
 - Main Circuit
 - Functions9
 - Terminal Names9
 - Main Circuit Power Error .52
 - MEI PCX/DSP55
 - Model
 - Serial Converter Unit6
 - Model Number1
 - Linear Motor2
 - Rotary Motor1

O			
Oil Seals	32	Shaft Tolerance	31
Output Circuits	21	Vibration Class	33
Output Signals		Vibration Resistance	33
RUN	43	SGMAH	33
Overcurrent	51	SGMDH	33
Overload	51	SGMGH	33
Overspeed	51	SGMPH	33
Overvoltage	51	SGMSH	33
		SGMUH	33
P		Runaway	52
Peripherals	24	S	
Power Line		Scale Polarity Error	52
Size	13	Serial Converter	
Stripping	14	Applied Motor	7
Terminal Processing	14	JZDP-A003	6
Power ON Sequence	13	JZDP-A004	6
Protection Sequence		JZDP-A005	6
Design	41	JZDP-A006	6
		JZDP-A008	6
R		Servo Alarm	
Regen Circuit Error	51	Output	41
Regenerative Resistor		Servomotor	
Selection	47	Inspection	49
Regenerative Resistor Selection	47	Comprehensive	49
Regenerative Resistors		External	49
-500W Capacity Amps	48	Noise	49
500W+ Capacity Amps	48	Oil Seal	49
Connecting	48	Vibration	49
Energy Calculation	48	Maximum Capacity	5
External	48	Vibration Resistance and Class	33
Relays		SGDG-01GT	5
Replacement	50	SGLTW -35A	3
Rotary Motor		SGLTW -80A	3
Mounting	29	SGLTW-20A	3
Rotary Motors		SGLTW-40A	3
Alignment	31	Smoothing Capacitor	
Mounting		Replacement	50
Direction	31	Specifications	61
Location	30	Storage Temperature	30
		Switch Setting	
		Function Selection	37
		Linear Scale Pitch	37
		PG Divider	
		13-bit Rotary	38
		17-bit Rotary	38
		Linear Motor	38
		PG Divider Setting	38
		Switch Setting Error	51
		Switch Settings	37
		T	
		T-Type Iron Core	
		Magnet Track	3
		Terminal Block	
		Connection	14
		Torque Control	
		Description	41
		U	
		Undervoltage	51
		W	
		Wiring	9
		Encoder	22
		Main Circuit	9
		Example	12
		Terminal Block	13



YASKAWA ELECTRIC AMERICA, INC.

Chicago-Corporate Headquarters 2121 Norman Drive South, Waukegan, IL 60085, U.S.A.
Phone: (847) 887-7000 Fax: (847) 887-7310 Internet: <http://www.yaskawa.com>

MOTOMAN INC.

805 Liberty Lane, West Carrollton, OH 45449, U.S.A.
Phone: (937) 847-6200 Fax: (937) 847-6277 Internet: <http://www.motoman.com>

YASKAWA ELECTRIC CORPORATION

New Pier Takeshiba South Tower, 1-16-1, Kaigan, Minatoku, Tokyo, 105-0022, Japan
Phone: 81-3-5402-4511 Fax: 81-3-5402-4580 Internet: <http://www.yaskawa.co.jp>

YASKAWA ELETRICO DO BRASIL COMERCIO LTDA.

Avenida Fagundes Filho, 620 Bairro Saude Sao Paulo-SP, Brasil CEP: 04304-000
Phone: 55-11-5071-2552 Fax: 55-11-5581-8795 Internet: <http://www.yaskawa.com.br>

YASKAWA ELECTRIC EUROPE GmbH

Am Kronberger Hang 2, 65824 Schwalbach, Germany
Phone: 49-6196-569-300 Fax: 49-6196-888-301 Internet: <http://www.yaskawa.de>

MOTOMAN ROBOTICS AB

Box 504 S38525, Torsås, Sweden
Phone: 46-486-48800 Fax: 46-486-41410 Internet: <http://www.motoman.se>

MOTOMAN ROBOTEC GmbH

Kammerfeldstraße 1, 85391 Allershausen, Germany
Phone: 49-8166-900 Fax: 49-8166-9039 Internet: <http://www.motoman.de>

YASKAWA ELECTRIC UK LTD.

1 Hunt Hill Orchardton Woods Cumbernauld, G68 9LF, Scotland, United Kingdom
Phone: 44-12-3673-5000 Fax: 44-12-3645-8182 Internet: <http://www.yaskawa.co.uk>

YASKAWA ELECTRIC KOREA CORPORATION

Paik Nam Bldg. 901 188-3, 1-Ga Euljiro, Joong-Gu, Seoul, Korea
Phone: 82-2-776-7844 Fax: 82-2-753-2639

YASKAWA ELECTRIC (SINGAPORE) PTE. LTD.

Head Office: 151 Lorong Chuan, #04-01, New Tech Park Singapore 556741, SINGAPORE
Phone: 65-282-3003 Fax: 65-289-3003

TAIPEI OFFICE (AND YATEC ENGINEERING CORPORATION)

10F 146 Sung Chiang Road, Taipei, Taiwan
Phone: 886-2-2563-0010 Fax: 886-2-2567-4677

YASKAWA JASON (HK) COMPANY LIMITED

Rm. 2909-10, Hong Kong Plaza, 186-191 Connaught Road West, Hong Kong
Phone: 852-2803-2385 Fax: 852-2547-5773

BEIJING OFFICE

Room No. 301 Office Building of Beijing International Club,
21 Jianguomenwai Avenue, Beijing 100020, China
Phone: 86-10-6532-1850 Fax: 86-10-6532-1851

SHANGHAI OFFICE

27 Hui He Road Shanghai 200437 China
Phone: 86-21-6553-6600 Fax: 86-21-6531-4242

SHANGHAI YASKAWA-TONJI M & E CO., LTD.

27 Hui He Road Shanghai 200437 China
Phone: 86-21-6533-2828 Fax: 86-21-6553-6677 Internet: <http://www.yaskawa-tonji.com>

BEIJING YASKAWA BEIKE AUTOMATION ENGINEERING CO., LTD.

30 Xue Yuan Road, Haidian, Beijing 100083 China
Phone: 86-10-6232-9943 Fax: 86-10-6234-5002

SHOUGANG MOTOMAN ROBOT CO., LTD.

7, Yongchang-North Street, Beijing Economic & Technological Development Area,
Beijing 100076 China
Phone: 86-10-6788-0551 Fax: 86-10-6788-2878

YEA, TAICHUNG OFFICE IN TAIWAN

B1, 6F, No.51, Section 2, Kung-Yi Road, Taichung City, Taiwan, R.O.C.
Phone: 886-4-2320-2227 Fax: 886-4-2320-2239