

# Twido Programmable Controllers

Modular and Compact Bases  
Hardware Guide

06/2011

---

The information provided in this documentation contains general descriptions and/or technical characteristics of the performance of the products contained herein. This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications. It is the duty of any such user or integrator to perform the appropriate and complete risk analysis, evaluation and testing of the products with respect to the relevant specific application or use thereof. Neither Schneider Electric nor any of its affiliates or subsidiaries shall be responsible or liable for misuse of the information contained herein. If you have any suggestions for improvements or amendments or have found errors in this publication, please notify us.

No part of this document may be reproduced in any form or by any means, electronic or mechanical, including photocopying, without express written permission of Schneider Electric.

All pertinent state, regional, and local safety regulations must be observed when installing and using this product. For reasons of safety and to help ensure compliance with documented system data, only the manufacturer should perform repairs to components.

When devices are used for applications with technical safety requirements, the relevant instructions must be followed.


Failure to use Schneider Electric software or approved software with our hardware products may result in injury, harm, or improper operating results.

Failure to observe this information can result in injury or equipment damage.

© 2011 Schneider Electric. All rights reserved.

---

# Table of Contents



	<b>Safety Information</b> .....	<b>7</b>
	<b>About the Book</b> .....	<b>9</b>
<b>Part I</b>	<b>Twido Hardware Guide - Compact &amp; Modular Bases</b>	<b>11</b>
<b>Chapter 1</b>	<b>Twido Overview</b> .....	<b>13</b>
	About Twido .....	14
	Maximum Hardware Configuration for Compact Bases .....	18
	Maximum Hardware Configuration for Modular Bases .....	21
	Main Features of the Controllers .....	23
	Communications Overview .....	26
<b>Chapter 2</b>	<b>Installation</b> .....	<b>33</b>
2.1	Installation Overall Instructions .....	34
	Installation Requirements .....	35
	Installation Preparation .....	39
	Compact and Modular Bases Mounting Positions .....	40
	Assembling an Expansion I/O Module to a Base .....	42
	Disassembling an Expansion I/O Module from a Base .....	44
	Minimum Clearances for Bases and Expansion I/O Modules in a Control Panel .....	46
2.2	Compact Bases Installation .....	48
	Dimensions of the Compact Bases .....	49
	How to Direct Mount a Compact Base on a Panel Surface .....	51
	How to Install and Remove a Compact Base from a DIN Rail .....	52
	How to Install the Operator Display Module .....	54
	How to Install a Serial Interface Adapter to a Compact Base .....	56
	How to Install a Memory or RTC Cartridge in a Compact base .....	57
	How to Connect the Power Supply to Compact Bases .....	58
	How to Install and Replace an External Battery .....	60
2.3	Modular Bases Installation .....	63
	Dimensions for the Modular Controllers .....	64
	How to Direct Mount a Modular Base on a Panel Surface .....	66
	How to Install and Remove a Modular Base from a DIN Rail .....	67
	How to Install the Operator Display Expansion Module .....	69
	How to Install a Serial Interface Adapter to Modular Bases .....	70

---

	How to Install a Second Serial Interface Expansion Module to a Modular Base . . . . .	71
	Removing a Terminal Block . . . . .	74
	How to Install a Memory or RTC Cartridge in a Modular Base . . . . .	75
	How to Connect the Power Supply to Modular Bases . . . . .	76
<b>Chapter 3</b>	<b>Description of Compact Bases . . . . .</b>	<b>79</b>
3.1	Compact Bases Description . . . . .	80
	Overview of Compact Bases . . . . .	81
	Parts Description of a Compact Base . . . . .	85
3.2	Specifications for Compact Bases . . . . .	87
	General Specifications for the Compact Bases . . . . .	88
	Electrical Specifications for the Compact Bases . . . . .	90
	Input Specifications for the Compact Base . . . . .	93
	Relay Output Specifications for the Compact Base . . . . .	95
	Output Transistor Specifications for the Compact Base . . . . .	97
	Description of Analog Potentiometers . . . . .	99
	Functional Specifications for the Compact Bases . . . . .	100
3.3	Wiring Rules and Recommendations, and Wiring Schematics for Compact Bases . . . . .	102
	Wiring Rules and Recommendations for Compact Bases . . . . .	103
	Compact Base Wiring diagrams . . . . .	107
3.4	Compact Bases Options . . . . .	112
	Memory Cartridges . . . . .	113
	Real Time Clock (RTC) Cartridge . . . . .	114
	Operator Display Modules . . . . .	115
	Input Simulators . . . . .	117
<b>Chapter 4</b>	<b>Description of Modular Bases . . . . .</b>	<b>119</b>
4.1	Modular Bases Description . . . . .	120
	Overview of Modular Controllers . . . . .	121
	Parts Description of a Modular Base . . . . .	123
4.2	Modular Bases Specifications . . . . .	124
	General Specifications for the Modular Bases . . . . .	125
	Electrical Specifications for the Modular Bases . . . . .	126
	Input Specifications for the Modular Bases . . . . .	127
	Relay Output Specifications for the Modular Bases . . . . .	132
	Transistor Output Specifications for the Modular bases . . . . .	134
	Description of Analog Potentiometers . . . . .	136
	Overview of Analog Voltage Input . . . . .	137
	Functional Specifications for the Modular Bases . . . . .	138
4.3	Modular Bases Wiring . . . . .	140
	Wiring Rules and Recommendations . . . . .	141
	Modular Base Wiring Diagrams . . . . .	145


4.4	Modular Bases Options . . . . .	150
	Memory Cartridges . . . . .	151
	Real Time Clock (RTC) Cartridge . . . . .	152
	Operator Display Expansion Modules . . . . .	153
<b>Chapter 5</b>	<b>Telefast® Pre-Wired Systems for Twido . . . . .</b>	<b>157</b>
	Overview of the Telefast® Pre-Wired System for Twido . . . . .	158
	Dimensions of the Telefast® Bases . . . . .	161
	Specifications for the Telefast® Bases . . . . .	162
	Telefast® Bases Wiring Schematics . . . . .	164
	Wiring Specifications for the TeleFast Cables . . . . .	171
<b>Chapter 6</b>	<b>Controller Operation . . . . .</b>	<b>175</b>
6.1	Dedicated I/Os . . . . .	176
	RUN/STOP Input . . . . .	177
	Controller Status Output . . . . .	178
	Latching input . . . . .	179
	Fast Counting . . . . .	180
	Very Fast Counters . . . . .	181
	Pulse (PLS) Generator Output . . . . .	184
	Pulse Width Modulation (PWM) Output . . . . .	185
6.2	Controller Operating Modes . . . . .	186
	Cyclic Scan . . . . .	187
	Periodic Scan . . . . .	189
	Checking Scan Time . . . . .	192
	Operating Modes . . . . .	193
	Dealing with Power Outages and Restoration . . . . .	195
	Dealing with a Warm Restart . . . . .	197
	Dealing with a Cold Start . . . . .	199
	Initialization of Objects . . . . .	201
<b>Chapter 7</b>	<b>Operator Display Operation . . . . .</b>	<b>203</b>
	Operator Display . . . . .	204
	Controller Identification and State Information . . . . .	207
	System Objects and Variables . . . . .	209
	Serial Port Settings . . . . .	216
	Time of Day Clock . . . . .	217
	Real-Time Correction Factor . . . . .	218
<b>Appendices</b>	<b>. . . . .</b>	<b>219</b>
<b>Appendix A</b>	<b>System Diagnostic using the Front Panel LED's . . . . .</b>	<b>221</b>
	System Diagnostic Using the Front Panel LEDs . . . . .	221
<b>Appendix B</b>	<b>Troubleshooting . . . . .</b>	<b>225</b>
	Checking I/O Connections on the Base Controller . . . . .	225
<b>Appendix C</b>	<b>The DIN Rail . . . . .</b>	<b>227</b>
	The DIN Rail . . . . .	227

---

<b>Appendix D</b>	<b>IEC Symbols</b> .....	<b>229</b>
	Glossary of Symbols .....	229
<b>Appendix E</b>	<b>Agency Compliance</b> .....	<b>231</b>
	Agency Requirements .....	231
<b>Glossary</b>	.....	<b>233</b>
<b>Index</b>	.....	<b>241</b>

---

## Safety Information



---

### Important Information

#### NOTICE

Read these instructions carefully, and look at the equipment to become familiar with the device before trying to install, operate, or maintain it. The following special messages may appear throughout this documentation or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a Danger or Warning safety label indicates that an electrical hazard exists, which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

### **DANGER**

**DANGER** indicates an imminently hazardous situation which, if not avoided, **will result in** death or serious injury.

### **WARNING**

**WARNING** indicates a potentially hazardous situation which, if not avoided, **can result in** death or serious injury.

---

 **CAUTION**

**CAUTION** indicates a potentially hazardous situation which, if not avoided, **can result in** minor or moderate injury.

**CAUTION**

**CAUTION**, used without the safety alert symbol, indicates a potentially hazardous situation which, if not avoided, **can result in** equipment damage.

**PLEASE NOTE**


Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

A qualified person is one who has skills and knowledge related to the construction and operation of electrical equipment and its installation, and has received safety training to recognize and avoid the hazards involved.



---

## About the Book



---

### At a Glance

#### Document Scope

This is the Hardware Guide for Twido programmable controllers for compact modular bases.

#### Validity Note

The information in this manual is applicable **only** for Twido programmable controllers. This documentation is valid for TwidoSuite Version 2.3.

#### User Comments

We welcome your comments about this document. You can reach us by e-mail at [techcomm@schneider-electric.com](mailto:techcomm@schneider-electric.com).



---

# Twido Hardware Guide - Compact & Modular Bases



---

## Introduction

This part of the guide provides parts descriptions, specifications, wiring schematics, installation, set up, and troubleshooting information about all Twido compact & modular bases.

## What's in this Part?

This part contains the following chapters:

Chapter	Chapter Name	Page
1	Twido Overview	13
2	Installation	33
3	Description of Compact Bases	79
4	Description of Modular Bases	119
5	Telefast® Pre-Wired Systems for Twido	157
6	Controller Operation	175
7	Operator Display Operation	203



---

# Twido Overview



---

## Introduction

This chapter provides an overview of the Twido products, the maximum configurations, the main functions of the bases, and an overview of the communication system.

## What's in this Chapter?

This chapter contains the following topics:

Topic	Page
About Twido	14
Maximum Hardware Configuration for Compact Bases	18
Maximum Hardware Configuration for Modular Bases	21
Main Features of the Controllers	23
Communications Overview	26

## About Twido

### Introduction

The Twido controller is available in the two following models:

- Compact Bases
- Modular Bases

Compact bases are available with 10, 16, 24 or 40 I/Os.

Modular bases are available with either 20 or 40 I/Os.

Additional I/O can be added to the bases using expansion I/O modules. They are:

- 15 expansion modules for discrete I/O or relay type
- 10 expansion modules for the analog I/O type

There are also several options that can be added to the bases as in the table from the Base Options (*see page 16*) paragraph below.

In addition to these options, other options listed below can be added:

- Programming cables (*see page 17*)
- Discrete I/O cables
- Telefast pre-wired systems with I/O interfaces (*see page 158*)

### Connection to Communication Modules

Connecting to an AS-Interface bus interface module also permits you to manage up to 62 slave devices. Use the following module:

- AS-Interface V2 bus interface master module: TWDNOI10M3.

The 24 I/O and 40 I/O compact bases and all modular bases can connect to a CANopen fieldbus interface module. The CANopen master module permits you to manage up to 16 CANopen slave devices (not to exceed 16 Transmit-PDOs (TPDO) and 16 Receive-PDOs (RPDO)). Use the following module:

- CANopen fieldbus interface master module: TWDNCO1M.

### Advanced Features for TWDLC••40DRF Compact Bases

Advanced integrated features are provided on the TWDLC••40DRF series compact bases:

- Built-in 100Base-TX Ethernet network port: TWDLCAE40DRF and TWDLCDE40DRF only
- Onboard Real-Time Clock (RTC): TWDLC••40DRF
- A fourth Fast Counter (FC): TWDLC••40DRF
- External battery support: TWDLC••40DRF

## Base Models

The following table lists the bases:

Base Name	Reference	Channels	Channel type	Input/Output type	Power supply
Compact 10 I/O	TWDLCAA10DRF	6	Inputs	24 VDC	100/240 VAC
		4	Outputs	Relay	
Compact 10 I/O	TWDLCDA10DRF	6	Inputs	24 VDC	24 VDC
		4	Outputs	Relay	
Compact 16 I/O	TWDLCAA16DRF	9	Inputs	24 VDC	100/240 VAC
		7	Outputs	Relay	
Compact 16 I/O	TWDLCDA16DRF	9	Inputs	24 VDC	24 VDC
		7	Outputs	Relay	
Compact 24 I/O	TWDLCAA24DRF	14	Inputs	24 VDC	100/240 VAC
		10	Outputs	Relay	
Compact 24 I/O	TWDLCDA24DRF	14	Inputs	24 VDC	24 VDC
		10	Outputs	Relay	
Compact 40 I/O	TWDLCAA40DRF	24	Inputs	24 VDC	100/240 VAC
		16	Outputs	Relay X 14 Transistors X 2	
Compact 40 I/O	TWDLCAE40DRF	24	Inputs	24 VDC	100/240 VAC
		16	Outputs	Relay X 14 Transistors X 2 Ethernet port	
Compact 40 I/O	TWDLCDA40DRF	24	Inputs	24 VDC	24 VDC
		16	Outputs	Relay X 14 Transistors X 2	
Compact 40 I/O	TWDLCDE40DRF	24	Inputs	24 VDC	24 VDC
		16	Outputs	Relay X 14 Transistors X 2 Ethernet port	
Modular 20 I/O	TWDLMDA20DUK	12	Inputs	24 VDC	24 VDC
		8	Outputs	Transistor sink	
Modular 20 I/O	TWDLMDA20DTK	12	Inputs	24 VDC	24 VDC
		8	Outputs	Transistor source	
Modular 20 I/O	TWDLMDA20DRT	12	Inputs	24 VDC	24 VDC
		6	Outputs	Relay	
		2	Outputs	Transistor source	

Base Name	Reference	Channels	Channel type	Input/Output type	Power supply
Modular 40 I/O	TWDLMDA40DUK	24	Inputs	24 VDC	24 VDC
		16	Outputs	Transistor sink	
Modular 40 I/O	TWDLMDA40DTK	24	Inputs	24 VDC	24 VDC
		16	Outputs	Transistor source	

## Base Options

The following table lists the options:

Option name	Reference
Operator display module (Compact bases only)	TWDXCPODC
Operator display expansion module (Modular bases only)	TWDXCPODM
Real Time Clock (RTC) cartridge	TWDXCPRTC
32 Kb EEPROM memory cartridge	TWDXCPMFK32
64 Kb EEPROM memory cartridge	TWDXCPMFK64
Communication adapter, RS485, miniDIN	TWDNAC485D
Communication adapter, RS232, miniDIN	TWDNAC232D
Communication adapter, RS485, terminal	TWDNAC485T
Communication expansion module, RS485, miniDIN (Modular bases only)	TWDNOZ485D
Communication expansion module, RS232, miniDIN (Modular bases only)	TWDNOZ232D
Communication expansion module, RS485, terminal (Modular bases only)	TWDNOZ485T
ConneXium TwidoPort Ethernet interface module (except for TWDLCAE40DRF and TWDLCDE40DRF with on-board Ethernet interface)	499TWD01100
6-point input simulator (Compact bases only)	TWDXSM6
9-point input simulator (Compact bases only)	TWDXSM9
14-point input simulator (Compact bases only)	TWDXSM14
External backup battery (TWDLCA•40DRF only)	TSXPLP01 (single battery order) TSXPLP101 (10 pack order)
5 mounting strips	TWDDXMT5
2 terminal blocks (10 positions)	TWDFTB2T10
2 terminal blocks (11 positions)	TWDFTB2T11
2 terminal blocks (13 positions)	TWDFTB2T13
2 terminal blocks (16 positions)	TWDFTB2T16T
2 connectors (20 pins)	TWDFCN2K20
2 connectors (26 pins)	TWDFCN2K26



## Cables

The following table lists the cables:

Cable name	Reference
<b>Programming cables</b>	
PC to controller programming cable: Serial	TSX PCX1031
PC to controller programming cable: USB	TSX CUSB485, TSX CRJMD25 and TSX PCX3030
Mini-DIN to free wire communication cable	TSX CX100

## Maximum Hardware Configuration for Compact Bases

### Introduction

This section provides the maximum hardware configurations for a compact base.

### Maximum Hardware Configurations

The following tables list the maximum number of configuration items for each type of compact base:

#### Base specifics:

Base Item	Compact base			
	LCAA10DRF LCDA10DRF	LCAA16DRF LCDA16DRF	LCAA24DRF LCDA24DRF	LCAA40DRF LCAE40DRF LCDA40DRF LCDE40DRF
Serial ports	1	2	2	2
Ethernet port	0	0	0	1 (TWDLCAE40DRF and TWDLCDE40DRF only)
Cartridge slots	1	1	1	1
Largest application/backup size (KB)	8	16	32	64
Optional memory cartridge (KB)	32 <sup>1</sup>	32 <sup>1</sup>	32 <sup>1</sup>	32 or 64 <sup>2</sup>
Optional RTC cartridge	yes <sup>1</sup>	yes <sup>1</sup>	yes <sup>1</sup>	RTC onboard <sup>3</sup>
Optional Operator Display	yes	yes	yes	yes
Optional 2nd serial port	no	yes	yes	yes
Optional Ethernet interface module	yes	yes	yes	yes (TWDLCAA40DRF and TWDLCDA40DRF) no (TWDLCAE40DRF and TWDLCDE40DRF)

#### NOTE:

1. A Compact base can have either a memory cartridge or an RTC cartridge.
2. Memory cartridge only, for RTC is already onboard.
3. All TWDLC••40DRF compact bases have a built-in RTC. Therefore, only a memory cartridge can be added to those controllers.

**Discrete I/O expansions:**

<b>Base Item</b>	<b>Compact base</b>			
<b>TWD...</b>	<b>LCAA10DRF LCDA10DRF</b>	<b>LCAA16DRF LCDA16DRF</b>	<b>LCAA24DRF LCDA24DRF</b>	<b>LCAA40DRF LCAE40DRF LCDA40DRF LCDE40DRF</b>
Standard discrete inputs	6	9	14	24
Standard discrete outputs	4	7	10	16 (14 Relay + 2 Transistor outputs)
Max expansion I/O modules (Discrete or analog)	0	0	4	7
Max discrete inputs (controller I/O + exp I/O)	6	9	14+(4x32)=142	24+(7x32)=248
Max discrete outputs (controller I/O + exp I/O)	4	7	10+(4x32)=138	16+(7x32)=240
Max digital I/O (controller I/O + exp I/O)	10	16	24+(4x32)=152	40+(7x32)=264
Max relay outputs	4 base only	7 base only	10 base + 32 expansion	14 base + 96 expansion
Potentiometers	1	1	2	2

**Analog I/O expansions:**

<b>Base Item</b>	<b>Compact base</b>			
<b>TWD...</b>	<b>LCAA10DRF LCDA10DRF</b>	<b>LCAA16DRF LCDA16DRF</b>	<b>LCAA24DRF LCDA24DRF</b>	<b>LCAA40DRF LCAE40DRF LCDA40DRF LCDE40DRF</b>
Built-in analog inputs	0	0	0	0
Max analog I/O (controller I/O + exp I/O)	0 in or 0 out	0 in or 0 out	32 in or 8 out	56 in / 14 out

---

**Communication modules:**

Base Item	Compact base			
	LCAA10DRF LCDA10DRF	LCAA16DRF LCDA16DRF	LCAA24DRF LCDA24DRF	LCAA40DRF LCAE40DRF LCDA40DRF LCDE40DRF
Max AS-Interface bus interface modules	0	0	2	2
Max I/O with AS-Interface modules (7 I/O per slave)	10	16	24+(2x62x7)=892	40+(2x62x7)=908
Max CANopen fieldbus interface modules	0	0	1	1
Max T/R-PDOs with CANopen devices	0	0	16 TPDOs 16 RPDOs	16 TPDOs 16 RPDOs
Remote controllers	7	7	7	7

## Maximum Hardware Configuration for Modular Bases

### Introduction

This section provides the maximum hardware configurations for a modular base.

### Maximum Hardware Configurations

The following tables list the maximum number of configuration items for each type of modular base:

#### Base specifics:

Base Item	Modular base		
	LMDA20DUK LMDA20DTK	LMDA20DRT	LMDA40DUK LMDA40DTK
Serial ports	2	2	2
Cartridge slots	2	2	2
Largest application/backup size (KB)	32	64	64
Optional memory cartridge (KB)	32	32 or 64	32 or 64
Optional RTC cartridge	yes	yes	yes
Optional Operator Display	yes <sup>1</sup>	yes <sup>1</sup>	yes <sup>1</sup>
Optional Ethernet interface module	yes	yes	yes

#### NOTE:

1. A modular base can have either an Operator Display expansion module (with an optional communication adapter) or a communication expansion module.

#### Discrete I/O expansions:

Base Item	Modular base		
	LMDA20DUK LMDA20DTK	LMDA20DRT	LMDA40DUK LMDA40DTK
Standard discrete inputs	12	12	24
Standard discrete outputs	8	8	16
Max expansion I/O modules (Discrete or analog)	4	7	7
Max discrete inputs (controller I/O + exp I/O)	12+(4x32)=140	12+(7x32)=236	24+(7x32)=248
Max discrete outputs (controller I/O + exp I/O)	8+(4x32)=136	8+(7x32)=232	16+(7x32)=240
Max digital I/O (controller I/O + exp I/O)	20+(4x32)=148	20+(7x32)=244	40+(7x32)=264

<b>Base Item</b>	<b>Modular base</b>		
<b>TWD...</b>	<b>LMDA20DUK LMDA20DTK</b>	<b>LMDA20DRT</b>	<b>LMDA40DUK LMDA40DTK</b>
Max relay outputs	64 expansion only	6 base + 96 expansion	96 expansion only
Potentiometers	1	1	1

**Analog I/O expansions:**

<b>Base Item</b>	<b>Modular base</b>		
<b>TWD...</b>	<b>LMDA20DUK LMDA20DTK</b>	<b>LMDA20DRT</b>	<b>LMDA40DUK LMDA40DTK</b>
Built-in analog inputs	1	1	1
Max analog I/O (controller I/O + exp I/O)	33 in or 17 in and 8 out	57 in or 29 in and 14 out	57 in or 29 in and 14 out

**Communication modules:**

<b>Base Item</b>	<b>Modular base</b>		
<b>TWD...</b>	<b>LMDA20DUK LMDA20DTK</b>	<b>LMDA20DRT</b>	<b>LMDA40DUK LMDA40DTK</b>
Max AS-Interface bus interface modules	2	2	2
Max I/O with AS-Interface modules (7 I/O per slave)	$20+(2 \times 62 \times 7)=888$	$20+(2 \times 62 \times 7)=888$	$40+(2 \times 62 \times 7)=908$
Max CANopen fieldbus interface modules	1	1	1
Max T/R-PDOs with CANopen devices	16 TPDOs 16 RPDOs	16 TPDOs 16 RPDOs	16 TPDOs 16 RPDOs
Remote controllers	7	7	7

## Main Features of the Controllers

### Introduction

By default all I/Os on the bases are configured as discrete I/Os. However, certain dedicated I/Os (*see page 176*) can be assigned to specific tasks during configuration such as:

- RUN/STOP input
- Latching inputs
- Fast counters:
  - Single up/down counters: 5 kHz (1-phase)
  - Very fast counters: Up/down counters - 20 kHz (2-phase)
- Controller status output
- Pulse Width Modulation (PWM)
- Pulse (PLS) generator output

Twido controllers are programmed using TwidoSuite which also enables the PID and PID Auto-Tuning functions to be used on certain controllers:

### Main Features

The following table lists the main features of the bases:

Feature	Description
Scanning	Normal (cyclical) or periodic (constant) (2 to 150 ms)
Execution time	0.14 $\mu$ s to 0.9 $\mu$ s for a list instruction
Memory capacity	Data: 3000 memory words for all bases 128 memory bits for TWDLCAA10DRF and TWDLCAA16DRF 256 memory bits for all other bases.  Program: 10 I/O compact base: 700 list instructions 16 I/O compact base: 2000 list instructions 24 I/O compact, and 20 I/O modular bases: 3000 list instructions 20 I/O modular and 40 I/O modular bases, and 40 I/O compact bases: 6000 list instructions (with a 64 Kb cartridge, otherwise 3000 list instructions)
RAM backup	All bases: By lithium internal battery. Backup duration is approximately 30 days (typically) at 25° C (77° F) after battery is fully charged. It take 15 hours to obtain 0 to 90% of the full battery charge. Battery life is 10 years when charged for 9 hours and discharged for 15 hours. The battery cannot be replaced.  40DRF compact bases: By user-replaceable lithium external battery (in addition to internal battery onboard). Backup duration is approximately 3 years (typically) at 25° C (77° F) under normal operating conditions of the base (typically, no long-term powering off of the base). BAT LED on front-panel provides indication of battery-power status.

Feature	Description	
Programming port	All bases: EIA RS485 TWDLC•E40DRF compact bases: Built-in RJ45 Ethernet communications port	
Expansion I/O modules	10 and 16 I/O compact bases: no expansion modules 24 I/O compact and 20 I/O modular bases: up to 4 expansion I/O modules 40 I/O modular and 40 I/O compact bases: up to 7 expansion I/O modules	
AS-Interface V2 bus interface modules	10 and 16 I/O compact bases: no AS-Interface bus interface module 24 I/O and 40 I/O compact, 20 I/O and 40 I/O modular bases: up to 2 AS-Interface bus interface modules	
CANopen fieldbus interface modules	10 and 16 I/O compact bases: no CANopen fieldbus interface module 24 I/O and 40 I/O compact, 20 I/O and 40 I/O modular bases: 1 CANopen fieldbus interface module	
Remote link communication	Maximum 7 slaves by remote I/O or peer bases. Maximum length of entire network: 200 m (650 feet).	
Modbus communication	Non-isolated EIA RS485 type, maximum length limited to 200 m. ASCII or RTU mode.	
Ethernet communication	TWDLCAE40DRF, TWDLCDE40DRF compact bases and 499TWD01100 Ethernet interface module: 100Base-TX auto-negotiated type Ethernet communications over TCP/IP protocol, via built-in RJ45 port.	
ASCII communication	Half-duplex protocol to a device.	
Dedicated function blocks	Fast counters	TWDLCA•40DRF and TWDLCD•40DRF Compact bases: 4 All other compact bases: 3 All modular bases: 2
	Very fast counters	TWDLCA•40DRF and TWDLCD•40DRF compact bases: 2 All other compact bases: 1 All modular bases: 2
	PWM/PLS	All modular and 40 I/O compact bases: 2
Analog potentiometers	24 I/O and 40 I/O compact bases: 2 All other bases: 1	
Built-in analog channel	Compact bases: none Modular bases: 1 input	
Programmable input filter	Input filter time can be changed during configuration No filtering or filtering at 3 ms or 12 ms I/O points are configured in groups	



Feature	Description	
Special I/O	Inputs	RUN/STOP: Any one of the base inputs
		Latching: up to 4 inputs (%I0.2 to %I0.5)
		0-10 V built-in analog input connected to %IW0.0.0
		Fast counters: 5 kHz maximum Very fast counters: 20 kHz maximum Frequency meter: 1 kHz to 20 kHz maximum
	Outputs	Controller status output: 1 of 3 outputs (%Q0.1 to %Q0.3)
		PWM: 7 kHz maximum
		PLS: 7 kHz maximum

## Communications Overview

### Introduction

Twido bases have one, or an optional second, serial port that is used for real-time or system management services.

Four types of communication can be used with Twido controllers:

- AS-Interface bus connection
- CANopen fieldbus connection
- Ethernet network connection
- Modem connection

The real-time services provide data distribution functions for exchanging data with I/O devices and messaging functions for communicating to external devices. System management services manage and configure the base through TwidoSuite. Either serial port is used for any of these services but only serial port 1 is for communicating with TwidoSuite.

To provide these services, there are three protocols available on each base:


- Remote Link
- Modbus
- ASCII

In addition, the TWDLCAE40DRF and TWDLCDE40DRF compact bases feature a built-in RJ45 Ethernet communications port allowing to perform all real-time communications and system management tasks via the network. Ethernet communications implements the following protocol:

- Modbus TCP/IP

## Communications Architecture with Protocols

The following diagram shows the communication architecture with all three protocols.

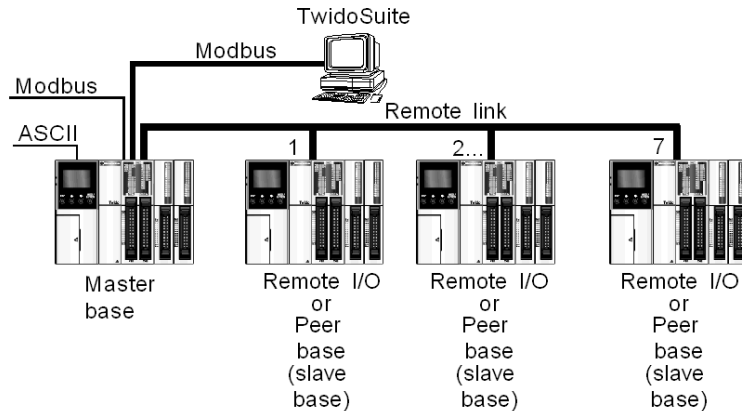

**NOTE:** Communication between the "Modbus" and "Remote Link" protocols cannot occur at the same time.

## AS-Interface Connection

The AS-Interface (abbreviation for Actuator-Sensor-Interface) bus is a field bus (level 0), and can be used to connect sensors/actuators. This allows "discrete" or analog type information to run between a bus "master" and sensor/actuator type "slave" devices.


AS-Interface is made up of three major basic elements:

- a specific supply providing a 30 VDC voltage,
- a bus master,
- one or more slave devices (sensors, actuators and others).

These components are interconnected by a two-wire cable dedicated to data transmission and power supply.

## AS-Interface Connection Illustration

The following illustration describes the AS-Interface Connection:

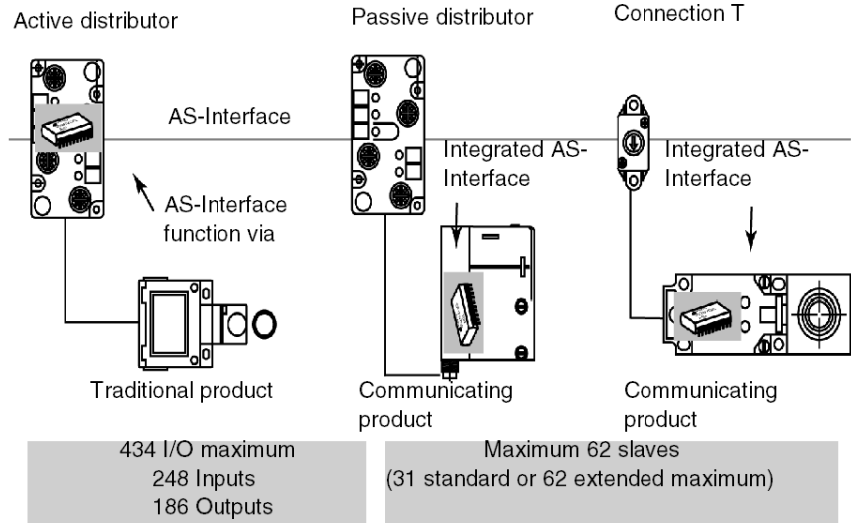

## CANopen Fieldbus Connection

The CANopen architecture of a Twido system consists of:


- a Twido PLC (compact base or modular base)<sup>1</sup>,
- a CANopen fieldbus master module (TWDNCO1M module) installed on the Twido PLC's expansion bus<sup>2</sup>,
- CANopen slave devices<sup>3,4</sup>.

### NOTE:

1. The TWDNCO1M CANopen master module is supported by the following Twido base controllers:
  - Compact bases: TWDLC•A24DRF, TWDLCA•40DRF and TWDLCD•40DRFseries
  - All modular bases: TWDLMDA20••• and TWDLMDA40••• series
2. Only 1 TWDNCO1M CANopen master module can be installed on the Twido system expansion bus.
3. The TWDNCO1M CANopen master module can manage up to 16 CAN slave devices on a single bus segment.
4. The TWDNCO1M CANopen fieldbus does not support extended addressing for CANopen slave devices.

## Twido CANopen Fieldbus Topology


The following figure shows the Twido CANopen fieldbus topology:

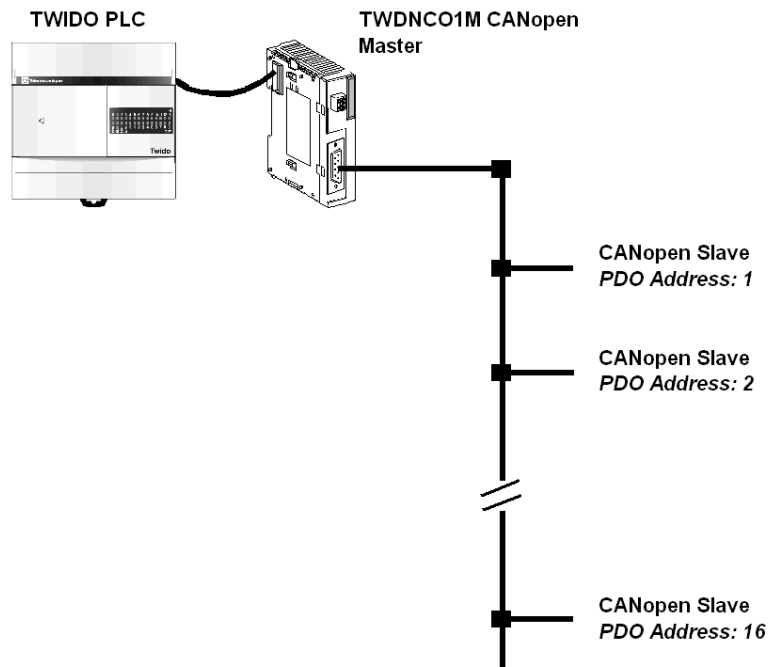

## Ethernet Network Connection

**NOTE:** Although direct cable connection (using a Ethernet crossover cable) is supported between the Twido TWDLCAE40DRF (or TWDLCDE40DRF) and the PC running the TwidoSuite programming software, making the connection, via a network Ethernet hub/switch, is recommended.


The following figure shows a PC-to-Twido connection via a network Ethernet hub/switch:

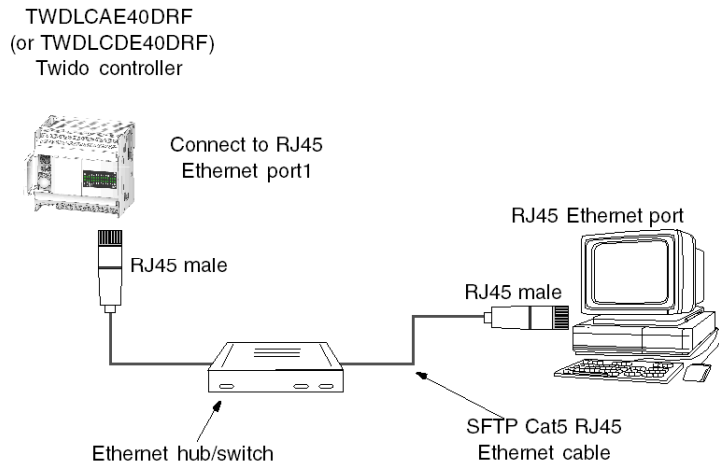

**NOTE:** The PC running the TwidoSuite application must be Ethernet-capable.

The Twido TWDLCAE40DRF and TWDLCDE40DRF bases feature a RJ45 connector to connect to the 100 BASE-TX network Ethernet with auto negotiation. It can accommodate both 100Mbps and 10 Mbps network speeds.

The following figure shows the RJ45 connector of the Twido controller:



The eight pins of the RJ45 connector are arranged vertically and numbered in order from bottom to top. The pinout for the RJ45 connector is described in the table below:

Pinout	Function	Polarity
8	NC	
7	NC	
6	RxD	(-)
5	NC	


Pinout	Function	Polarity
4	NC	
3	RxD	(+)
2	TxD	(-)
1	TxD	(+)

**NOTE:**

- The same connector and pinout is used for both 10Base-T and 100Base-TX.
- When connecting the Twido controller to a 100Base-TX network, use at least a category 5 Ethernet cable.

**Modem Connection**

A PC executing TwidoSuite can be connected to a Twido controller for transferring applications, animating objects and executing operator mode commands. It is also possible to connect a Twido controller to other devices, such as another Twido controller, for establishing communication with the application process.

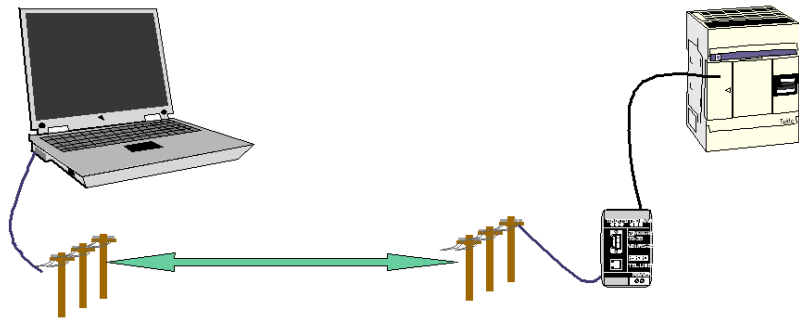





---

# Installation

# 2

---

## Introduction

This chapter provides installation overall instructions and installation preparation, installation and mounting instructions for the compact bases, for the modular bases, and for their options, and how to connect the power supply.

## What's in this Chapter?

This chapter contains the following sections:

Section	Topic	Page
2.1	Installation Overall Instructions	34
2.2	Compact Bases Installation	48
2.3	Modular Bases Installation	63

## 2.1 Installation Overall Instructions

---

### Introduction

This section provides information for installation preparation, safety, how to assemble and disassemble bases and modules, and minimum clearances for bases and modules.

### What's in this Section?

This section contains the following topics:

<b>Topic</b>	<b>Page</b>
Installation Requirements	35
Installation Preparation	39
Compact and Modular Bases Mounting Positions	40
Assembling an Expansion I/O Module to a Base	42
Disassembling an Expansion I/O Module from a Base	44
Minimum Clearances for Bases and Expansion I/O Modules in a Control Panel	46

## Installation Requirements

### NOTICE

Electrical equipment should be serviced only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material. This document is not intended as an instruction manual for untrained persons.

(c) 2008 Schneider Electric All Rights Reserved

### Additional Information

Those responsible for the application, implementation or use of this product must ensure that the necessary design considerations have been incorporated into each application, completely adhering to applicable laws, performance and safety requirements, regulations, codes and standards.

### General Information

## DANGER

### HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Disconnect all power from all equipment including connected devices prior to removing any covers or doors, or installing or removing any accessories, hardware, cables, or wires except under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

**Failure to follow these instructions will result in death or serious injury.**

## **WARNING**

### **EXPLOSION HAZARD**

- This equipment is suitable for use in Class 1, Division 2, Groups A, B, C and D or non-hazardous locations only.
- Substitution of components may impair suitability for Class I, Division 2 compliance.
- Do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

## **WARNING**

### **UNINTENDED EQUIPMENT OPERATION**

- This product is not intended for use in safety critical machine functions. Where personnel and or equipment hazards exist, use appropriate safety interlocks.
- Do not disassemble, repair, or modify the modules.
- This controller is designed for use within an enclosure appropriately rated for its intended environment.
- Install the modules in the operating environment conditions described.
- Use the sensor power supply only for supplying power to sensors connected to the module.
- For power line and output circuits, use a fuse in compliance with local and national requirements for the circuit voltage and current requirements.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

## WARNING

### LOSS OF CONTROL

- The designer of any control scheme must consider the potential failure modes of control paths and, for certain critical control functions, provide a means to achieve a safe state during and after a path failure. Examples of critical control functions are emergency stop and overtravel stop.
- Separate or redundant control paths must be provided for critical control functions.
- System control paths may include communication links. Consideration must be given to the implications of unanticipated transmission delays or failures of the link.<sup>1</sup>
- Each implementation of the Twido Programmable Controller must be individually and thoroughly tested for proper operation before being placed into service.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

<sup>1</sup>For additional information refer to NEMA ICS 1.1 (latest edition), "Safety Guidelines for the Application, Installation, and Maintenance of Solid State Control".

### Safe Battery Disposal

The TWDLCA•40DRF compact bases use an optional external lithium battery for longer duration of data backup. (Note: The lithium battery is not supplied with the compact bases; you must purchase it separately.)

## WARNING

### FIRE OR CHEMICAL HAZARD

The Lithium batteries used in this device may present a risk of fire or chemical burn if not handled properly

- Do not recharge, disassemble, heat above 212 °F (100 °C), or incinerate.
- Recycle or properly dispose of used batteries.
- Replace with identical type: TSXPLP01 (Tadiran, TL-5902) only.
- Follow all battery manufacturers' instructions.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

## Reverse Polarity

### Reverse-Polarity at Transistor Output is Not Allowed

The TWDLCA•40DRF compact bases transistor outputs cannot withstand any reverse polarity.

 <b>CAUTION</b>
<b>REVERSE-POLARITY DAMAGE AT TRANSISTOR OUTPUTS</b> Make sure to conform to the polarity markings on the transistor output terminals. <b>Failure to follow these instructions can result in injury or equipment damage.</b>

---

## Installation Preparation

### Introduction

The following section provides information on preparation for all TwidoSuite bases and expansion I/O modules.

### Before Starting

Before installing any of the TwidoSuite products read the Safety Information at the beginning of this book.

 <b>CAUTION</b>
--

<b>INOPERABLE EQUIPMENT</b>
-----------------------------

Before adding/removing any module or adapter, turn off the power to the base.
---

<b>Failure to follow these instructions can result in injury or equipment damage.</b>
---

**NOTE:** All options, expansion I/Os, AS-Interface bus and CANopen fieldbus interface modules should be assembled before installing a Twido system on a DIN rail, onto a mounting plate, or in a control panel, should be removed from a DIN rail, a mounting plate, or a control panel before disassembling the modules.

## Compact and Modular Bases Mounting Positions

### Introduction

This section shows the correct and incorrect mounting positions for all bases.

**NOTE:** Keep adequate spacing for proper ventilation and to maintain an ambient temperature between 0° C (32° F) and 55° C (131° F).

### CAUTION


#### EQUIPMENT OVERHEATING

Do not place heat generating devices such as transformers and power supplies underneath the controllers or expansion I/O modules.

**Failure to follow these instructions can result in injury or equipment damage.**


### Correct Mounting Position for all Bases

Compact and Modular bases must be mounted horizontally on a vertical plane as shown in the figures below.

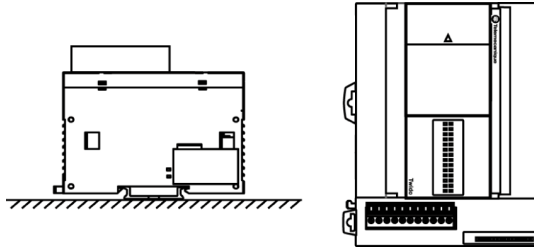


### Additional Permitted Mounting Positions for Compact Bases

Where the ambient temperature will not exceed 40° C (104° F), the compact bases may be mounted sideways on a vertical place as shown below:

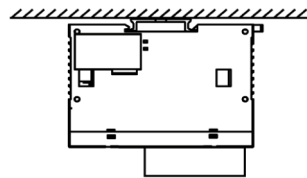



Where the ambient temperature will not exceed 35° C (95° F), the compact bases may also be mounted upright on a horizontal plane as shown below:

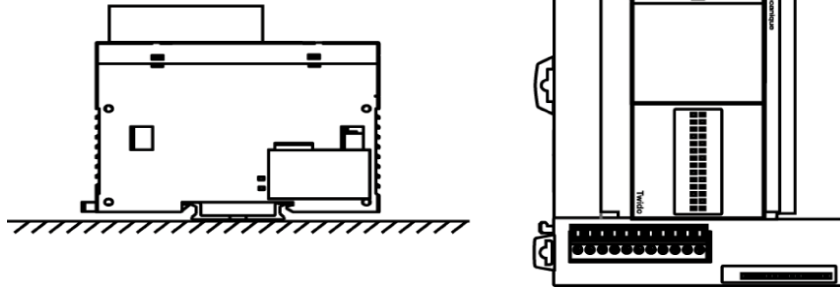

Do not mount the products in any other orientation.

## Assembling an Expansion I/O Module to a Base

### Introduction

This section shows how to assemble an expansion I/O module to a base. This procedure is for both Compact and Modular bases. Your base and expansion I/O module may differ from the illustrations in this procedure.

### ⚠ WARNING

#### UNEXPECTED EQUIPMENT OPERATION


Update the software each time you change the hardware configuration of the I/O expansion bus. Otherwise, the expansion bus will no longer operate while the local base inputs and outputs will continue to operate.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**


### Assembling an Expansion I/O Module to a Base.

The following procedure shows how to assemble a base and an expansion I/O module together.

Step	Action
1	Remove the expansion connector cover from the base.
2	Verify that the black latch button on the I/O module is in the up position.

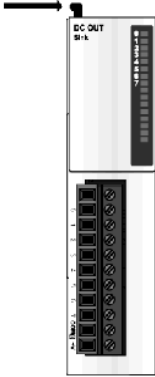

The diagram shows a vertical I/O module. At the top, there is a section labeled 'DC OUT' with '5V 1A' below it. Below this is a vertical strip of ports. At the bottom of the module is a large connector panel with multiple ports. A black arrow points to a small black latch button located at the top of the module, just below the 'DC OUT' section.

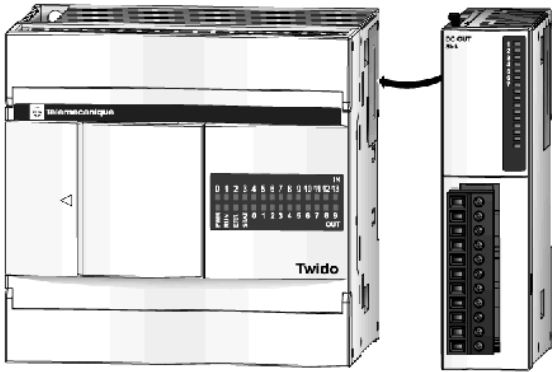Step	Action
3	<p>Align the connector on the left side of the Expansion I/O module with the connector on the right side of the base.</p> 
4	Press the expansion I/O module to the base until it "clicks" into place.
5	Push down the black latch button on the top of the expansion I/O module to lock the module to the base.


## Disassembling an Expansion I/O Module from a Base


### Introduction

This section describes how to disassemble an expansion I/O module from a base. This procedure is for both Compact and Modular bases. Your base and expansion I/O module may differ from the illustrations in these procedures but the basic mechanism procedures are still applicable.

### Disassembling an Expansion I/O Module from a Base.

The following procedure describes how to disassemble an expansion I/O module from a base.

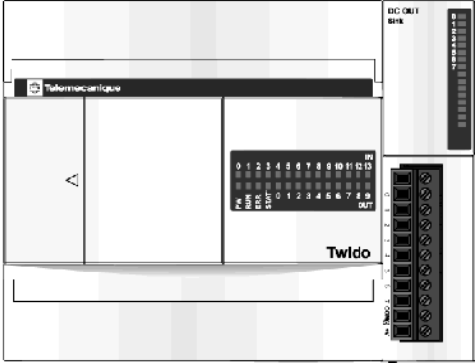Step	Action
1	Remove the assembled base and module from the DIN rail before disassembling them, see <i>The DIN Rail</i> , page 227.
2	<p>Push up the black latch from the bottom of the expansion I/O module to disengage it from the base.</p>  <p>The diagram shows a Twido expansion I/O module mounted on a base. The module has a terminal block with labels: IN (0-12), DI (0-12), DI+, DI-, OUT (1-8), and OUT+. A black arrow points to a latch at the bottom of the module, indicating where to push up to disengage it from the base. The base has a 'THERMOCARTE' label and a 'DIN ONLY SINK' label.</p>

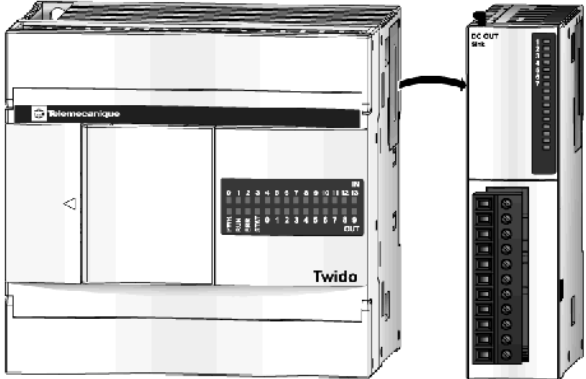Step	Action
3	<p data-bbox="474 204 776 227">Pull apart the base and module.</p> 


## Minimum Clearances for Bases and Expansion I/O Modules in a Control Panel

### Introduction

This section provides the minimum clearances for bases and expansion I/O modules in a control panel.


### Minimum Clearances for a Compact Base and Expansion I/O Modules

In order to maintain a natural circulation of air around the Compact base and expansion I/O modules in a control panel, observe the minimum clearances shown in the figures below.

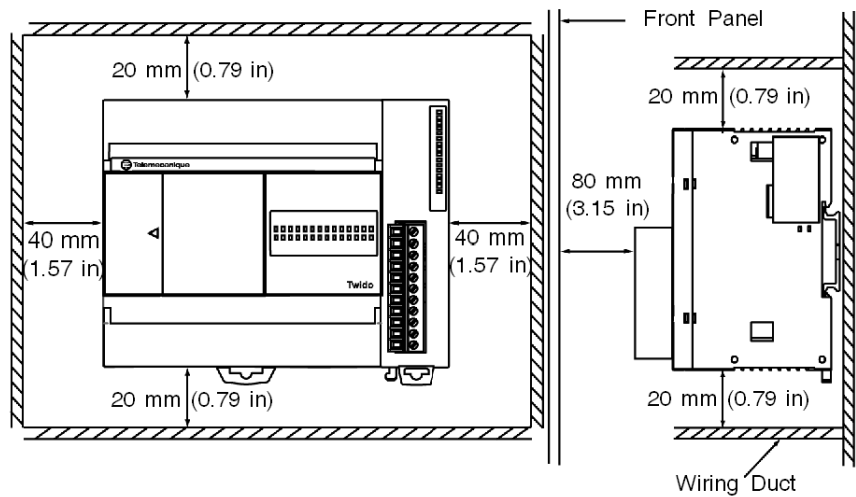

### Minimum Clearances for a Modular Base and Expansion I/O Modules

In order to maintain a natural circulation of air around the Modular base and expansion I/O modules in a control panel, observe the minimum clearances shown in the figures below.

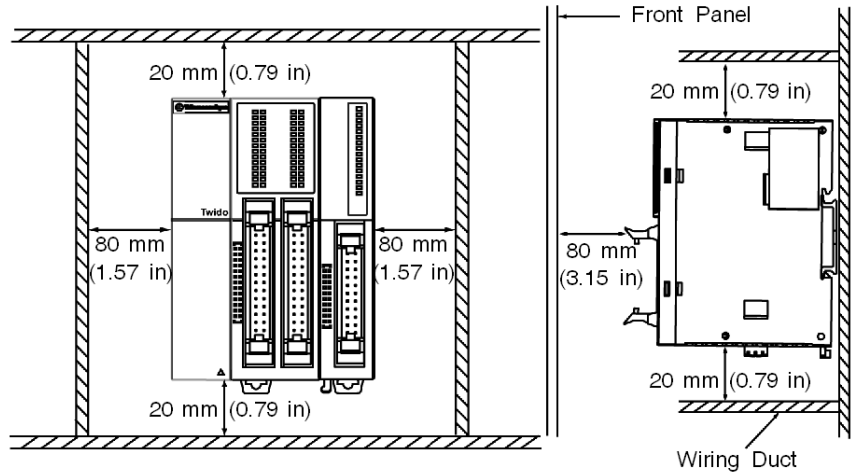

## 2.2 Compact Bases Installation

---

### Introduction

This section provides information for installing Compact bases.

### What's in this Section?

This section contains the following topics:

<b>Topic</b>	<b>Page</b>
Dimensions of the Compact Bases	49
How to Direct Mount a Compact Base on a Panel Surface	51
How to Install and Remove a Compact Base from a DIN Rail	52
How to Install the Operator Display Module	54
How to Install a Serial Interface Adapter to a Compact Base	56
How to Install a Memory or RTC Cartridge in a Compact base	57
How to Connect the Power Supply to Compact Bases	58
How to Install and Replace an External Battery	60



## Dimensions of the Compact Bases


### Introduction

The following section shows the dimensions for all Compact bases.

### TWDLCA10-DRF and TWDLCA16-DRF


The following diagrams show the dimensions for the TWDLCA10DRF and TWDLCA16DRF series Compact bases.

Illustration showing TWDLCA10DRF series base:

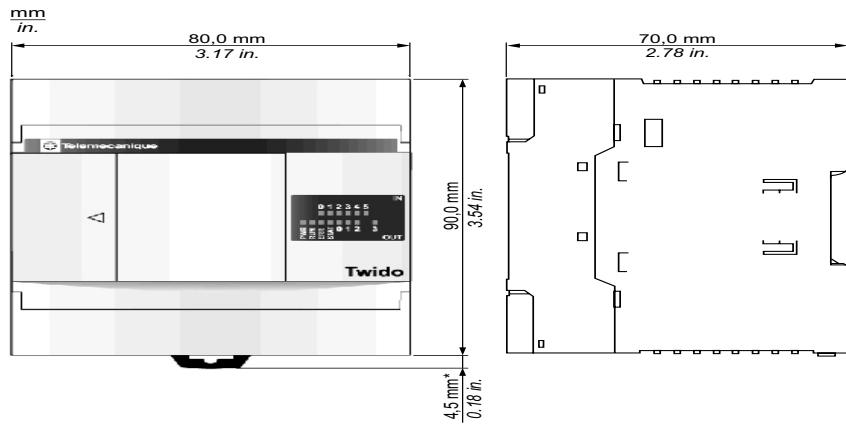


### TWDLCA24-DRF

The following diagrams show the dimensions for the TWDLCA24DRF series Compact base.

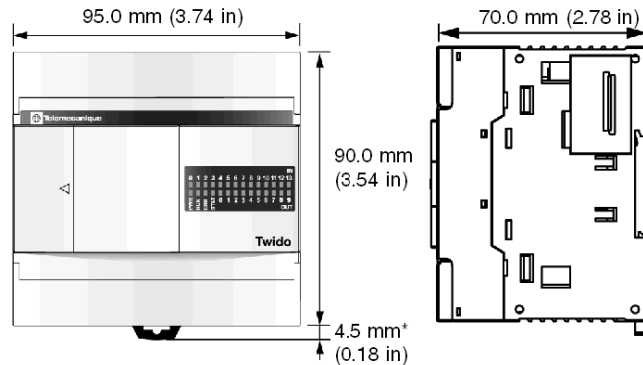

**TWDLCL••40-DRF**

The following diagrams show the dimensions for the TWDLCL••40DRF series Compact base.

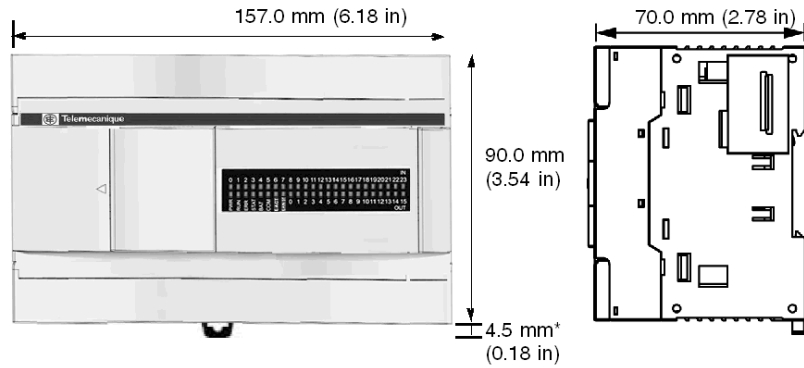

**NOTE:** \* 8.5 mm (0.33 in) when the clamp is pulled out.


## How to Direct Mount a Compact Base on a Panel Surface

### Introduction

This section also provides mounting hole layouts for a Compact base and module. Your base or module may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.

### Mounting Hole Layout for Compact Bases

The following diagram shows the mounting hole layout for all the Compact bases.

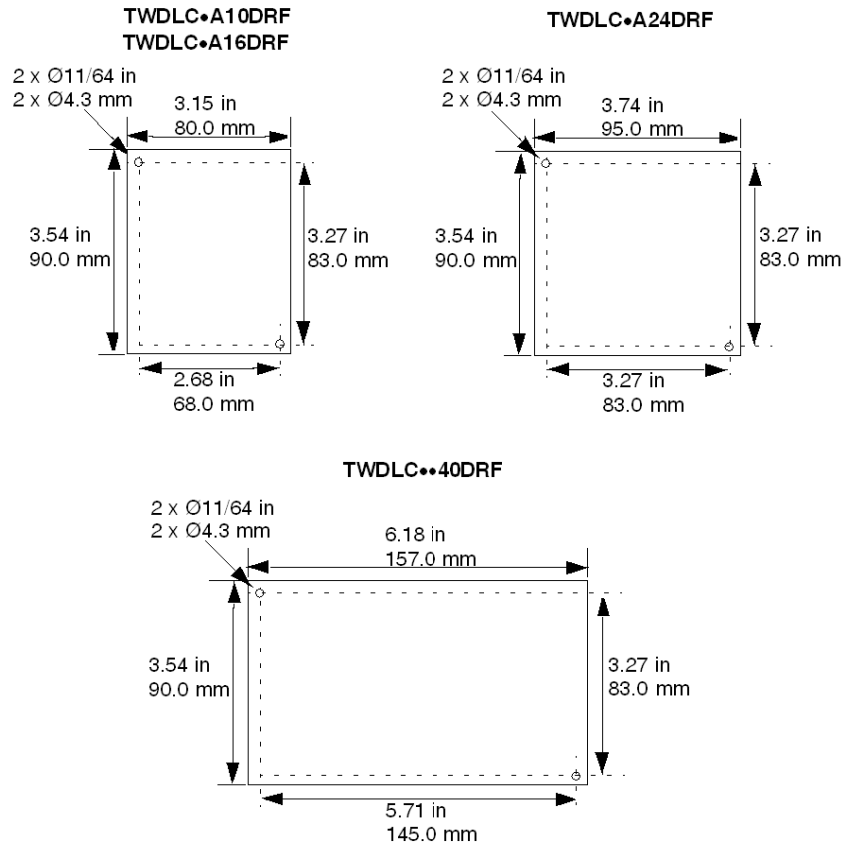

## How to Install and Remove a Compact Base from a DIN Rail

### Introduction



This section describes how to install and remove compact bases from a DIN rail. The device you want to install or remove may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.

**NOTE:** When mounting compact bases on a DIN rail, use two end stops, type AB1-AB8P35 or equivalent.

For additional information about the DIN rail, see *The DIN Rail*. *The DIN Rail*, page 227

### How to Install a Compact Base on a DIN Rail



The following procedure shows how to install a compact base on a DIN rail.

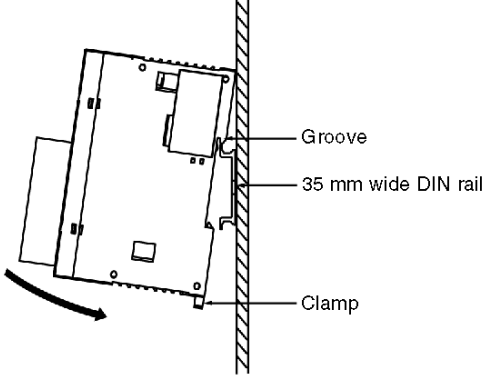Step	Action
1	Fasten the DIN rail to a panel using screws.
2	<p>Pull out the clamp at the bottom of the compact base and module assembly.</p> 
3	<p>Put the top groove of the compact base and module on the DIN rail and press the modules toward the DIN rail.</p> 

Step	Action
4	Push the clamp into the DIN rail.
5	Place mounting clips on both sides of the modules to keep the system from moving sideways.

### How to Remove a Compact Base from a DIN Rail

The following procedure shows how to remove a compact base from a DIN rail.

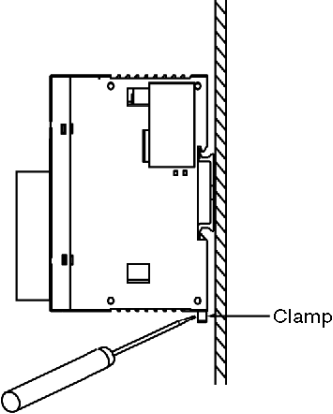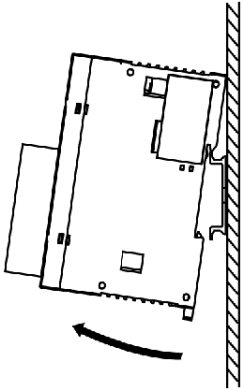Step	Action
1	Insert a flat screwdriver into the slot in the clamp.
2	Pull out the clamp. 
3	Pull the compact base and the associated module off the DIN rail from the bottom. 



## How to Install the Operator Display Module

### Introduction

This section describes installation of the TWDXCPODC operator display module.

### Installing the Operator Display Module into a Compact Base

The following procedure shows how to install the TWDXCPODC operator display module into a Compact base.

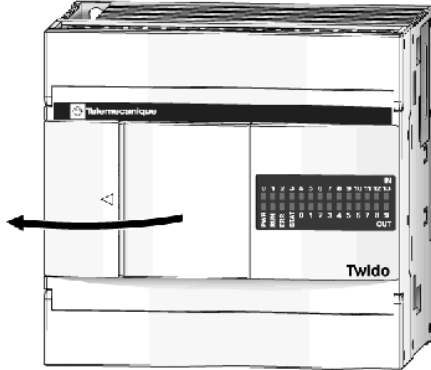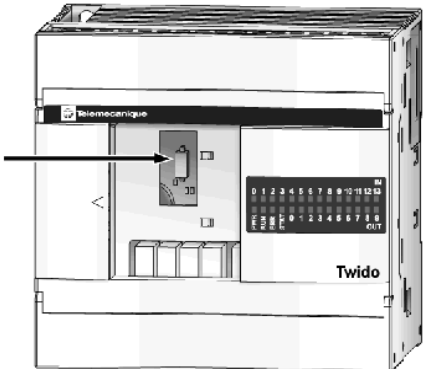Step	Action
1	Remove the operator display connector cover on the Compact base. 
2	Locate the operator display connector inside the Compact base. 




## How to Install a Serial Interface Adapter to a Compact Base

### Introduction

This section shows how to install the TWDNAC232D, TWDNAC485D, or TWDNAC485T serial interface adapter into the port 2 in a Compact base. Your base may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.

### How to Install the Serial Interface Adapter into the Port 2 in a Compact Base

The following procedure shows how to install the TWDNAC232D, TWDNAC485D, or TWDNAC485T serial interface adapter into the port 2 in a Compact base.

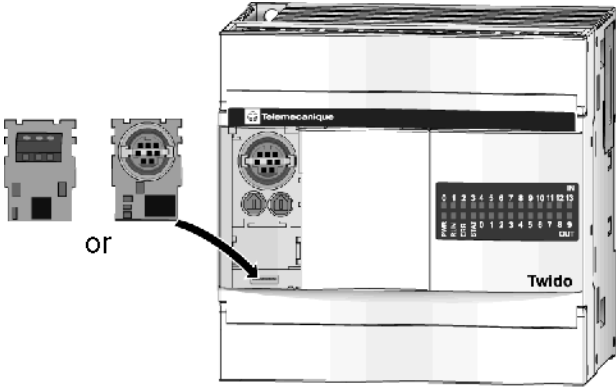Step	Action
1	Open the hinged lid.
2	Remove the cartridge cover located on the bottom of the Compact base.
3	<p>Push the serial interface adapter connector into the port 2 of the Compact base connector until it "clicks".</p> 
4	Look in the opening at the bottom of the Compact base where the cartridge cover resided and verify that the serial interface adapter connector is seated in the port 2 connector of the Compact base . Adjust the adapter if it is not seated correctly.
5	Attach the cartridge cover.



## How to Install a Memory or RTC Cartridge in a Compact base

### Introduction

This section shows how to install the TWDXCPMFK32 memory cartridge, the TWDXCPMFK64 memory cartridge (only for TWDLC••40DRF bases) and the TWDXCPRTC RTC cartridge in a Compact base.

### Installing a Cartridge in a Compact Base

The following procedure shows how to install the TWDXCPMFK32 memory, the TWDXCPMFK64 memory (only for TWDLC••40DRF bases) or the TWDXCPRTC RTC cartridge in a Compact base. Only one of these cartridges can be installed in the Compact base.

**NOTE:** The cartridge electrical elements are sensitive to static electricity.


## ⚠ CAUTION

### INOPERABLE EQUIPMENT

Do not touch cartridge pins. Use proper Electrically Sensitive Device (ESD) procedures when handling cartridge.

**Failure to follow these instructions can result in injury or equipment damage.**

Step	Action
1	Open bottom terminal cover.
2	Remove the cartridge cover.
3	Push the cartridge into the cartridge connector until it "clicks".
4	Close the terminal cover.

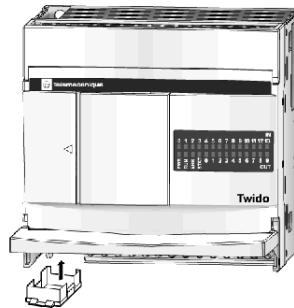

## How to Connect the Power Supply to Compact Bases

### Introduction

This section describes how to connect the power supply to the Compact bases.

**NOTE:** When operating outside of the specified voltage range, outputs may not switch accordingly. Use appropriate safety interlocks and voltage monitoring circuits.

### **⚠ CAUTION**


#### **INCOMPATIBLE OR IMPROPER POWER SUPPLY CONNECTIONS**

- Verify that proper voltage and frequency is applied to the device.
- Verify that you have made proper lead connections to the power supply terminal block.

**Failure to follow these instructions can result in injury or equipment damage.**


### Connect an AC Power Supply to a Compact Base

The following diagram shows how to connect an AC power supply to a TWDLCA\*\*\*DRF series Compact Base.

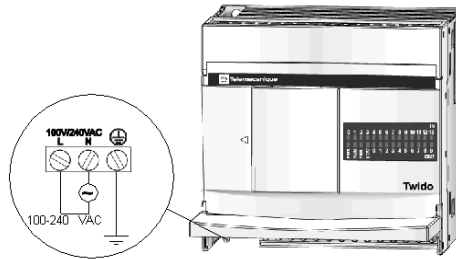

## Connect a DC Power Supply to a Compact Base

The following diagram shows how to connect a DC power supply to a TWDLCD•••DRF series Compact Base.

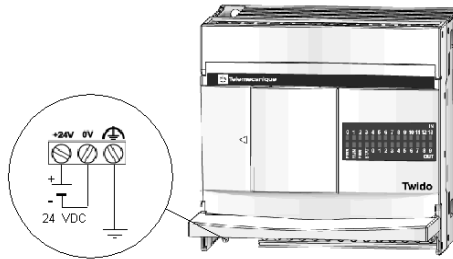

## Compact Base Power Supply Specifications

The following table provides power supply information for the Compact base.

Item	AC Specifications	DC Specifications
Power supply voltage	Rated power voltage: from 100 to 240 VAC	Rated power voltage: 24 VDC
	Allowable range: from 85 to 264 VAC	Allowable range: from 19.2 to 30 VDC
	The detection of the absence of a power supply depends on the number of inputs and outputs used. Usually the absence of a power supply is detected when voltage drops to less than 85 VAC, stopping the current operation.	The detection of the absence of a power supply depends on the number of inputs and outputs used. Usually the absence of a power supply is detected when voltage drops to below 14 VDC, stopping the current operation.
	<b>Note:</b> Momentary power interruption for 20 ms or less at 100 to 240 VAC is not recognized as a loss of power.	<b>Note:</b> Momentary power interruption for 10 ms or less at 24 VDC is not recognized as a loss of power.
Inrush current flow at power-up	TWDLCAA10DRF and TWDLCAA16DRF: 35 A maximum TWDLCAA24DRF: 40 A maximum	TWDLCD•40DRF: 60 A maximum
Power supply wiring	0.64 mm <sup>2</sup> (UL1015 AWG22) or 1.02 mm <sup>2</sup> (UL1007 AWG18) Make the power supply wiring as short as possible.	
Ground wiring	1.30 mm <sup>2</sup> (UL1007 AWG16) Do not connect ground wire in common with ground wire of motor equipment.	

## How to Install and Replace an External Battery

**NOTE:** The following information about the external battery applies to TWDLC••40DRF series compact bases only. If you have another compact base model, you may skip this section.

### Introduction

In addition to the built-in internal battery used for RAM backup, all TWDLC••40DRF compact bases are equipped with a battery compartment that can host a user-replaceable external battery. Note that for most applications, no external battery is required.

The external battery option provides extended backup duration to meet the needs for long-term backup for specific applications, such as HAVC applications.

### Battery Type

Your compact base uses one 1/2 AA, 3.6 V, lithium battery to provide optional extended data storage duration of up to 3 years.

**NOTE:** The external battery is not included with your Twido base and is purchased separately. Please use part number TSXPLP01 to order a single battery or TSXPLP101 to order a 10 pack.

### Safe Battery Disposal

The TWDLC••40DRF compact bases use an optional external lithium battery for longer duration of data backup. (Note: The lithium battery is not supplied with the compact base and is purchased separately.)

### **WARNING**

#### **FIRE OR CHEMICAL HAZARD**

The Lithium batteries used in this device may present a risk of fire or chemical burn if not handled properly

- Do not recharge, disassemble, heat above 212 °F (100 °C), or incinerate.
- Recycle or properly dispose of used batteries.
- Replace with identical type: TSXPLP01 (Tadiran, TL-5902) only.
- Follow all battery manufacturers' instructions.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

## Battery Power Status

The BAT LED indicator located on the front panel of your Twido compact base is used as an indicator for low battery alert. The BAT LED state is described in the following table:

LED State	Description
Off	Indicates that either: <ul style="list-style-type: none"> <li>the external battery is functioning normally, or</li> <li>the BAT LED has been disabled by user by setting the %S66 system bit to 1.</li> </ul>
Steady red	Indicates that either: <ul style="list-style-type: none"> <li>the power of the external battery is low (voltage below 2.5V) (The external battery must be replaced within two weeks from the date the BAT LED was first lit.), or</li> <li>there is no external battery installed in the battery compartment.</li> </ul>

## Battery Installation Requirements

When installing or replacing the external battery, verify that the following two conditions are met:


1. The internal battery of your Twido compact base must be fully charged.
2. After installing the external battery, power up your Twido base immediately.

**NOTE:** Not meeting either of the above two conditions will result in a significantly shorter battery life. The external battery life can be rapidly reduced to less than one month.

## Installing and Replacing an External Battery

The battery compartment is located on the lower-panel of the Twido compact base case. To install or replace an external battery, follow these steps:

Step	Action
1	Before installing or replacing the external battery, verify that the internal battery of your Twido base is fully charged so that the data stored in RAM memory are not lost when the external battery is removed from its compartment.
2	Press sideways on the small latch protruding from the compartment cover to unlock the door of the battery compartment.

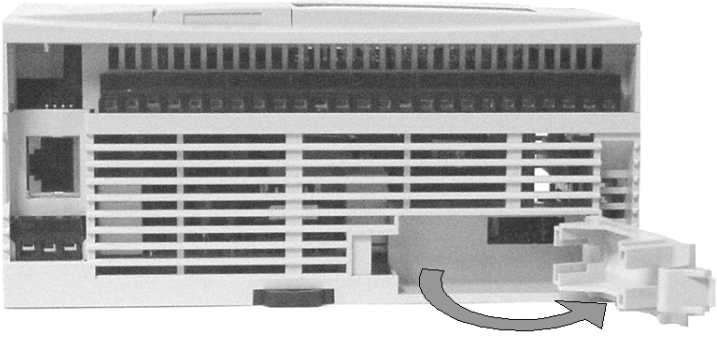Step	Action
3	<p>Pull to open the compartment door, as shown in the figure below:</p> 
4	Remove the used battery from the compartment, if any.
5	Insert the new battery in the compartment, observing the correct polarity, as indicated by the polarity marking located inside the battery compartment.
6	Close the door of the battery compartment (verify the latch clicks into place to lock the compartment door).
7	Power up your Twido base immediately to preserve battery life.

### Battery Status Monitoring and Control via System Bits

The following information describes how the battery status can be monitored and how the battery LED management can be controlled via two system bits %S75 and %S66, respectively:

System Bit	Description
%S75	<p>This is a read-only system bit that indicates the current battery status:</p> <ul style="list-style-type: none"> <li>● %S75 = 0: external battery is operating normally.</li> <li>● %S75 = 1: external battery power is low, or battery is absent from compartment.</li> </ul>
%S66	<p>This system bit is writable and allows you to turn on/off the BAT LED:</p> <ul style="list-style-type: none"> <li>● Set this bit to 1 to disable the BAT LED (LED is off even if there is no battery inside the compartment).</li> <li>● Set this bit to 0 to enable the BAT LED indicator. Note that the %S66 system bit is reset to 0 as default at system start-up.</li> </ul>

---

## 2.3 Modular Bases Installation

---

### Introduction

This section provides Information about installing Modular bases.

### What's in this Section?

This section contains the following topics:

Topic	Page
Dimensions for the Modular Controllers	64
How to Direct Mount a Modular Base on a Panel Surface	66
How to Install and Remove a Modular Base from a DIN Rail	67
How to Install the Operator Display Expansion Module	69
How to Install a Serial Interface Adapter to Modular Bases	70
How to Install a Second Serial Interface Expansion Module to a Modular Base	71
Removing a Terminal Block	74
How to Install a Memory or RTC Cartridge in a Modular Base	75
How to Connect the Power Supply to Modular Bases	76


## Dimensions for the Modular Controllers

### Introduction

The following section shows the dimensions for all Modular controllers.


### TWDLMDA20-DRT Dimensions

The following diagrams show the dimensions for the TWDLMDA20DRT Modular base.

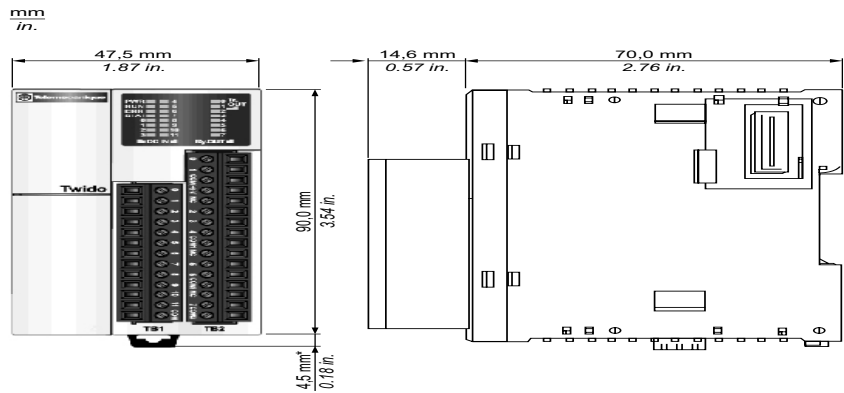

### TWDLMDA20-DUK and TWDLMDA20-DTK Dimensions


The following diagrams show the dimensions for the TWDLMDA20DUK and TWDLMDA20DTK Modular bases.

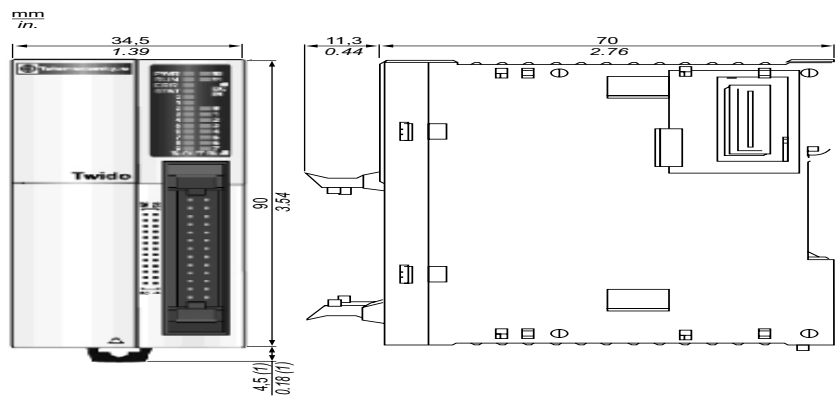



**TWDLMDA40-DUK and TWDLMDA40-DTK Dimensions**

The following diagrams show the dimensions for the TWDLMDA40DUK and TWDLMDA40DTK Modular bases.

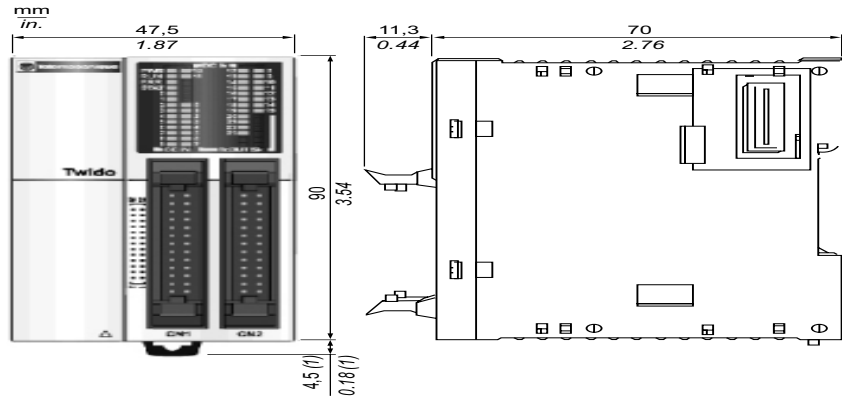

**NOTE:** \* 8.5 mm (0.33 in) when the clamp is pulled out.

## How to Direct Mount a Modular Base on a Panel Surface

### Introduction

This section shows how to install mounting strips directly on modular bases. This section also provides mounting hole layouts for modular bases. Your base may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.


### Installing a Mounting Strip

The following procedure shows how to install a mounting strip.

Step	Action
1	Remove the clamp from the back side of the module by pushing the clamp inward.
2	Insert the mounting strip, with the hook entering last, into the slot where the clamp was removed.
3	Slide the mounting strip into the slot until the hook enters into the recess in the module.

### Mounting Hole Layout for Modular Bases

The following diagram shows the mounting hole layout for all the Modular bases.

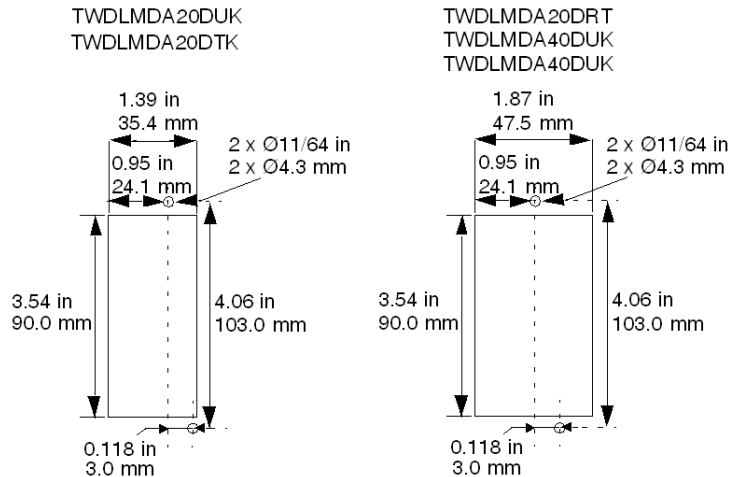

## How to Install and Remove a Modular Base from a DIN Rail

### Introduction



This section describes how to install and remove modular base from a DIN rail. The device you want to install or remove may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.

**NOTE:** When mounting modular bases on a DIN rail, use two end stops, type AB1-AB8P35 or equivalent.

For additional information about the DIN rail, see *The DIN Rail*. *The DIN Rail*, page 227

### How to Install a Modular Base on a DIN Rail



The following procedure shows how to install a Modular base on a DIN rail.

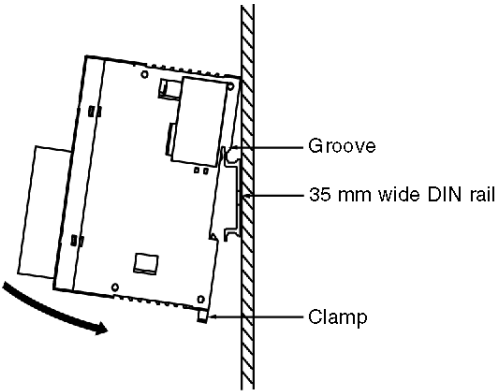Step	Action
1	Fasten the DIN rail to a panel using screws.
2	Pull out the clamp at the bottom of the modular base and module assembly. 
3	Put the top groove of the modular base and module on the DIN rail and press the modules toward the DIN rail. 

Step	Action
4	Push the clamp into the DIN rail.
5	Place mounting clips on both sides of the modules to help to minimize side-to-side movement of the system.

### How to Remove a Modular Base from a DIN Rail

The following procedure shows how to remove a modular base from a DIN rail.

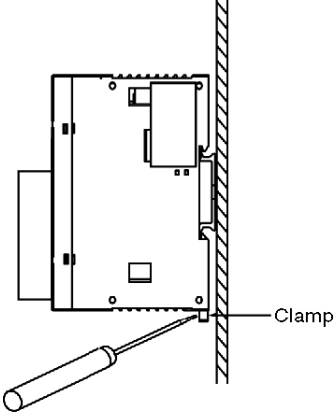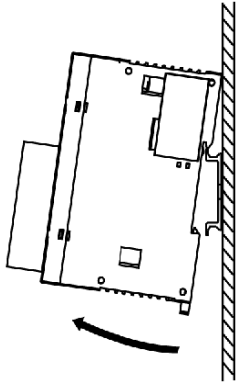Step	Action
1	Insert a flat screwdriver into the slot in the clamp. 
2	Pull out the clamp.
3	Pull the modular base and the associated module off the DIN rail from the bottom. 



## How to Install the Operator Display Expansion Module

### Introduction

This section describes the TWDXCPODM installation and removal of the operator display expansion module .

### Assembling the Operator Display Expansion Module to a Modular Base

The following procedure shows how to assemble the TWDXCPODM operator display expansion module to a Modular base.

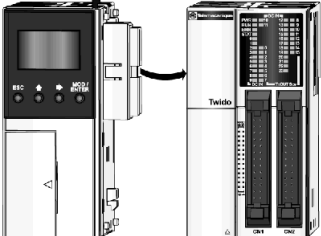Step	Action
1	Remove the communication connector cover on the left side of the Modular base.
2	Verify that the black latch button on the operator display expansion module is in the up position. 
3	Align the connector opening on the left side of the Modular base to the connector on the right side of the operator display expansion module. 
4	Press the operator display expansion module to the Modular base until it "clicks" into place.
5	Push down the black latch button on the top of the operator display expansion module to lock the module to the Modular base.

### Disassembling an Operator Display Expansion Module from a Modular Base

To remove the TWDXCPODM operator display expansion module from a Modular base, see *Disassembling an Expansion I/O Module from a Base, page 44*.


## How to Install a Serial Interface Adapter to Modular Bases

### Introduction

This section shows how to install the TWDNAC232D, TWDNAC485D or TWDNAC485T serial interface adapter in a TWDXCPODM operator display expansion module. Your base may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.

### How to Install a Serial interface Adapter in the Operator Display Expansion Module

The following procedure shows how to install the TWDNAC232D, TWDNAC485D, or TWDNAC485T serial interface adapter in a TWDXCPODM operator display expansion module.

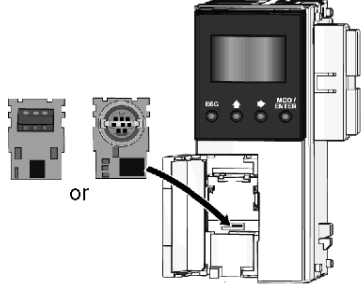Step	Action
1	Open the hinged lid.
2	Push the serial interface adapter connector into the operator display expansion module connector until it "clicks". 
3	Close the hinged lid.

## How to Install a Second Serial Interface Expansion Module to a Modular Base


### Introduction

This section shows how to assemble the TWDNOZ232D, TWDNOZ485D, and TWDNOZ485T second serial interface expansion module to a Modular base. Your base may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.

### Assembling a Second Serial Interface Expansion Module to a Modular Base

The following procedure shows how to assemble the TWDNOZ485D, TWDNOZ232D, or TWDNOZ485T second serial interface expansion module to a Modular base.



Step	Action
1	Remove the communication connector cover on the left side of the Modular base.
2	Verify that the black latch button on the second serial interface expansion module is in the up position.
3	Align the connector opening on the left side of the Modular base to the connector on the right side of the second serial interface expansion module.

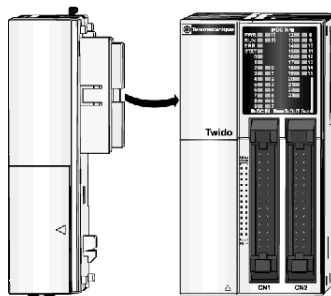

Step	Action
4	Press the second serial interface expansion module to the Modular base until it "clicks" into place.
5	Push down the black latch button on the top of the second serial interface expansion module to lock the module to the Modular base.

### Installing a Second Serial Interface Expansion Module with Operator Display

The following procedure shows how to assemble the TWDNOZO485D, TWDNOZO232D, or TWDNOZO485T second serial interface expansion module to a Modular base.

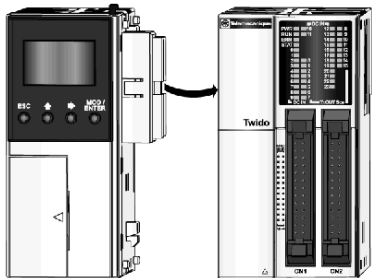
Step	Action
1	Remove the communication connector cover on the left side of the Modular base.
2	Verify that the black latch button on the operator display expansion module is in the up position. 
3	Align the connector opening on the left side of the Modular base to the connector on the right side of the operator display expansion module. 
4	Press the operator display expansion module to the Modular base until it "clicks" into place.
5	Push down the black latch button on the top of the operator display expansion module to lock the module to the Modular base.



## Second Serial Interface Expansion Module Dimensions

The following diagram shows the dimensions for all second serial interface expansion modules (TWDNOZ232D, TWDNOZ485T, and TWDNOZ485D).

Illustration of the TWDNOZ485T module:

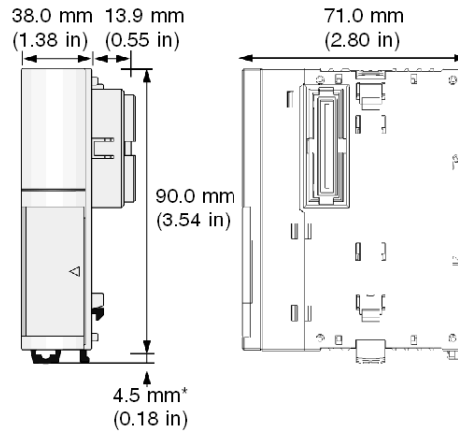

## Removing a Terminal Block

### Introduction

This section shows how to remove a terminal block from the TWDLMDA20DRT Modular base.

### Removing a Terminal Block



The following procedure shows how to remove a terminal block from the TWDLMDA20DRT Modular base.

## ⚠ CAUTION

### TERMINAL BLOCK DAMAGE

Do not pull the terminal block out from the top or bottom of the block.

**Failure to follow these instructions can result in injury or equipment damage.**

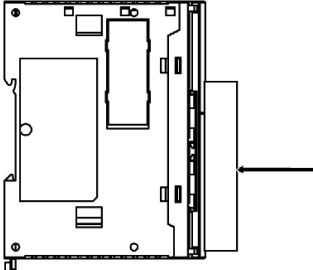Step	Action
1	<p>Power off to the Modular base and disconnect all wires.</p> <p><b>Note:</b> The terminal block on the left (1) must be removed before the terminal block on the right (2).</p>  <p>The diagram shows a vertical terminal block assembly. On the left side, there is a terminal block labeled '1'. On the right side, there is another terminal block labeled '2'. The assembly is mounted on a base with terminals labeled 'TB1' and 'TB2'. The word 'Twido' is printed on the left side of the assembly.</p>
2	<p>Remove the terminal block by holding the center of the terminal block and pulling it out straight.</p>  <p>The diagram shows a top-down view of the terminal block assembly. A terminal block is being pulled out from the right side of the base. An arrow points to the right, indicating the direction of removal.</p>

## How to Install a Memory or RTC Cartridge in a Modular Base

### Introduction

This section shows how to install the TWDXCMPFK32 or TWDXCMPFK64 memory cartridge in a Modular base, and the TWDXCPRTC RTC cartridge in a Modular base.

### Installing a Cartridge in a Modular Base


The following procedure shows how to install the TWDXCMPFK32 or TWDXCMPFK64 memory cartridge or the TWDXCPRTC RTC cartridge in a Modular base. Only one RTC cartridge can be installed. A memory cartridge and a RTC cartridge can be installed at the same time.

## ⚠ CAUTION

### INOPERABLE EQUIPMENT

Do not touch cartridge pins. Use proper Electrically Sensitive Device (ESD) procedures when handling cartridge.

**Failure to follow these instructions can result in injury or equipment damage.**

Step	Action
1	Open the hinged door.
2	Remove the cartridge cover by holding and pulling the opposite edges of the cover until it is out.
3	Push the cartridge into the Modular base connector until it "clicks".
	
4	Close the hinged door.

## How to Connect the Power Supply to Modular Bases

### Introduction

This section describes how to connect the power supply to the Modular bases.

**NOTE:** When operating outside of the specified voltage range, outputs may not switch as expected. Use appropriate interlocks and voltage monitoring circuits.

### **⚠ CAUTION**


#### **INCOMPATIBLE OR IMPROPER POWER SUPPLY CONNECTIONS**

- Verify that proper voltage and frequency is applied to the device.
- Verify that you have made proper lead connections to the power supply terminal block.

**Failure to follow these instructions can result in injury or equipment damage.**

### Connect a Power Supply to a Modular Base

The following diagram shows how to connect a power supply to a Modular Base.

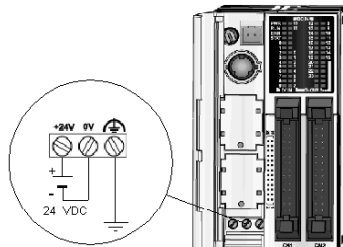

## Modular Base Power Supply Specifications

The following table provides power supply information for the Modular base.

Item	Specifications
Power supply voltage	Rated power voltage: 24 VDC Allowable range: from 20.4 to 26.4 VDC The detection of the absence of a power supply depends on the number of inputs and outputs used. Usually the absence of a power supply is detected when voltage drops to below 20.4 VDC, stopping the current operation. <b>Note:</b> Momentary power interruption for 10 ms or less at 24 VDC is not recognized as a loss of power.
Inrush current flow at power-up	50 A maximum
Power supply wiring	0.64 mm <sup>2</sup> (UL1015 AWG22) or 1.02 mm <sup>2</sup> (UL1007 AWG18) Make the power supply wiring as short as possible.
Ground wiring	0.64 mm <sup>2</sup> (UL1015 AWG22) or 1.02 mm <sup>2</sup> (UL1007 AWG18) Do not connect ground wire in common with ground wire of motor equipment.



---

# Description of Compact Bases

# 3

---

## Introduction

This chapter provides descriptions, overviews, parts, specifications, wiring rules and recommendations, and wiring schematics for the Twido Compact Bases.

## What's in this Chapter?

This chapter contains the following sections:

Section	Topic	Page
3.1	Compact Bases Description	80
3.2	Specifications for Compact Bases	87
3.3	Wiring Rules and Recommendations, and Wiring Schematics for Compact Bases	102
3.4	Compact Bases Options	112

## 3.1 Compact Bases Description

---

### Introduction

This section provides an overview and a parts description of the Compact bases.

### What's in this Section?

This section contains the following topics:

Topic	Page
Overview of Compact Bases	81
Parts Description of a Compact Base	85



## Overview of Compact Bases

### Introduction

The information in this section describes the main features of the Compact bases.


### Compact Controllers Features Overview

The following table gives information about the main features of the different types of Compact controllers:

Features	10 I/O bases: TWDLCAA10DRF TWDLCDA10DRF	16 I/O bases: TWDLCAA16DRF TWDLCDA16DRF	24 I/O bases: TWDLCAA24DRF TWDLCDA24DRF	40 I/O bases: TWDLCAA40DRF TWDLCAE40DRF TWDLCDA40DRF TWDLCDE40DRF
Inputs	6 discrete inputs	9 discrete inputs	14 discrete inputs	24 discrete inputs
Outputs	4 relay outputs	7 relay outputs	10 relay outputs	14 relay and 2 transistor outputs
Analog Potentiometers	1	1	2	2
Integrated Serial Port	√	√	√	√
Additional Serial Port	No	one slot available	one slot available	one slot available
RTC cartridge (optional)	√	√	√	RTC onboard
Memory cartridge (optional)	32 KB	32 KB	32 KB	32 KB or 64 KB
Battery Compartment	No	No	No	√
Expansion I/O Modules	No	No	up to 4 modules	up to 7 modules
AS-I V2 bus Modules	No	No	up to 2 modules	up to 2 modules
CANopen fieldbus Module	No	No	√	√
Operator Display Module (optional)	√	√	√	√
Ethernet interface	1 ConneXium TwidoPort module	1 ConneXium TwidoPort module	1 ConneXium TwidoPort module	For TWDLC•A40DRF: 1 ConneXium TwidoPort module For TWDLC•E40DRF: 1 Built-in RJ45 port


### Illustration of Compact 10 I/O Controllers

The following illustration gives a picture of the two types of 10 I/O Compact controllers:

Controller References	Illustration
TWDLCAA10DRF TWDLCA10DRF Note: Power supply: <ul style="list-style-type: none"> <li>● 100/240 VAC for theTWDLCAA10DRF</li> <li>● 24 VDC for theTWDLCA10DRF</li> </ul>	TWDLCAA10DRF TWDLCA10DRF 


### Illustration of Compact 16 I/O Controllers

The following illustration gives a picture of the two types of 16 I/O Compact controllers:

Controller References	Illustration
TWDLCAA16DRF TWDLCA16DRF Note: Power supply: <ul style="list-style-type: none"> <li>● 100/240 VAC for theTWDLCAA16DRF</li> <li>● 24 VDC for theTWDLCA16DRF</li> </ul>	TWDLCAA16DRF TWDLCA16DRF 



## Illustration of Compact 24 I/O Controllers

The following illustration gives a picture of the two types of 24 I/O Compact controllers:

Controller References	Illustration
TWDLCAA24DRF TWDLCA24DRF Note: Power supply: <ul style="list-style-type: none"> <li>● 100/240 VAC for theTWDLCAA24DRF</li> <li>● 24 VDC for theTWDLCA24DRF</li> </ul>	TWDLCAA24DRF TWDLCA24DRF 

### Illustration of Compact 40 I/O Controllers

The following illustration gives a picture of the two types of 40 I/O Compact controllers:

Controller References	Illustration
<p>TWDLCAA40DRF                      TWLDCDA40DRF                      TWDLCAE40DRF                      TWLDCDE40DRF</p> <p>Note: Power supply:</p> <ul style="list-style-type: none"> <li>● 100/240 VAC for the TWDLCA•40DRF</li> <li>● 24 VDC for the TWLDCD•40DRF</li> </ul>	<p>TWDLCAA24DRF                      TWLDCDA24DRF</p>  <p>TWDLCE40DRF</p> 


## Parts Description of a Compact Base

### Introduction

The following section describes the parts of a Compact base. Your base may differ from the illustrations but the parts will be the same.

### Parts Description of a Compact Base

The following figure shows the parts of a Compact base. This figure is the TWDLCAA24DRF base.

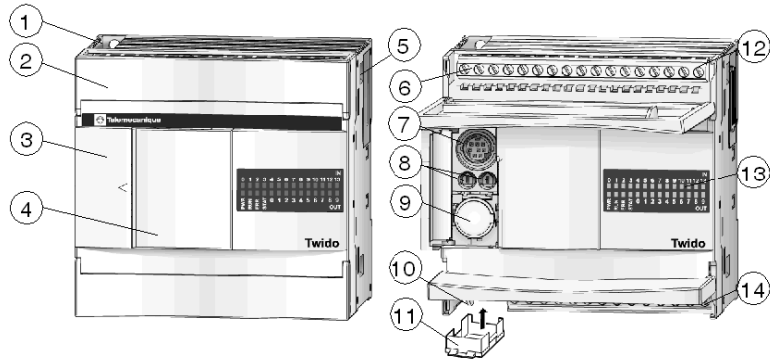


### Caption

Label	Description
1	Mounting hole
2	Terminal cover
3	Hinged lid
4	Removable cover to operator display connector
5	Expansion connector - On both 24DRF and 40DRF series compact bases
6	Sensor power terminals
7	Serial port 1
8	Analog potentiometers - TWDLCAA10DRF and TWDLCAA16DRF have one
9	Serial port 2 connector - TWDLCAA10DRF does not have any
10	100-240 VAC power supply terminals on TWDLCA***DRF series 24 VDC power supply terminals on TWDLCD***DRF series
11	Cartridge connector - located on the bottom of the base
12	Input terminals

Label	Description
13	LEDs
14	Output terminals

### Rear Panel of a 40DRF Compact Base

The following figure shows the rear panel of a 40 I/O Compact base. This figure is the TWDLCAE40DRF base.

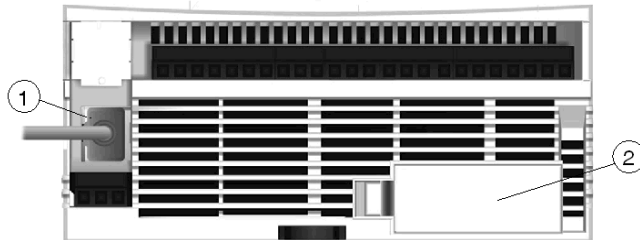

### Caption

Label	Description
1	RJ45 100Base-TX Ethernet port (only TWDLCAE40DRF has one)
2	External user-replaceable battery compartment (both TWDLCAA40DRF and TWDLCAE40DRF have one)

---

## 3.2 Specifications for Compact Bases

---

### Introduction

This section provides general, electrical, I/O, and functional specifications, and Analog Potentiometers description for Compact bases.

### What's in this Section?

This section contains the following topics:

<b>Topic</b>	<b>Page</b>
General Specifications for the Compact Bases	88
Electrical Specifications for the Compact Bases	90
Input Specifications for the Compact Base	93
Relay Output Specifications for the Compact Base	95
Output Transistor Specifications for the Compact Base	97
Description of Analog Potentiometers	99
Functional Specifications for the Compact Bases	100

## General Specifications for the Compact Bases

### Introduction

This section provides general specifications for the Compact bases. The Twido compact base is certified to CISPR.

### TWDLCA•40DRF

<b>⚠ WARNING</b>
<b>ELECTROMAGNETIC EMISSION</b>
Class A equipment is intended for use in industrial environments. Compliance with 5.1.2/CISPR11 for electromagnetic compatibility in other than industrial environments may need to be verified.
<b>Failure to follow these instructions can result in death, serious injury, or equipment damage.</b>

### Normal Operating Specifications

Compact base TWDLCA...	AA10DRF DA10DRF	AA16DRF DA16DRF	AA24DRF DA24DRF	AA40DRF AE40DRF DA40DRF DE40DRF
Ambient operating temperature	0 to 55°C (32°F to 131°F)			0 to 55°C (32°F to 131°F) at 75% load 0 to 45°C (32°F to 113°F) at full load
Storage temperature	-25°C to +70°C (-13°F to 158°F)			
Relative humidity	Level RH1, 30 to 95% (non-condensing)			
Degree of pollution	2 (IEC60664)			
Degree of protection	IP20			
Corrosion immunity	Free from corrosive gases			
Altitude	Operation: 0 to 2,000 m (0 to 6,560 ft) Transport: 0 to 3,000 m (0 to 9,840 ft)			
Resistance to vibration	When mounted on a DIN rail: 10 to 57 Hz amplitude 0.075 mm, 57 to 150 Hz acceleration 9.8 ms <sup>2</sup> (1G), 2 hours per axis on each of three mutually perpendicular axes. When mounted on a panel surface: 2 to 25 Hz amplitude 1.6 mm, 25 to 100 Hz acceleration 39.2 ms <sup>2</sup> (4G) Lloyd's 90 min per axis on each of three mutually perpendicular axes.			



<b>Compact base TWDLC...</b>	<b>AA10DRF DA10DRF</b>	<b>AA16DRF DA16DRF</b>	<b>AA24DRF DA24DRF</b>	<b>AA40DRF AE40DRF DA40DRF DE40DRF</b>
Impact strength	147 ms <sup>2</sup> (15G), 11 ms duration, 3 shocks per axis, on three mutually perpendicular axes (IEC 61131)			
Weight	230 g (8.11 oz)	250 g (8.81 oz)	305 g (10.75 oz)	522 g (18.4 oz)

### Specifications for the Backup Internal Battery

All compact base controllers have one non-removable internal battery

<b>Compact backed up elements</b>	<b>Internal RAM: internal variables, internal bits and words, timers, counters, shift registers, etc.</b>
Time	Approximately 30 days at 25°C (77°F) after battery fully charged.
Battery type	Non-interchangeable lithium accumulator
Charging time	Approximately 15 hours for 0% to 90 % of total load
Service life	10 years

### Specifications for the Backup External Battery

Only TWDLCA•40DRF and TWDLCD•40DRF series compact bases have one external battery compartment.

<b>Compact backed up elements</b>	<b>Internal RAM: internal variables, internal bits and words, timers, counters, shift registers, etc.</b>
Time	Approximately 3 years at 25°C (77°F) under following conditions: <ul style="list-style-type: none"> <li>● Internal backup battery is fully charged.</li> <li>● The Twido compact base is constantly powered. It has had no (or minor) down-time.</li> </ul>
Battery type	½ AA, 3.6V, lithium battery Part number TSXPLP01 (Tadiran, TL-5902) Note that the external battery must be purchased separately by user. No external battery is included with the Twido controller package.

## Electrical Specifications for the Compact Bases

### Introduction

This section provides electrical specifications for the Compact bases. The Twido compact base is certified to CISPR.

### TWDLCA•40DRF

<b>⚠ WARNING</b>
<b>ELECTROMAGNETIC EMISSION WARNING (5.1.2/CISPR11)</b>
Class A equipment is intended for use in industrial environments. Compliance with 5.1.2/CISPR11 for electromagnetic compatibility in other than industrial environments may need to be verified.
<b>Failure to follow these instructions can result in death, serious injury, or equipment damage.</b>

### Electrical Specifications

Compact base TWDLCA...	AA10DRF	AA16DRF	AA24DRF	AA40DRF AE40DRF
Rated power voltage	100 to 240 VAC			
Allowable voltage range	85 to 264 VAC			
Rated power frequency	50/60 Hz (47 to 63 Hz)			
Maximum input current	0.25 A (85 VAC)	0.30 A (85 VAC)	0.45 A (85 VAC)	0.79 A (85 VAC)
Maximum power consumption	30 VA (264 VAC), 20 VA (100 VAC) This base power consumption includes 250 mA sensor power.	31 VA (264 VAC), 22 VA (100 VAC) This base power consumption includes 250 mA sensor power.	40 VA (264 VAC), 33 VA (100 VAC) This base plus 4 I/O modules power consumption includes 250 mA sensor power.	110 VA (264 VAC), 77 VA (100 VAC) This base plus 7 I/O modules power consumption includes 400 mA sensor power.
Allowable momentary power interruption	10 ms, 100% drop out (at the rated inputs and outputs) (IEC61131 and IEC61000-4-11)			
Dielectric strength	Between power and ground terminals: 1,500 VAC, 1 min Between I/O and ground terminals: 1,500 VAC, 1 min			
Insulation resistance	Between power and ground terminals: 10 MΩ minimum (500 VDC) Between I/O and ground terminals: 10 MΩ minimum (500 VDC)			

Compact base TWDLC...	AA10DRF	AA16DRF	AA24DRF	AA40DRF AE40DRF
Electromagnetic resistance	AC power terminals: 2kV, Level 3 I/O terminals: - DC: 1kV, Level 3 - AC: 2kV, Level 4 According to IEC61131-2 (Zone B) and IEC61000-4-4			
Inrush current	35 A maximum	35 A maximum	40 A maximum	35 A maximum
Ground wiring	UL1007 16 AWG (1.30 mm <sup>2</sup> )			
Power supply wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )			
Effect of improper power supply connection	Reverse polarity: normal operation Improper voltage or frequency: internal fuse protection			

Compact base TWDLC...	DA10DRF	DA16DRF	DA24DRF	DA40DRF DE40DRF
Rated power voltage	24 VDC			
Allowable voltage range	from 19.2 to 30 VDC (including ripple)			
Maximum input power	Base	Base	Base plus 4 I/O Modules	Base plus 7 I/O Modules
	3.9 W (@ 24 VDC)	4.6 W (@ 24 VDC)	5.6 W (@ 24 VDC)	30 W (@ 24 VDC)
Allowable momentary power interruption	10 ms, 100% drop out (at the rated inputs and outputs) (IEC61000-4-11)			
Dielectric strength Between power and ground terminals: Between I/O and ground terminals:	500 VAC, 1 min			1000 VAC, 1 min
	1500 VAC, 1 min			1500 VAC, 1 min
Insulation resistance	Between power and ground terminals: 10 M $\Omega$ minimum (500 VDC) Between I/O and ground terminals: 10 M $\Omega$ minimum (500 VDC)			
Electromagnetic resistance	AC power terminals: 2kV, Level 3 I/O terminals: - DC: 1kV, Level 3 - AC: 2kV, Level 4 According to IEC61131-2 (Zone B) and IEC61000-4-4			
Inrush current	35 A maximum (@ 24 VDC)	35 A maximum (@ 24 VDC)	40 A maximum (@ 24 VDC)	35 A maximum (@ 24 VDC)
Ground wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )			

Description of Compact Bases

---

<b>Compact base TWDLC...</b>	<b>DA10DRF</b>	<b>DA16DRF</b>	<b>DA24DRF</b>	<b>DA40DRF DE40DRF</b>
Power supply wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )			
Effect of improper power supply connection	Reverse polarity: no operation, no damage Improper voltage or frequency: internal fuse protection			

## Input Specifications for the Compact Base

### Introduction

This section provides Input specifications for the Compact bases.

### DC Input Specifications

#### WARNING

##### UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified below.


**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

Compact base	TWDLCAA10DRF TWDLCAA10DRF	TWDLCAA16DRF TWDLCAA16DRF	TWDLCAA24DRF TWDLCAA24DRF	TWDLCAA40DRF TWDLCAA40DRF TWDLCAA40DRF TWDLCAA40DRF
Input points	6 points in 1 common line	9 points in 1 common line	14 points in 1 common line	24 points in 2 common lines
Rated input voltage	24 VDC sink/source input signal			
Input voltage range	from 20.4 to 28.8 VDC			
Rated input current	I0 and I1: 11 mA I2 to I13: 7 mA/point (24 VDC)		I0, I1, I6, I7: 11 mA I2 to I5, I8 to I23: 7 mA/point (24 VDC)	
Input impedance	I0 and I1: 2.1 k $\Omega$ I2 to I13: 3.4 k $\Omega$		I0, I1, I6, I7: 2.1 k $\Omega$ I2 to I5, I8 to I23: 3.4 k $\Omega$	
Turn on time	I0 to I1: 35 $\mu$ s + filter value I2 to I13: 40 $\mu$ s + filter value		I0, I1, I6, I7: 35 $\mu$ s + filter value I2 to I5, I8 to I23: 40 $\mu$ s + filter value	
Turn off time	I0 and I1: 45 $\mu$ s + filter value I2 to I13: 150 $\mu$ s + filter value		I0, I1, I6, I7: 45 $\mu$ s + filter value I2 to I5, I8 to I23: 150 $\mu$ s + filter value	
Isolation	Between input terminals and internal circuit: photocoupler isolated (isolation protection up to 500 V) Between input terminals: not isolated			
Input type	Type 1 (IEC 61131)			

Compact base	TWDLCAA10DRF TWDLCAA16DRF	TWDLCAA16DRF TWDLCAA16DRF	TWDLCAA24DRF TWDLCAA24DRF	TWDLCAA40DRF TWDLCAA40DRF TWDLCAA40DRF TWDLCAA40DRF
External load for I/O interconnection	Not needed			
Signal determination method	Static			
Input signals type	The input signals can be both sink and source.			
Cable length	3m (9.84 ft) for compliance with electromagnetic immunity.			

### I/O Usage Limits

When using TWDLCA•AA16DRF, TWDLCA•A24DRF, TWDLCA•40DRF and TWDLCA•40DRF at an ambient temperature of 55°C (131°F) in the normal mounting direction, limit the inputs and outputs, respectively, which turn on simultaneously along line (1).

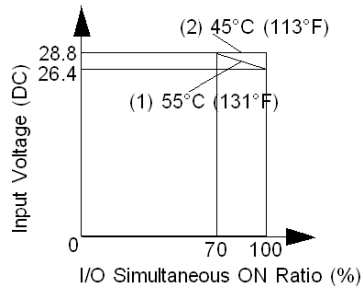

Also, when using the above-mentioned bases at 45°C (113°F), all I/O can be turned on simultaneously at input voltage 28.8 VDC as indicated by line (2).

## Relay Output Specifications for the Compact Base

### Introduction


This section provides relay output specifications for the Compact bases.

### Relay Output Specifications

Compact base	TWDLCAA10DRF TWDLCAA10DRF	TWDLCAA16DRF TWDLCAA16DRF	TWDLCAA24DRF TWDLCAA24DRF	TWDLCAA40DRF TWDLCAA40DRF
Output points	4 output	7 output	10 output	14 output
Output points per common line: COM0	3 NO contacts	4 Normally Open	4 NO contacts	—
Output points per common line: COM1	1 NO contact	2 NO contacts	4 NO contacts	—
Output points per common line: COM2	—	1 NO contact	1 NO contact	4 NO contact
Output points per common line: COM3	—	—	1 NO contact	4 NO contact
Output points per common line: COM4	—	—	—	4 NO contact
Output points per common line: COM5	—	—	—	1 NO contact
Output points per common line: COM6	—	—	—	1 NO contact
Maximum load current	2 A per output 8 A per common line			
Minimum switching load	0.1 mA/0.1 VDC (reference value)			
Initial contact resistance	30 mΩ maximum: @ 240VAC/2A load @ 30VDC/2A load			
Electrical life	100,000 operations minimum (rated resistive load 1,800 operations/h)			
Mechanical life	20,000,000 operations minimum (no load 18,000 operations/h)			
Rated load (resistive/inductive)	240 VAC/2 A, 30 VDC/2 A			
Dielectric strength	Between output to internal circuit: 1500 VAC, 1 min Between output groups: 1500 VAC, 1 min			


### Relay Output Contact

The relay output contact is shown below.

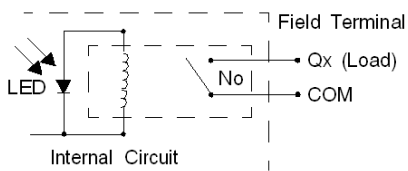

### Relay Output Delay

The relay output delay is shown below.

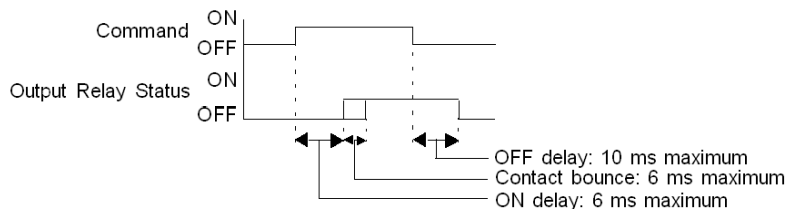



## Output Transistor Specifications for the Compact Base

### Introduction

This section provides Output transistor specifications for the Compact bases.

### Reverse Polarity Hazard

#### Reverse-Polarity at Transistor Output is Not Allowed

The TWDLC••40DRF compact bases transistor outputs cannot withstand any reverse polarity.

### CAUTION

#### RISK OF REVERSE-POLARITY DAMAGE AT TRANSISTOR OUTPUTS

- Conform to the polarity markings on the transistor output terminals.
- Use of a reverse polarity can permanently damage or destroy the output circuits.

**Failure to follow these instructions can result in injury or equipment damage.**


### Transistor Source Output Specifications

Compact base	TWDLC••40DRF bases
Output type	Source output
Number of discrete output points	2
Output points per common Line	1
Rated load voltage	24 VDC
Maximum load current	1 A per common line
Operating load voltage range	from 20.4 to 28.8 VDC
Voltage drop (on voltage)	1 V maximum (voltage between COM and output terminals when output is on)
Rated load current	1 A per output
Inrush current	2.5 A maximum
Leakage current	0.25 mA maximum
Maximum lamp load	19 W
Inductive load	L/R = 10 ms (28.8 VDC, 1 Hz)
External current draw	12 mA maximum, 24 VDC (power voltage at the +V terminal)

Compact base	TWDL••40DRF bases
Isolation	Between output terminal and internal circuit: photocoupler isolated (isolation protection up to 500 VDC) Between output terminals: 500 VDC
Output delay - turn on/off time	Q0, Q1: 5 $\mu$ s maximum ( $I \geq 5mA$ )

### Transistor Source Output Contact

The transistor source output contact applicable to TWDL••40DRF series compact bases is shown below.

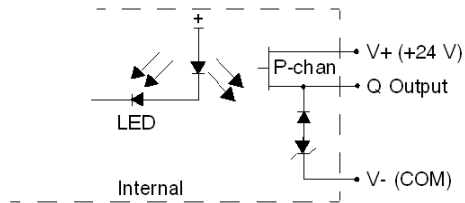

## Description of Analog Potentiometers

### Introduction

The following section describes the analog potentiometer on the Compact bases.

### Description


The TWDLC•A10DRF<sup>1</sup> and TWDLC•A16DRF<sup>1</sup> bases have one analog potentiometer. The TWDLC•A24DRF<sup>1</sup>, TWDLCA•40DRF<sup>2</sup> and TWDLCD•40DRF<sup>2</sup> bases have two analog potentiometers. The two analog potentiometers can be set to a value between 0 and 1023. The value is stored in a system word and is updated in every scan. For more information on setting the analog potentiometer, see the TwidoSuite Software Reference Manual.

#### NOTE:

1. • = D as in 24 VDC power supply
  - = A as in 110/240 VAC power supply
2. • = A as in standard model (no Ethernet port)
  - = E as in built-in Ethernet communications interface

### Analog Potentiometer on a Compact Base

The following figure shows the analog potentiometers on a TWDLC•A24DRF Compact base.

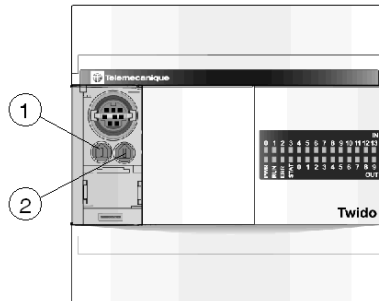

### Caption

Label	Description
1	Analog potentiometer 1
2	Analog potentiometer 2

## Functional Specifications for the Compact Bases

### Introduction

This section provides functional specifications for the Compact bases.

### Communication Function Specifications

Communication Port	Port 1 (RS485)	Port 2 (RS232C) Communication Adapter: TWDNAC232D	Port 2 (RS485) Communication Adapters: TWDNAC485D TWDNAC485T	Ethernet Port (RJ45) (TWDLCAE40DRF and TWDLCDE40DRF bases only)
Standards	RS485	RS232	RS485	100Base-TX, RJ45
Maximum baud rate	PC Link: 19,200 bps Remote Link: 38,400 bps	19,200 bps	PC Link: 19,200 bps Remote Link: 38,400 bps	100 Mbps, depending on network speed.
Modbus communication (RTU master/slave)	Possible	Possible	Possible	TCP/IP Modbus Client/Server
ASCII communication	Possible	Possible	Possible	-
Remote communication	7 links possible	Not possible	7 links possible	up to 16 remote nodes configured per base
Maximum cable length	Maximum distance between the base controller and the remote controller: 200 m (656 ft)	Maximum distance between the base controller and the remote controller: 10 m (32.8 ft)	Maximum distance between the base controller and the remote controller: 200 m (656 ft)	Maximum distance between network nodes (depending on network architecture)
Isolation between internal circuit and communication port	Not isolated	Not isolated	Not isolated	Isolated
Telephone communication	Possible Possible to connect from a receive only modem.	Not possible	Not possible	Not possible

**Built-in Function Specifications**

Sensor power supply	Output voltage/current	24 VDC (+10% to -15%), 250 mA max. current (For TWDLCA•40DRF, 400 mA max. current) (For TWDLCD•40DRF, 700 mA max. current)
	Overload detection	Short-circuit protection for TWDLCA•40DRF. Short-circuit and overload protection for TWDLCD•40DRF. Not available on all other bases.
	Isolation	Isolated from the internal circuit
Counting	Number of channels	4
	Frequency	For TWDLCA•40DRF and TWDLCD•40DRF: - 4 channels at 5kHz (FCi), - 2 channels at 20kHz (VFCi)  For all other bases: - 3 channels at 5kHz (FCi), - 1 channel at 20kHz (VFCi)
	Capacity	16 bits (0..65535 steps) 32 bits (0..4294967295 steps)
Analog potentiometers	1 adjustable from 0 through to 1023 steps	
	1 adjustable from 0 through to 1023 steps	
FCi: Fast Counter "i". VFCi: Very Fast Counter "i".		

## 3.3 Wiring Rules and Recommendations, and Wiring Schematics for Compact Bases

---

### Introduction

This section provides wiring rules and recommendations, and wiring schematics for Compact bases.

### What's in this Section?

This section contains the following topics:

Topic	Page
Wiring Rules and Recommendations for Compact Bases	103
Compact Base Wiring diagrams	107

## Wiring Rules and Recommendations for Compact Bases

### Introduction

There are several rules that must be followed when wiring a compact base. Recommendations, when needed, are provided on how to comply with the rules.

### DANGER

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Disconnect all power from all equipment including connected devices prior to removing any covers or doors, or installing or removing any accessories, hardware, cables, or wires except under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

**Failure to follow these instructions will result in death or serious injury.**

### WARNING

#### MALFUNCTION OF OUTPUTS

Use appropriate interlocks where personal and/or equipment hazards exist. Outputs can malfunction and remain ON or OFF.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

### Rules

- Each terminal accepts up to two 18 AWG (0.82 mm<sup>2</sup>) through 28 AWG (0.08 mm<sup>2</sup>) fitted with cable ends or tags.
- The power supply wire should be between 18 AWG (0.82 mm<sup>2</sup>) and 22 AWG (0.33 mm<sup>2</sup>). Use the shortest wire length possible.
- The grounding wire should be 16 AWG (1.30 mm<sup>2</sup>).
- Power supply wires routed inside the panel must be kept separate from power wires, I/O wiring and communication wiring. Route wiring in separate cable ducting.

- Verify that the operating conditions and environments are within the specification values.
- Use proper wire size to meet voltage and current requirements.


### Terminal Tightening Torque

Recommended tightening torque of terminal blocks is listed for all products on the product label.

### Input Operating Range

The input operating range of the Type 1 (IEC 61131-2) input module is shown below.

Inputs I0 and I1 <- (10, 16 and 24 I/O controllers) -> Inputs I0, I1, I6, I7  
 Inputs I0, I1, I6, I7 <- (40 I/O controllers) -> Inputs I2 to I5, I8 to I23

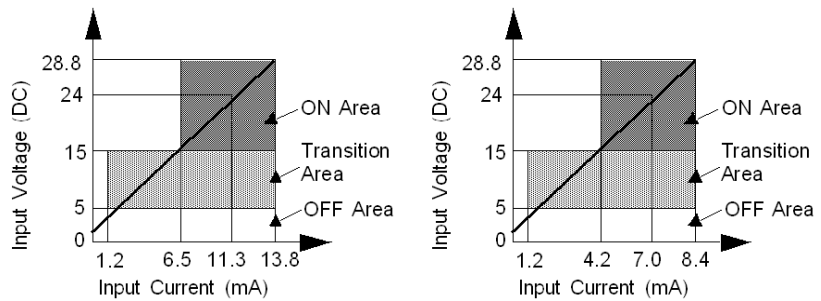


### Input Internal Circuit


The input internal circuit is shown below.

#### Latching or High Speed Sink or Source Inputs

Inputs I0 and I1 <- (10, 16 and 24 I/O controllers) -> Inputs I0, I1, I6, I7  
 Inputs I0, I1, I6, I7 <- (40 I/O controllers) -> Inputs I2 to I5, I8 to I23

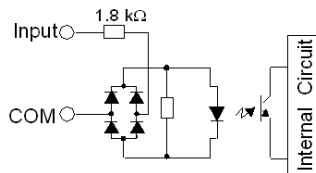

#### Standard Sink or Source Input






## Contact Protection Circuit for Relay and Transistor Outputs


Depending on the load, a protection circuit may be needed for the relay output on the bases. Choose a protection circuit, from the following diagrams, according to the power supply. Connect the protection circuit to the outside of the base or relay output module.

Protective circuit A: this protection circuit can be used when the load impedance is smaller than the RC impedance in an AC load power circuit.




- C represents a value from 0.1 to 1  $\mu\text{F}$ .
- R represents a resistor of approximately the same resistance value as the load.

Protective circuit B: this protection circuit can be used for both AC and DC load power circuits.



- C represents a value from 0.1 to 1  $\mu\text{F}$ .
- R represents a resistor of approximately the same resistance value as the load.


Protective circuit C: this protection circuit can be used for DC load power circuits.



Use a diode with the following ratings:


- Reverse withstand voltage: power voltage of the load circuit x 10.
- Forward current: more than the load current.

Protective circuit D: this protection circuit can be used for both AC and DC load power circuits.



### Explanation of Source Inputs/Sink Outputs


**NOTE: Sink** corresponds to the sensors' common on the (+) terminal of the power supply.

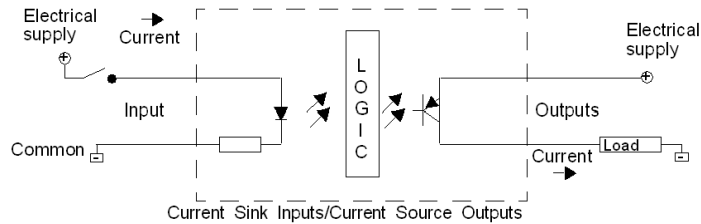

Input side COM field terminal connects to the "-" terminal or common of the field power supply. Output side COM field terminal connects to +24V field power supply.

### Explanation of Sink Inputs/Source Outputs

**NOTE: Source** corresponds to the sensors' common on the (-) terminal of the power supply.

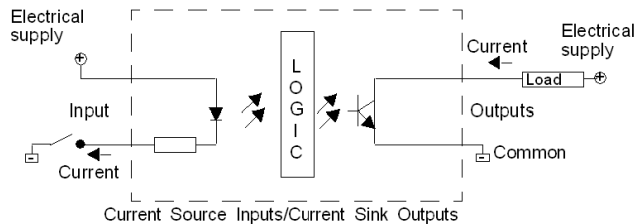

Input side COM field terminal connects to +24V field power supply. Output side COM field terminal connects to the "-" terminal or common of the field power supply.

## Compact Base Wiring diagrams

### Introduction

This section shows examples of wiring diagrams for Compact bases. Symbols used in the following diagrams are explained in the Glossary of Symbols (*see page 229*) in the appendix.

### DANGER

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Disconnect all power from all equipment including connected devices prior to removing any covers or doors, or installing or removing any accessories, hardware, cables, or wires except under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

**Failure to follow these instructions will result in death or serious injury.**

### CAUTION

#### RISK OF REVERSE-POLARITY DAMAGE AT TRANSISTOR OUTPUTS

- Observe the polarity markings on the transistor output terminals.
- Use of a reverse polarity can permanently damage or destroy the output circuits.


**Failure to follow these instructions can result in injury or equipment damage.**

**NOTE:** These diagrams are for external wiring only.

**NOTE:** The shaded boxes are markings on the base. The I and Q numbers are the input and output points.


### AC Power Supply Wiring Diagram

The following AC power supply wiring diagram is for the TWDLCA•••DRF series controllers.




### DC Power Supply Wiring Diagram

The following DC power supply wiring diagram is for the TWDLCD•••DRF series bases.




### DC Source Input Wiring Diagram

The following diagram is for the TWDLC•A10DRF, TWDLC•A16DRF, and TWDLC•A24DRF bases (external power).




The following schematic is for the TWDLC•A10DRF, TWDLC•A16DRF, and TWDLC•A24DRF bases (internal power).




- Max current: 250mA.

The following DC source input wiring diagram is for the TWDLC••40DRF series bases (external power).

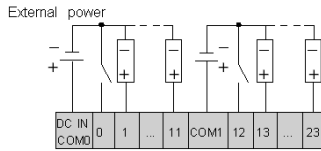


The following DC source input wiring diagram is for the TWDLC••40DRF series bases (internal power).

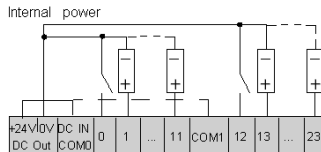


- Max current: 400mA.

## DC Sink Input Wiring Diagram

This wiring diagram is for the TWDLC•A10DRF, TWDLC•A16DRF, and TWDLC•A24DRF bases (external power).




This wiring diagram is for the TWDLC•A10DRF, TWDLC•A16DRF, and TWDLC•A24DRF bases (internal power).




- Max current: 250mA.

The following DC sink input wiring diagram is for the TWDLC••40DRF series controllers (external power).

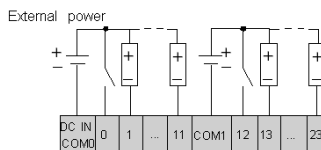


The following DC sink input wiring diagram is for the TWDLC••40DRF series controllers (internal power).

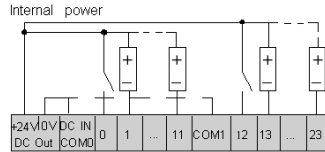


- Max current: 400mA.

### Relay and Transistor Output Wiring Diagram


This wiring diagram is the protection for inductive load:




This wiring diagram is for the TWDLC•A10DRF series bases.

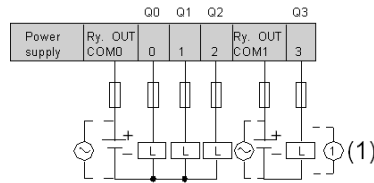


This wiring diagram is for the TWDLC•A16DRF series bases.

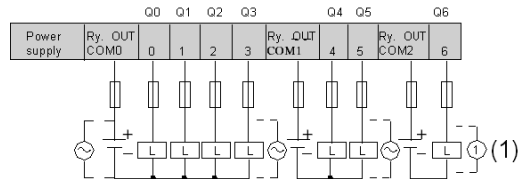

This wiring diagram is for the TWDLC•A24DRF series bases.

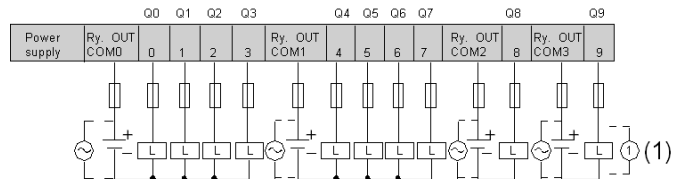

This wiring diagram is for the TWDLC••40DRF series bases.

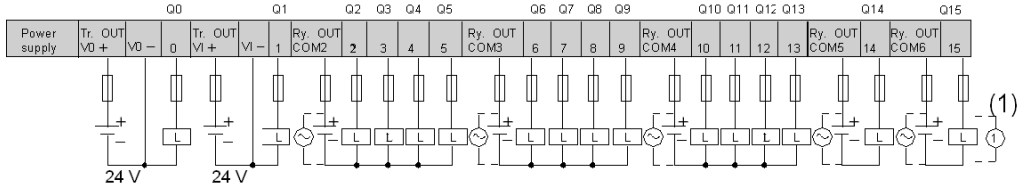

### Reverse-Polarity at Transistor Output is Not Allowed

The TWDLC••40DRF compact bases transistor outputs cannot withstand any reverse polarity.

## 3.4 Compact Bases Options

---

### Introduction

This section provides information about memory cartridges, RTC cartridges, operator display modules and input simulators as options for Compact bases.

### What's in this Section?

This section contains the following topics:

Topic	Page
Memory Cartridges	113
Real Time Clock (RTC) Cartridge	114
Operator Display Modules	115
Input Simulators	117



## Memory Cartridges

### Introduction

The following section provides an overview and specifications about the TWDXCPMFK32 and TWDXCPMFK64 memory cartridges, as options for the Compact bases.

### Overview of the Memory Cartridges

There are two optional memory cartridges, 32 KB (TWDXCPMFK32) and 64 KB (TWDXCPMFK64), available. The memory cartridges provide additional memory for application storage. The memory cartridges are used to:

- Provide a removable backup of the application.
- Load an application into a compact base if certain conditions exist.
- Increase the program memory capacity.

The following table presents the available memory cartridge for each compact base.

Memory Cartridge	Compact 10 I/O	Compact 16 I/O	Compact 24 I/O	Compact 40 I/O
TWDXCPMFK32	yes	yes	yes	yes
TWDXCPMFK64	no	no	no	yes

The TWDXCPMFK32 memory cartridge is for back up only. The TWDXCPMFK64 memory cartridge is for back up and expansion.

### Memory Cartridge Specifications

The following table describes the memory cartridge specifications.

Memory Type	EEPROM
Accessible memory capacity	32 KB: TWDXCPMFK32 64 KB: TWDXCPMFK64
Hardware for storing data	Twido base
Software for storing data	TwidoSuite
Quantity of stored programs	One user program is stored on one memory cartridge.
Program execution priority	When a memory cartridge is installed and enabled, the external user program will be loaded and executed if it differs from the internal program.

## Real Time Clock (RTC) Cartridge

### Introduction

This section provides an overview and specifications for the TWDXPRTC RTC cartridge, as an option for Compact bases.

### Overview of the Real Time Clock (RTC) Cartridge

An optional Real Time Clock cartridge (TWDXPRTC) is available for all compact bases. (Note that 40 I/O compact bases have RTC onboard)

The Real Time Clock cartridge provides the compact base with the current time and date.

The RTC is required for the Schedule Blocks to operate.

When the compact base is powered down, the Real Time Clock (RTC) will keep time for 1000 hours at 25 °C (77° F) or 300 hours at 55 °C (131° F) when using a fully charged battery.

### Real Time Clock Cartridge Specifications

The following table describes the Real Time Clock cartridge specifications.

<b>Accuracy</b>	<b>30 s/month (typical) at 25° C (77° F)</b>
Backup duration	Approximately 30 days (typical) at 25° C (77° F) after backup battery fully charged
Battery	Lithium secondary battery
Charging time	Approximately 10 hours for charging from 0% to 90% of full charge
Replaceable	Not possible

## Operator Display Modules

### Introduction

The following section provides an overview of the TWDXCPODC operator display module. This section also describes the parts, specifications and dimensions of the TWDXCPODC operator display module

### Overview

The operator display is an optional module that can be added to any of the compact bases. It is installed into a Compact base as an operator display module (TWDXCPODC). See *How to Install the Operator Display Module*, page 54.

The operator display provides the following services:


- Displays the controller state information
- Allows the user to control the base
- Allows the user to monitor and tune application data objects

The operator display has two states:

- Display state - Displays data
- Edit state - Allows the user to change data

### Parts Description of an Operator Display Module

The following figure shows the parts of the TWDXCPODC operator display module.




### Caption

Label	Part	Description
1	Display screen	Shows menus, operands, and data.
2	ESC button	In Edit state - Returns to the previous display state and rejects changes made by the user.
3	Up arrow button	In Edit state - Changes the current edit element to the next value.

Label	Part	Description
4	Right arrow button	In Display state - Advances to the next display state. In Edit state - Advances to the next editing element. The current editing element blinks.
5	MOD/ENTER button	In Display state - Works in MOD function, goes to the corresponding edit state. In Edit state - Works in ENTER function, returns to previous display state and accepts changes made by the user.
6	Operator display connector	Connects to the Compact base.

### Operator Display Module Dimensions

The following diagram shows the dimensions for the operator display module (TWDXCPODC).



### Operator Display Module Specifications

The following table describes the operator display module specifications.

Part Number	TWDXCPODC
Power voltage	5 VDC (supplied from the base)
Internal current draw	200 mA DC
Weight	20 g (0.7 oz)

## **Input Simulators**

### **Introduction**

The following section provides an overview of the TWDXSM6, TWDXSM9, and TWDXSM14 input simulators for compact bases.

### **Overview of the Input Simulators**

There are three input simulators: 6, 9, and 14 point. These are used only on the three Compact bases. Used for debugging, you can control the inputs to test your application logic.



---

# Description of Modular Bases



---

## Introduction

This chapter provides overviews, parts descriptions, specifications, wiring rules and recommendations, wiring schematics, and options for the Modular bases.

## What's in this Chapter?

This chapter contains the following sections:

Section	Topic	Page
4.1	Modular Bases Description	120
4.2	Modular Bases Specifications	124
4.3	Modular Bases Wiring	140
4.4	Modular Bases Options	150

## 4.1 Modular Bases Description

---

### Introduction

This section provides an overview and a parts description of the Modular bases.

### What's in this Section?

This section contains the following topics:

Topic	Page
Overview of Modular Controllers	121
Parts Description of a Modular Base	123



## Overview of Modular Controllers

### Introduction

The information in this section describes the main features of the Modular bases.


### Modular Bases Features Overview

The following table gives information about the main features of the different types of Modular bases:

Features	20 I/O bases: TWDLMDA20DTK TWDLMDA20DUK	20 I/O bases: TWDLMDA20DRT	40 I/O bases: TWDLMDA40DTK TWDLMDA40DUK
Inputs	12 discrete inputs	12 discrete inputs	24 discrete inputs
Outputs	8 transistor source outputs: TWDLMDA20DTK 8 transistor sink outputs: TWDLMDA20DUK	6 relay outputs + 2 transistor source outputs	16 transistor source outputs: TWDLMDA40DTK 16 transistor sink outputs: TWDLMDA40DUK
Analog Voltage Input Connector	1	1	1
Analog Potentiometers	1	1	1
Integrated Serial Port	√	√	√
Wiring	Connector	Terminal Block	Connector
RTC cartridge (optional)	√	√	√
Memory cartridge (optional)	32 KB / 64 KB	32 KB / 64 KB	32 KB / 64 KB
Expansion I/O Modules	up to 4 modules	up to 7 modules	up to 7 modules
AS-I V2 bus Modules	up to 2 modules	up to 2 modules	up to 2 modules
CANopen fieldbus Module	√	√	√
Operator Display Expansion Module (optional)	√	√	√
Communication Expansion Module (optional)	√	√	√
Ethernet interface	1 ConneXium TwidoPort module	1 ConneXium TwidoPort module	1 ConneXium TwidoPort module

## Illustrations

The following illustrations are the Modular bases:

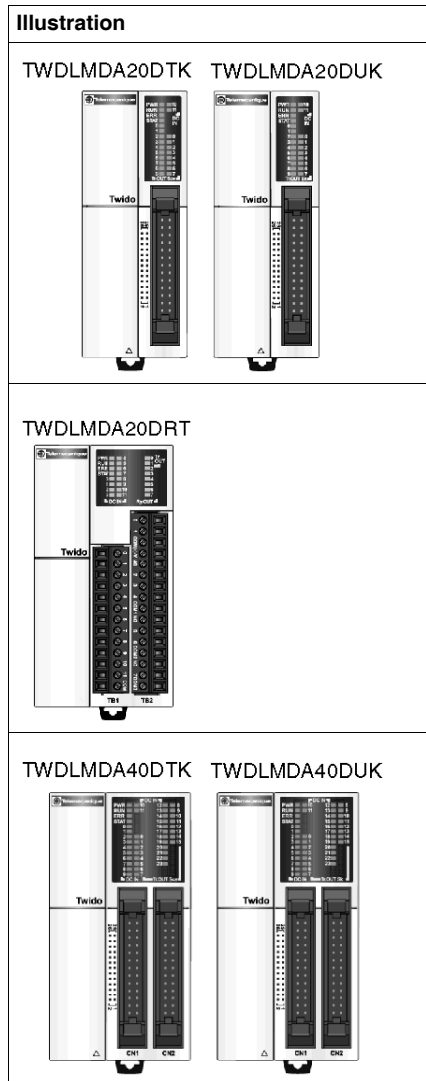


## Parts Description of a Modular Base

### Introduction

The following section describes the parts of a Modular base. Your base may differ from the illustrations but the parts will be the same.

### Parts Description of a Modular Base

The following figure shows the parts of a Modular base. This figure shows the Modular 40 I/O base.

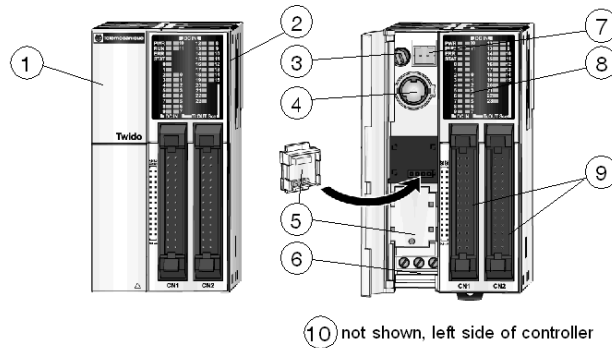

### Caption

Label	Description
1	Hinged lid
2	Expansion connector
3	Analog potentiometer
4	Serial port 1
5	Cartridge covers
6	24 VDC power supply terminals
7	Analog voltage input connector
8	LEDs
9	I/O terminals
10	Communication connector

## 4.2 Modular Bases Specifications

---

### Introduction

This section provides general specifications, electrical specifications, inputs and outputs specifications, analog potentiometers description, analog voltage input overview, and functional specifications for Modular bases.

### What's in this Section?

This section contains the following topics:

<b>Topic</b>	<b>Page</b>
General Specifications for the Modular Bases	125
Electrical Specifications for the Modular Bases	126
Input Specifications for the Modular Bases	127
Relay Output Specifications for the Modular Bases	132
Transistor Output Specifications for the Modular bases	134
Description of Analog Potentiometers	136
Overview of Analog Voltage Input	137
Functional Specifications for the Modular Bases	138

## General Specifications for the Modular Bases

### Introduction

This section provides general specifications for the Modular bases.

### Normal Operating Specifications

Modular base	TWDLMDA20DTK TWDLMDA20DUK	TWDLMDA20DRT	TWDLMDA40DTK TWDLMDA40DUK
Operating temperature	0 to 55° C (32° F to 131° F) operating ambient temperature		
Storage temperature	-25° C to +70° C (-13° F to 158° F)		
Relative humidity	from 30 to 95% Rh (non-condensing)		
Pollution degree	2 (IEC60664)		
Degree of protection	IP20		
Corrosion immunity	Free from corrosive gases		
Altitude	Operation: from 0 to 2000 m (0 to 6,560 ft) Transport: 0 to 3,000 m (0 to 9,840 ft)		
Resistance to Vibration	When mounted on a DIN rail: from 10 to 57 Hz amplitude 0.075 mm, from 57 to 150 Hz acceleration 9.8 ms <sup>2</sup> (1G), 2 hours per axis on each of three mutually perpendicular axes. When mounted on a panel surface: from 2 to 25 Hz amplitude 1.6 mm, from 25 to 100 Hz acceleration 39.2 ms <sup>2</sup> (4G) Lloyd's 90 min per axis on each of three mutually perpendicular axes.		
Impact strength	147 ms <sup>2</sup> (15G), 11 ms duration, 3 shocks per axis, on three mutually perpendicular axes (IEC 61131).		
Weight	140 g (4.93 oz)	185 g (6.52 oz)	180 g (6.35 oz)

### Specifications for the Backup Battery

Modular backed up elements	<b>Internal RAM: internal variables, internal bits and words, timers, counters, shift registers, etc.</b>
Time	Approximately 30 days at 25° C (77° F) after battery fully charged.
Battery type	Non-interchangeable lithium accumulator
Charging time	Approximately 15 hours for 0% to 90 % of total load
Service life	10 years

## Electrical Specifications for the Modular Bases

### Introduction

This section provides electrical specifications for the Modular bases.

### Electrical Specifications


Modular base	TWDLMDA20DTK TWDLMDA20DUK	TWDLMDA20DRT	TWDLMDA40DTK TWDLMDA40DUK
Rated power voltage	24 VDC		
Allowable voltage range	from 20.4 to 26.4 VDC (including ripple)		
Maximum input power	Base plus 4 I/O Modules	Base plus 7 I/O Modules	
	15 W (26.4 VDC)	19 W (26.4 VDC)	19 W (26.4 VDC)
Allowable momentary power interruption	10 ms, 100% drop out (at the rated inputs and outputs) (IEC61131 and IEC61000-4-11)		
Dielectric strength	Between power and ground terminals: 500 VAC, 1 min Between I/O and ground terminals: 1500 VAC, 1 min		
Insulation resistance	Between power and ground terminals: 10 M $\Omega$ minimum (500 VDC) Between I/O and ground terminals: 10 M $\Omega$ minimum (500 VDC)		
Electromagnetic resistance	AC power terminals: 2kV, Level 3 DC power terminals: 2kV, Level 3 I/O terminals: - DC: 1kV, Level 3 - AC: 2kV, Level 4 According to IEC61131-2 (Zone B) and IEC61000-4-4		
Inrush current	50 A maximum (24 VDC)		
Ground wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )		
Power supply wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )		
Effect of improper power supply connection	Reverse polarity: no operation, no damage Improper voltage or frequency: internal fuse protection		

## Input Specifications for the Modular Bases

### Introduction

This section provides Input specifications for the Modular bases.

### DC Input Specifications


<b> WARNING</b>
<b>UNINTENDED EQUIPMENT OPERATION</b>
If any input exceeding the rated value is applied, permanent damage may be caused.
<b>Failure to follow these instructions can result in death, serious injury, or equipment damage.</b>

Modular base	TWDLMDA20DUK TWDLMDA20DTK	TWDLMDA20DRT	TWDLMDA40DUK TWDLMDA40DTK
Input points	12 points in 1 common line	12 points in 1 common line	24 points in 1 common line
Rated input voltage	24 VDC source/sink input signal		
Input voltage range	from 20.4 to 26.4 VDC		
Rated input current	I0, I1, I6, I7: 5 mA/input (24 VDC) I2 to I5, I8 to I23: 7 mA/input (24 VDC)		
Input impedance	I0, I1, I6, I7: 5.7 k $\Omega$ I2 to I5, I8 to I23: 3.4 k $\Omega$		
Turn on time (ON Time)	I0 to I7: 35 $\mu$ s + filter value I8 to I23: 40 $\mu$ s + filter value		
Turn off time (OFF Time)	I0, I1, I6, I7: 45 $\mu$ s + filter value I2 to I5, I8 to I23: 150 $\mu$ s + filter value		
Isolation	Between input terminals and internal circuit: photocoupler isolated (isolation protection up to 500 V) Between input terminals: not isolated		
Filtering (3 possibilities: none, 3 ms or 12 ms.)	I0 to I11	I0 to I11	I0 to I7
Input type	Type 1 (IEC 61131)		
External load for I/O interconnection	Not needed		
Signal determination method	Static		
Input signals type	The input signals can be both sink and source.		

Modular base	TWDLMDA20DUK TWDLMDA20DTK	TWDLMDA20DRT	TWDLMDA40DUK TWDLMDA40DTK
Cable length	3m (9.84 ft) for compliance with electromagnetic immunity		
Connector insertion/removal durability	100 times minimum		

### I/O Usage Limits

When using TWDLMDA20DUK and TWDLMDA20DTK at an ambient temperature of 55° C (131° F) in the normal mounting direction, limit the inputs and outputs, respectively, which turn on simultaneously along line (1).

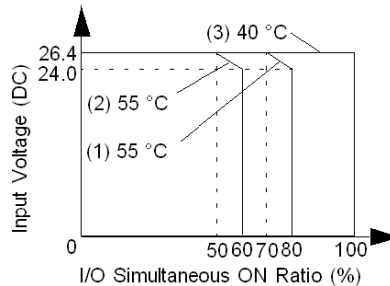

When using TWDLMDA40DUK and TWDLMDA40DTK limit the inputs and outputs, respectively, which turn on simultaneously along line (2).

At 40° C (104° F), all inputs and outputs can be turned on simultaneously at 26.4 VDC as indicated with line (3).

When using the TWDLMDA20DRT controller, all inputs and outputs can be turned on simultaneously at 55° C (131° F), input voltage 26.4 VDC.

### Transistor Sink and Source Output Specifications

Modular controller TWDLMDA...	20DUK	40DUK	20DRT	20DTK	40DTK
Output type	Sink	Sink	Source	Source	Source
Output points per common Line	8	2	2	8	16
Rated load voltage	24 VDC				
Maximum load current	1 A per common line				
Operating load voltage range	from 20.4 to 28.8 VDC				



Modular controller TWDLMDA...	20DUK	40DUK	20DRT	20DTK	40DTK
Voltage drop (on voltage)	1 V maximum (voltage between COM and output terminals when output is on)				
Rated load current	0.3 A per output				
Inrush current	1 A maximum				
Leakage current	0.1 mA maximum				
Clamping voltage	39 V +/-1 V				
Maximum lamp load	8 W				
Inductive load	L/R = 10 ms (28.8 VDC, 1 Hz)				
External current draw	100 mA maximum, 24 VDC (power voltage at the +V terminal)		100 mA maximum, 24 VDC (power voltage at the -V terminal)		
Isolation	Between output terminal and internal circuit: photocoupler isolated (isolation protection up to 500 V) Between output terminals: not isolated				
Average number of connector insertions/removals	100 times minimum				
Output delay - turn on/off time	Q0, Q1: 5 $\mu$ s maximum Q2 to Q15: 300 $\mu$ s maximum				

## Relay Output Specifications

Modular controller	TWDLMDA20DRT
Number of outputs	8 discrete inputs consisting of 6 relay outputs and 2 transistor source outputs
Output points per common line - COM0	2 outputs
Output points per common line - COM1	3 NO contacts
Output points per common line - COM2	2 NO contacts
Output points per common line - COM3	1 NO contact
Maximum load current	2 A per output 8 A per common line
Minimum switching load	0.1 mA/0.1 VDC (reference value)
Initial contact resistance	30 m $\Omega$ maximum
Mechanical life	20,000,000 operations minimum (no load 18,000 operations/h)


<b>Modular controller</b>	<b>TWDLMDA20DRT</b>
Dielectric strength	Between output to internal circuit: 1500 VAC, 1 min Between output groups: 1500 VAC, 1 min
Connector insertion/removal durability	100 times minimum

Usage category	Rated load	Electrical life (number of operations)
AC1 Resistive load command	500 VA(*)	10 <sup>5</sup>
AC14 Weak solenoid load	250 VA	10 <sup>5</sup>
AC15 Solenoid	200 VA	10 <sup>5</sup>
DC1 Resistive load command	60 W(*)	10 <sup>5</sup>
DC13 Solenoid L/R=150ms	30 W	10 <sup>5</sup>

(\*) for AC1 & DC1 the outputs indicated here take the maximum per point on Twido (2A) into account.


### Output delay

The output delay is shown below.

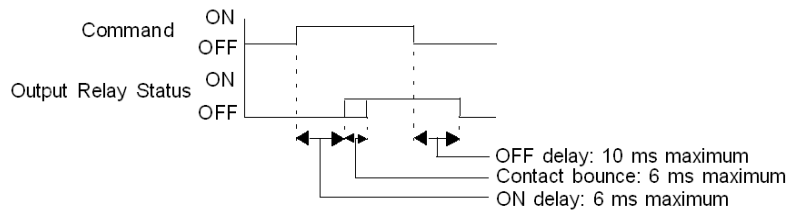


## Relay Output Contact

The relay output contact is shown below.

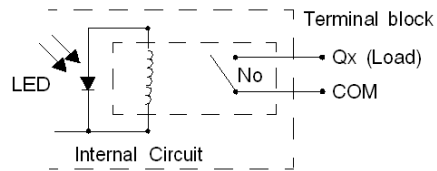


## Transistor Source Output Contact

The transistor source output contact is shown below.

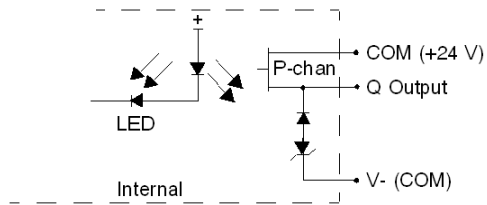

## Transistor Sink Output Contact

The transistor sink output contact is shown below.

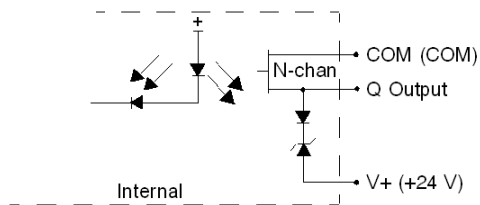

## Relay Output Specifications for the Modular Bases

### Introduction

This section provides Relay output specifications for the Modular bases.

### Relay Output Specifications


Modular base	TWDLMDA20DRT
Number of outputs	8 discrete inputs consisting of 6 relay outputs and 2 transistor source outputs
Output points per common line - COM0	2 outputs
Output points per common line - COM1	3 NO contacts
Output points per common line - COM2	2 NO contacts
Output points per common line - COM3	1 NO contact
Maximum load current	2 A per output 8 A per common line
Minimum switching load	0.1 mA/0.1 VDC (reference value)
Initial contact resistance	30 mΩ maximum
Mechanical life	20,000,000 operations minimum (no load 18,000 operations/h)
Dielectric strength	Between output to internal circuit: 1500 VAC, 1 min Between output groups: 1500 VAC, 1 min
Connector insertion/removal durability	100 times minimum

Usage category	Rated load	Electrical life (number of operations)
AC1 Resistive load command	500 VA(*)	10 <sup>5</sup>
AC14 Weak solenoid load	250 VA	10 <sup>5</sup>
AC15 Solenoid	200 VA	10 <sup>5</sup>
DC1 Resistive load command	60 W(*)	10 <sup>5</sup>
DC13 Solenoid L/R=150ms	30 W	10 <sup>5</sup>

(\*) for AC1 & DC1 the outputs indicated here take the maximum per point on TwidoSuite (2A) into account.


## Output delay

The output delay is shown below.

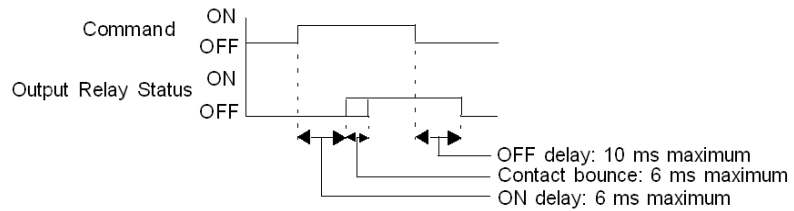

## Relay Output Contact

The relay output contact is shown below.

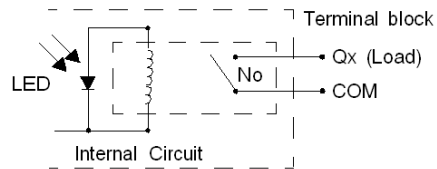

## Transistor Output Specifications for the Modular bases

### Introduction


This section provides Transistor output specifications for the Modular bases.

### Transistor Sink and Source Output Specifications

Modular controller TWDLMDA...	20DUK	40DUK	20DRT	20DTK	40DTK
Output type	Sink output	Sink output	Source output	Source output	Source output
Output points per common Line	8	2	2	8	16
Rated load voltage	24 VDC				
Maximum load current	1 A per common line				
Operating load voltage range	from 20.4 to 28.8 VDC				
Voltage drop (on voltage)	1 V maximum (voltage between COM and output terminals when output is on)				
Rated load current	0.3 A per output				
Inrush current	1 A maximum				
Leakage current	0.1 mA maximum				
Clamping voltage	39 V +/-1 V				
Maximum lamp load	8 W				
Inductive load	L/R = 10 ms (28.8 VDC, 1 Hz)				
External current draw	100 mA maximum, 24 VDC (power voltage at the +V terminal)		100 mA maximum, 24 VDC (power voltage at the -V terminal)		
Isolation	Between output terminal and internal circuit: photocoupler isolated (isolation protection up to 500 V) Between output terminals: not isolated				
Average number of connector insertions/removals	100 times minimum				
Output delay - turn on time	Q0, Q1: 5 $\mu$ s maximum Q2 to Q15: 300 $\mu$ s maximum				
Output delay - turn off time	Q0, Q1: 5 $\mu$ s maximum Q2 to Q15: 300 $\mu$ s maximum				


### Transistor Source Output Contact

The transistor source output contact is shown below.

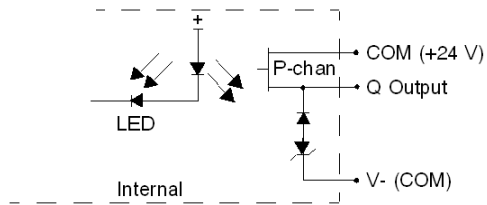

### Transistor Sink Output Contact

The transistor sink output contact is shown below.

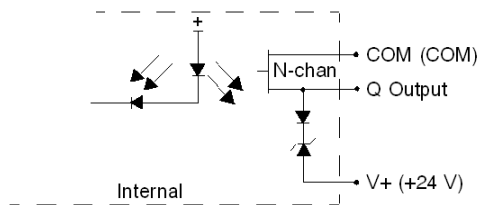

## Description of Analog Potentiometers

### Introduction


The following section describes the analog potentiometer on the Modular bases.

### Description

The TWDLMDA20DUK, TWDLMDA20DTK, TWDLMDA20DRT, TWDLMDA40DUK, and TWDLMDA40DTK bases have one analog potentiometer. The analog potentiometer can be set to a value between 0 and 1023. The value is stored in a system words and is updated in every scan. For more information on setting the analog potentiometer, see the TwidoSuite Software Reference Manual.

### Analog Potentiometer on a Modular Base

The following figure shows the analog potentiometer on a Modular base, the TWDLMDA40DUK.

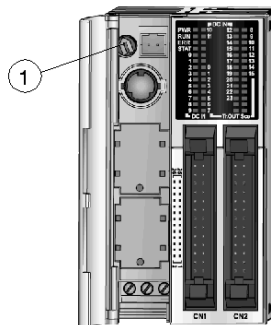

### Caption

Label	Description
1	Analog potentiometer 1



## Overview of Analog Voltage Input

### Introduction

The following section describes the analog voltage input on the Modular bases.

### Description

All Modular bases have one analog voltage input. The analog voltage input connects an analog voltage source of 0 through 10 VDC. The analog voltage is converted to a value of 0 through 1023 and is stored in a system word.

## Functional Specifications for the Modular Bases

### Introduction

This section provides functional specifications for the Modular bases.

### Communication Function Specifications

Communication Port	Port 1 (RS485)	Port 2 (RS232C) Communication Expansion Module (TWDNOZ232D) or Operator Display Expansion Module (TWDXCPODM) with Communication Adapter (TWDNAC232D)	Port 2 (RS485) Communication Expansion Modules (TWDNOZ485D) or (TWDNOZ485T) or Operator Display Expansion Module (TWDXCPODM) with Communication Adapter (TWDNAC485D) or (TWDNAC485T)
Standards	RS485	RS232	RS485
Maximum baud rate	PC Link: 19,200 bps Remote Link: 38,400 bps	19,200 bps	PC Link: 19,200 bps Remote Link: 38,400 bps
Modbus communication (RTU master/slave)	Possible	Possible	Possible
ASCII communication	Possible	Possible	Possible
Remote communication	7 links possible	Not possible	7 links possible
Maximum cable length	Maximum distance between the base controller and the remote controller: 200 m (656 ft)	Maximum distance between the base controller and the remote controller: 200 m (656 ft)	Maximum distance between the base controller and the remote controller: 200 m (656 ft)
Isolation between internal circuit and communication port	Not isolated	Not isolated	Not isolated
Telephone communication	Possible Possible to connect from a receive only modem.	Not possible	Not possible

**Built-in Function Specifications**

Analog voltage input	Number of channels	1
	Input voltage range	from 0 to 10 VDC
	Input impedance	100 k $\Omega$
	Resolution	9 bits (0 to 1023 steps)
	Input tolerance	+/- 5%
	Sample duration time	5 ms
	Sample repeat time	5 ms
	Total input transfer time	5 ms + 1 cycle time
Movement	Number of channels	2
	Frequency	7 kHz
	Functions	PWM - Pulse Width Modulation output PLS - Pulse generator output
Counting	Number of channels	4
	Frequency	2 channels at 5kHz (FCi), 2 channels at 20kHz (VFCi)
	Capacity	16 bits (0..65535 steps)
Analog potentiometers	1 adjustable from 0 through to 1023 steps	
FCi = Fast Counter "i" VFCi = Very Fast Counter "i"		

## 4.3 Modular Bases Wiring

---

### Introduction

This section provides wiring rules and recommendations, and wiring schematics for Modular bases.

### What's in this Section?

This section contains the following topics:

Topic	Page
Wiring Rules and Recommendations	141
Modular Base Wiring Diagrams	145

## Wiring Rules and Recommendations

### Introduction

There are several rules that must be followed when wiring a controller or module. Recommendations, when needed, are provided on how to comply with the rules.

### **DANGER**

#### **HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH**

- Disconnect all power from all equipment including connected devices prior to removing any covers or doors, or installing or removing any accessories, hardware, cables, or wires except under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

**Failure to follow these instructions will result in death or serious injury.**

### **WARNING**

#### **MALFUNCTION OF OUTPUTS**

Use appropriate safety interlocks where personal and/or equipment hazards exist. Outputs can malfunction and remain ON or OFF.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

### Rules

- Each terminal accepts up to two 18 AWG (0.82 mm<sup>2</sup>) through 28 AWG (0.08 mm<sup>2</sup>) fitted with cable ends or tags.
- Output module fusing is the responsibility of the user. It is not within the Twido product itself. Select a fuse appropriate for the load with respect to the electrical codes.
- Depending on the load, a protection circuit may be needed for relay outputs on modules.
- The power supply wire should be between 18 AWG (0.82 mm<sup>2</sup>) and 22 AWG (0.33 mm<sup>2</sup>). Use the shortest wire length possible.

- The grounding wire should be 16 AWG (1.30 mm<sup>2</sup>).
- Power supply wires routed inside the panel must be kept separate from power wires, I/O wiring and communication wiring. Route wiring in separate cable ducting.
- Take care when wiring output modules that are designed to work as either source or sink. Incorrect wiring can cause equipment damage.
- Verify that the operating conditions and environments are within the specification values.
- Use proper wire size to meet voltage and current requirements.

### Terminal Tightening Torque


Recommended tightening torque of terminal blocks is listed for all products on the product label.

### Contact Protection Circuit for Relay and Transistor Outputs

<b>⚠ CAUTION</b>
<b>OUTPUT CIRCUIT DAMAGE DUE TO INDUCTIVE LOADS</b>
Use one of the following protective circuits to reduce the risk of inductive load damage.
<b>Failure to follow these instructions can result in injury or equipment damage.</b>


Depending on the load, a protection circuit may be needed for the relay output on the controllers and certain modules. Choose a protection circuit, from the following diagrams, according to the power supply. Connect the protection circuit to the outside of the controller or relay output module.

Protective circuit A: this protection circuit can be used when the load impedance is smaller than the RC impedance in an AC load power circuit.

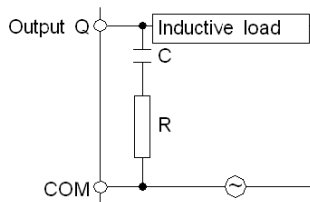


- C represents a value from 0.1 to 1  $\mu\text{F}$ .
- R represents a resistor of approximately the same resistance value as the load.

Protective circuit B: this protection circuit can be used for both AC and DC load power circuits.

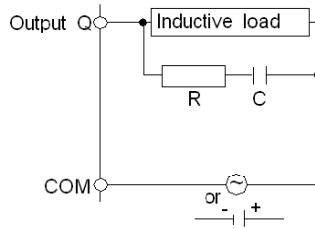

- C represents a value from 0.1 to 1  $\mu\text{F}$ .
- R represents a resistor of approximately the same resistance value as the load.


Protective circuit C: this protection circuit can be used for DC load power circuits.

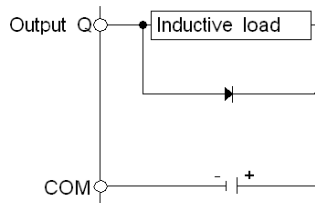

Use a diode with the following ratings:


- Reverse withstand voltage: power voltage of the load circuit x 10.
- Forward current: more than the load current.

Protective circuit D: this protection circuit can be used for both AC and DC load power circuits.

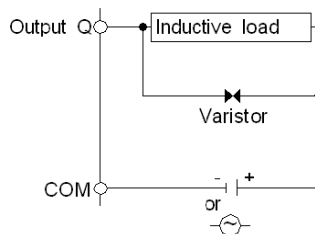

### Explanation of Source Inputs/Sink Outputs


**NOTE: Sink** corresponds to the sensors' common on the (+) terminal of the power supply.

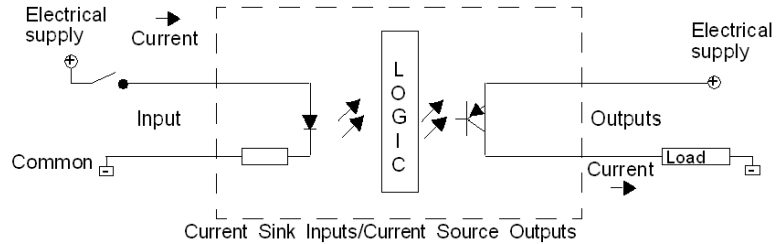

Input side COM field terminal connects to the "-" terminal or common of the field power supply. Output side COM field terminal connects to +24V field power supply.

### Explanation of Sink Inputs/Source Outputs

**NOTE: Source** corresponds to the sensors' common on the (-) terminal of the power supply.

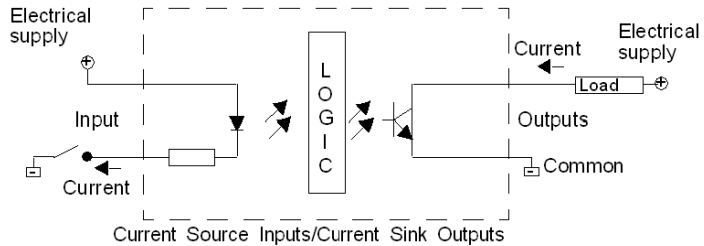

Input side COM field terminal connects to +24V field power supply. Output side COM field terminal connects to the "-" terminal or common of the field power supply.



## Modular Base Wiring Diagrams

### Introduction

This section shows examples of wiring diagrams for the Modular bases. Symbols used in the following diagrams are explained in the Glossary of Symbols (see page 229) in the appendix.

### **DANGER**

#### **HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH**

- Disconnect all power from all equipment including connected devices prior to removing any covers or doors, or installing or removing any accessories, hardware, cables, or wires except under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

**Failure to follow these instructions will result in death or serious injury.**

### **CAUTION**

#### **RISK OF REVERSE-POLARITY DAMAGE AT TRANSISTOR OUTPUTS**


- Make sure to conform to the polarity markings on the transistor output terminals.
- Use of a reverse polarity can permanently damage or destroy the output circuits.

**Failure to follow these instructions can result in injury or equipment damage.**

**NOTE:** These diagrams are for external wiring only.


**NOTE:** The shaded boxes are markings on the base. The I and Q numbers are the input and output points.

## DC Power Supply Wiring




- Make the power supply wiring as short as possible.
- Connect functional earth as close as possible to plate.

## Fast Input/Output Wiring Rules



## TWDLMDA20-DUK Wiring Diagram


This diagram is for the TWDLMDA20DUK base with connector.

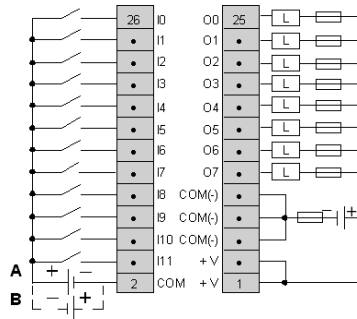

- The COM(-) terminals are connected together internally.
- The COM and COM(-) terminals are **not** connected together internally.
- The +V terminals are connected together internally.
- Connect an appropriate fuse for the load.
- A is the positive logic.
- B is the negative logic.

### TWDLMDA20-DTK Wiring Diagram


This diagram is for the TWDLMDA20DTK base with connector.

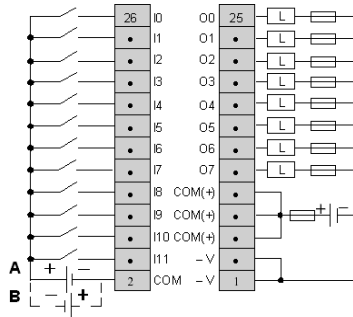

- The COM(+) terminals are connected together internally.
- The COM and COM(+) terminals are **not** connected together internally.
- The -V terminals are connected together internally.
- Connect an appropriate fuse for the load.
- A is the positive logic.
- B is the negative logic.

### TWDLMDA20-DRT Wiring Diagram


This diagram is for the TWDLMDA20DRT base with terminal block.

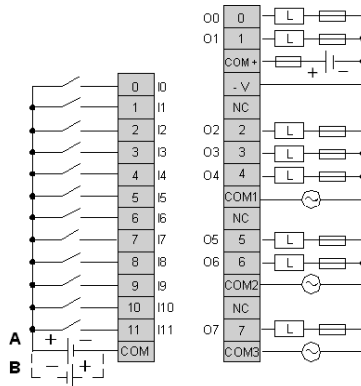

- Output points 0 and 1 are transistor source outputs, all other output points are relay.
- The COM terminals are **not** connected together internally.
- Connect an appropriate fuse for the load.
- A is the positive logic.
- B is the negative logic.

## TWDLMDA40-DUK Wiring Diagram


This diagram is for the TWDLMDA40DUK base with connector.

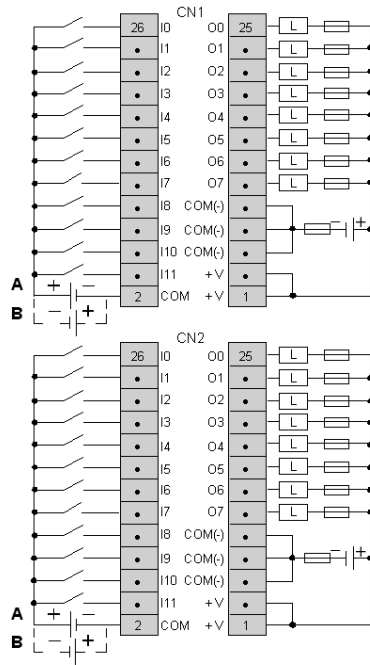

- The terminals on CN1 and CN2 are **not** connected together internally.
- The COM(-) terminals are connected together internally.
- The COM and COM(-) terminals are **not** connected together internally.
- The +V terminals are connected together internally.
- Connect an appropriate fuse for the load.
- A is the positive logic.
- B is the negative logic.

## TWDLMDA40-DTK Wiring Diagram

This diagram is for the TWDLMDA40DTK base with connector.

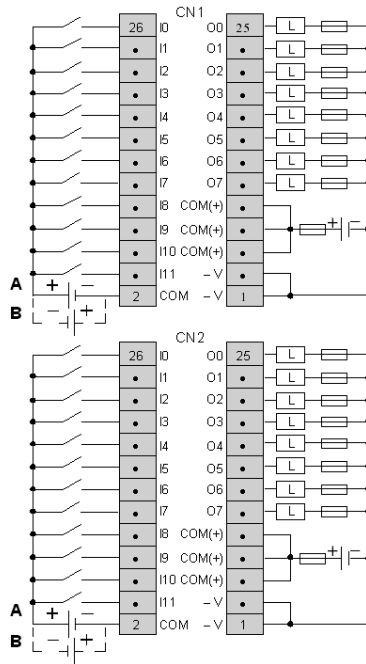

- The terminals on CN1 and CN2 are **not** connected together internally.
- The COM(+) terminals are connected together internally.
- The COM and COM(+) terminals are **not** connected together internally.
- The -V terminals are connected together internally.
- Connect an appropriate fuse for the load.
- A is the positive logic.
- B is the negative logic.

## 4.4 Modular Bases Options

---

### Introduction

This section provides information about memory cartridges, RTC cartridges, and operator display modules for Modular bases.

### What's in this Section?

This section contains the following topics:

Topic	Page
Memory Cartridges	151
Real Time Clock (RTC) Cartridge	152
Operator Display Expansion Modules	153

## Memory Cartridges

### Introduction

The following section provides an overview and specifications about the TWDXCPMFK32 and TWDXCPMFK64 memory cartridges, as options for the Modular bases.

### Overview of the Memory Cartridges

There are two optional memory cartridges, 32 KB (TWDXCPMFK32) and 64 KB (TWDXCPMFK64), available. The memory cartridges provide additional memory for application storage. The memory cartridges are used to:

- Provide a removable backup of the application.
- Load an application into a modular base if certain conditions exist.
- Increase the program memory capacity.

The following table presents the available memory cartridge for each type of modular base.

Memory Cartridge	20 I/O modular	40 I/O modular
TWDXCPMFK32	yes	yes
TWDXCPMFK64	yes	yes

The TWDXCPMFK32 memory cartridge is for back up only. The TWDXCPMFK64 memory cartridge is for back up and expansion.

### Memory Cartridge Specifications

The following table describes the memory cartridge specifications.

Memory Type	EEPROM
Accessible memory capacity	32 KB: TWDXCPMFK32 64 KB: TWDXCPMFK64
Hardware for storing data	Twido base
Software for storing data	TwidoSuite
Quantity of stored programs	One user program is stored on one memory cartridge.
Program execution priority	When a memory cartridge is installed and enabled, the external user program will be loaded and executed if it differs from the internal program.

## Real Time Clock (RTC) Cartridge

### Introduction

This section provides an overview and specifications for the TWDXPRTC RTC cartridge, as an option for Modular bases.

### Overview of the Real Time Clock (RTC) Cartridge

An optional Real Time Clock cartridge (TWDXPRTC) is available for all types of modular bases.

The Real Time Clock cartridge provides the Modular base with the current time and date. The RTC is required for the Schedule Blocks to operate.

When the Modular base is powered down, the Real Time Clock (RTC) will keep time for 1000 hours at 25 °C (77° F) or 300 hours at 55° C (131° F) when using a fully charged battery.

### Real Time Clock Cartridge Specifications

The following table describes the Real Time Clock cartridge specifications.

<b>Accuracy</b>	<b>30 s/month (typical) at 25° C (77° F)</b>
Backup duration	Approximately 30 days (typical) at 25° C (77° F) after backup battery fully charged
Battery	Lithium secondary battery
Charging time	Approximately 10 hours for charging from 0% to 90% of full charge
Replaceable	Not possible



## Operator Display Expansion Modules

### Introduction

The following section provides an overview of the TWDXCPODM operator display expansion module.

### Overview

The operator display is an optional module that can be added to any of the modular bases. It is assembled to a Modular base using the operator display expansion module (TWDXCPODM). See *How to Install the Operator Display Module*, page 54.

The operator display provides the following services:


- Displays the base state information
- Allows the user to control the base
- Allows the user to monitor and tune application data objects

The operator display has two states:

- Display state - Displays data
- Edit state - Allows the user to change data

### Parts Description of an Operator Display Expansion Module

The following figure shows the parts of the TWDXCPODM operator display expansion module.

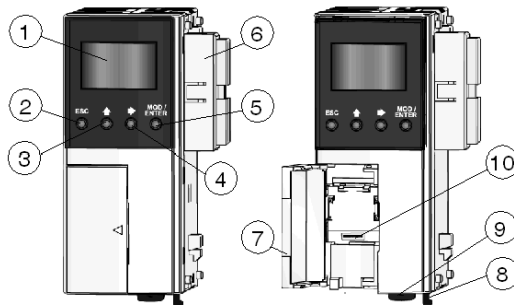

**Caption**

<b>Label</b>	<b>Part</b>	<b>Description</b>
1	Display screen	Shows menus, operands, and data.
2	ESC button	In Edit state - Returns to the previous display state and rejects changes made by the user.
3	Up arrow button	In Edit state - Changes the current edit element to the next value.
4	Right arrow button	In Display state - Advances to the next display state. In Edit state - Advances to the next editing element. The current editing element blinks.
5	MOD/ENTER button	In Display state - Works in MOD function, goes to the corresponding edit state. In Edit state - Works in ENTER function, returns to previous display state and accepts changes made by the user.
6	Operator display connector	Connects to a Modular base.
7	Hinged door	Opens to access the serial port 2.
8	Latch button	Holds/releases the module from a base.
9	Clamp	Secures the module to a DIN rail.
10	Serial port 2 connector	Connects to the connector on an optional TWDNAC232D, TWDNAC485D, or TWDNAC485T communication adapter.


**Operator Display Expansion Module Specifications**

The following table describes the operator display expansion module specifications.

<b>Part Number</b>	<b>TWDXCPODM</b>
Weight	78 g (2.75 oz)
Internal current draw	200 mA DC

**Operator Display Expansion Module Dimensions**

The following diagram shows the dimensions for the operator display expansion module (TWDXCPODM).

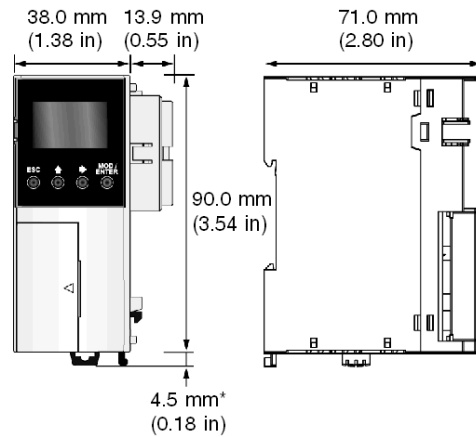

**NOTE:** \* 8.5 mm (0.33 in) when the clamp is pulled out.



---

# Telefast® Pre-Wired Systems for Twido

# 5

---

## Introduction

This chapter provides an overview of the Telefast® pre-wired system for Twido, Telefast® bases specifications, dimensions, and wiring schematics.

## What's in this Chapter?

This chapter contains the following topics:

Topic	Page
Overview of the Telefast® Pre-Wired System for Twido	158
Dimensions of the Telefast® Bases	161
Specifications for the Telefast® Bases	162
Telefast® Bases Wiring Schematics	164
Wiring Specifications for the TeleFast Cables	171

## Overview of the Telefast® Pre-Wired System for Twido


### Introduction

The following section provides an overview of the

- ABE 7B20MPN20,
- ABE 7B20MPN22,
- ABE 7B20MRM20,
- ABE 7E16EPN20,
- ABE 7E16SPN20,
- ABE 7E16SPN22,
- ABE 7E16SRM20 Telefast® pre-wired systems for Twido.

**Illustration**

The following illustration shows the Telefast® system for Twido:

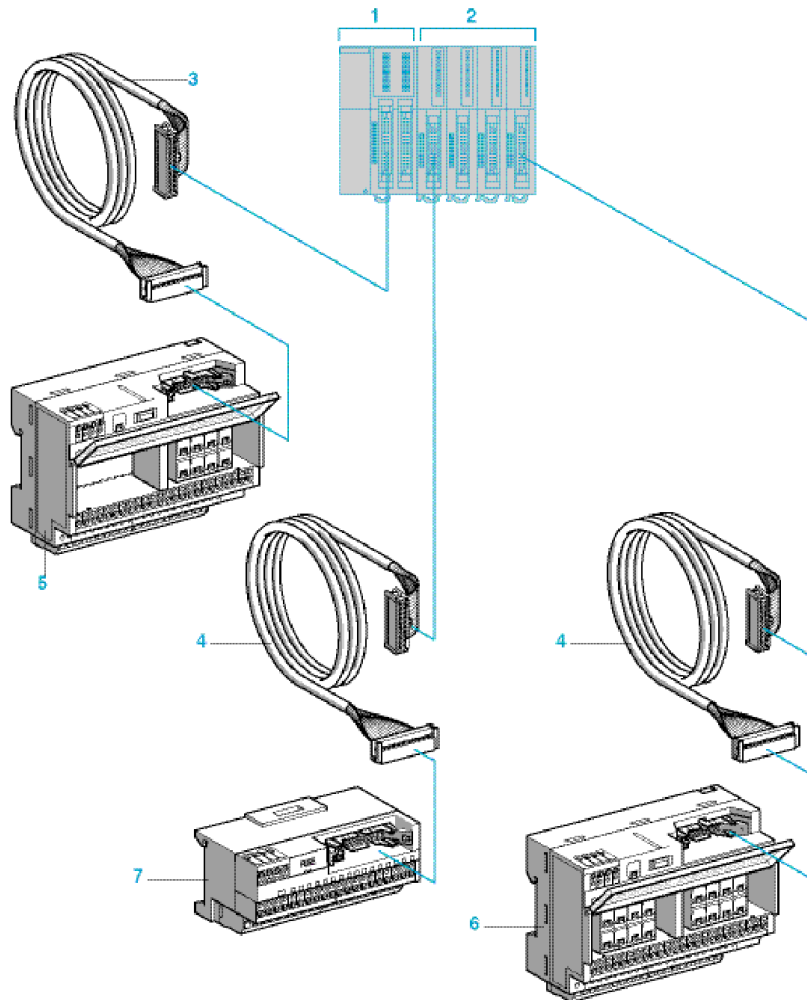**Caption**

Telefast system parts shown in the previous illustration are listed below:

1. Modular base controller with 26-way HE 10 connectors. The modular sizes available are 20 or 40 I/O.
2. Input and output modules with 20-way HE 10 connectors. The modular sizes available are 16 or 32 I/O.

3. Cable (ABF T26B\*\*0) equipped with a 26-way HE 10 connector at each end. This cable is available in 0.5, 1 and 2 meter lengths (AWG 28/0.08 mm<sup>2</sup>).
4. Cable (ABF T20E\*\*0) equipped with a 20-way HE 10 connector at each end. This cable is available in 0.5, 1, 2 and 3 meter lengths (AWG 28/0.08 mm<sup>2</sup>).
5. 20 channel sub-base (ABE 7B20MPN2• or ABE 7B20MR20) for modular base controllers.
6. 16 channel sub-base (ABE 7E16SPN22 or ABE 7E16SRM20) for output extension modules.
7. 16 channel sub-base (ABE 7E16EPN20 or ABE 7E16SPN20) for input or output extension modules.

### Compatibility Table

The following table describes compatibility between Twido (modular bases and I/O modules) and Telefast<sup>®</sup> components (bases and cables):

	Modular base controllers		Discrete I/O modules	
	Inputs/outputs		Inputs	Outputs
<b>Incorporated in Twido programmable controllers</b>	TWD LMDA 20DTK (12 I/8 O) TWD LMDA 40DTK (24 I/16 O)		TWD DDI 16DK (16 I) TWD DDI 32DK (32 I)	TWD DDO 16TK (16 O) TWD DDO 32TK (32 O)
<b>Terminal block types</b>	HE 10 connector, 26-way		HE 10 connector, 20-way	
<b>Connection to Twido programmable controller</b>	ABF T26B**0 (HE 10, 26-way)		ABF T20E**0 (HE 10, 20-way)	
<b>Passive connection sub-bases</b>				
20 channels	ABE 7B20MPN2•	Yes		
16 channels	ABE 7E16EPN20		Yes	
	ABE 7E16SPN2•			Yes
<b>Output adapter bases</b>				
20 channel	ABE 7B20MRM20	Yes		
16 channels	ABE 7E16SRM20			Yes



## Dimensions of the Telefast® Bases


### Introduction

The following section shows the dimensions for the Telefast® bases.

### ABE7B20MPN20 ABE7B20MPN22 ABE7B20MRM20 ABE7E16SPN22 ABE7E16SRM20


The following diagrams show the dimensions for the ABE7B20MPN20, ABE7B20MPN22, ABE7B20MRM20, ABE7E16SPN22 and ABE7E16SRM20 Telefast® bases.

#### Mounting on 35 mm rail

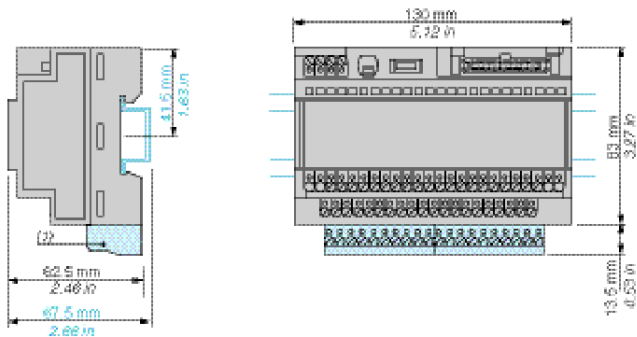

(1) ABE7B20MPN22, ABE7B20MRM20


#### Screw fixing (retractable lugs)

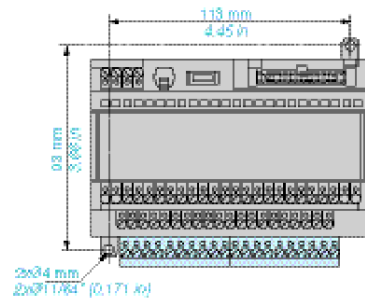

### ABE7E16EPN20 ABE7E16SPN20

The following diagrams show the dimensions for the ABE7E16EPN20 and ABE7E16SPN20 Telefast® bases.

#### Mounting on 35 mm rail

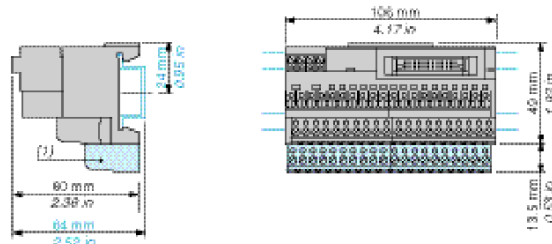

(1) ABE7E16SPN20

## Specifications for the Telefast® Bases

### Introduction

This section provides specifications for the Telefast® bases.

See Catalog 8501CT9801, "Advantys, TeleFast® pre-wired system for Twido" for more specifications on these Telefast® bases.

### Supply Specifications (controller side)

The following table provides supply specifications on the Telefast® bases at controller side:

Supply voltage	Conforming to IEC 61131-2	VDC	19...30(U <sub>n</sub> =24)
Maximum supply current per sub-base		A	2
Voltage drop on supply fuse		VDC	0,3
Supply overload and short-circuit protection by quick-blow fuse (included)		A	2

### Control Circuit Specifications (sensor/controller side)

The following table provides specifications on the Telefast® bases control circuit (per channel) at sensor/controller side:

Sub-base type	ABE 7	Unit	Passive connection sub-bases for digital signals			Connection sub-bases with soldered relays	
			B20MPN2*	E16EPN20	E16SPN2*	B20MRM20	E16SRM20
Number of channels	Passive input		12	16	–	12	–
	Passive output		8	–	16	–	–
	Solidstate output		–	–	–	2	–
	Relay output		–	–	–	6	16
Rated voltage U <sub>e</sub>		VDC	24				
Min/max voltage	Conforming to IEC 61131-2	VDC	20/4/26,4		20/4/28,8	19/30	
Internal current per channel at U <sub>e</sub>	Passive input	mA	– (3,2 for ABE 7 B20MPN2)				
	Passive output	mA	– (3,2 for ABE 7 B20MPN2)		– (3,2 for ABE 7 E16SPN2)	–	
	Solidstate output	mA	–			45	–
	Relay output	mA	–			9	
State 1 guaranteed	Solidstate output	V/mA	–			16/5,5	–
	Relay output	V	–			16,8	
State 0 guaranteed	Solidstate output	V/mA	–			10/0,4	–
	Relay output	V	–			2	
Conformity	Conforming to IEC 61131-2		Type 1	Type 1	–	Type 1	–

## Output Circuit Specifications (preactuator side)


The following table provides specifications on the Telefast<sup>®</sup> bases output circuit (per channel) at preactuator side:

Sub-base type		Unit	Passive connection sub-bases for digital signals			Connection sub-bases with soldered relays	
			E20MPN2	E16EPN20	E16SPN2	E20MFM20	E16SPM20
Number of channels	Passive output		8	–	16	–	–
	Solid state output		–	–	–	2	–
	Relay output		–	–	–	6	16
Contact arrangement			–			1 N/O relay	
Rated voltage at U <sub>e</sub>	Passive output	V DC	24			–	
	Solid state output	V DC	–			24	–
	Relay output	V DC	–			5...30	
V AC		–			110...250		
Current switched per I/O channel	Passive input/output	mA	15/300	15/–	–/100	15/–	–
	Solid state output	A	–			2	–
	Relay output	A	–			3	
Maximum current per common	Passive output	A	2	–	1.6	–	
	Solid state output	A	–			4	–
	Relay output	A	–			10	5
Rated operational current (60 °C max) (for 500 000 operations)	DC 12	A	–			2/3	–/3
	DC 13	A	–			2/05	–/05
	AC 12, relay	A	–			2	
	AC 15, relay	A	–			0.4	
Minimum current		mA	–			1/100	–/100
Rated insulation voltage		V	Not isolated			300	
Maximum response time	From state 0 to state 1	Solid state output	ms			–	–
		Relay output	ms			–	5
	From state 1 to state 0	Solid state output	ms			–	–
		Relay output	ms			–	2.5
Channel fuse protection		mA	– (315 for ABE 7 B20MPN22)	–	– (125 for ABE 7 E16SPN22)	–	




**ABE7B20MPN22**

The following diagram provides specifications for the ABE7B20MPN22 Telefast® base wiring.

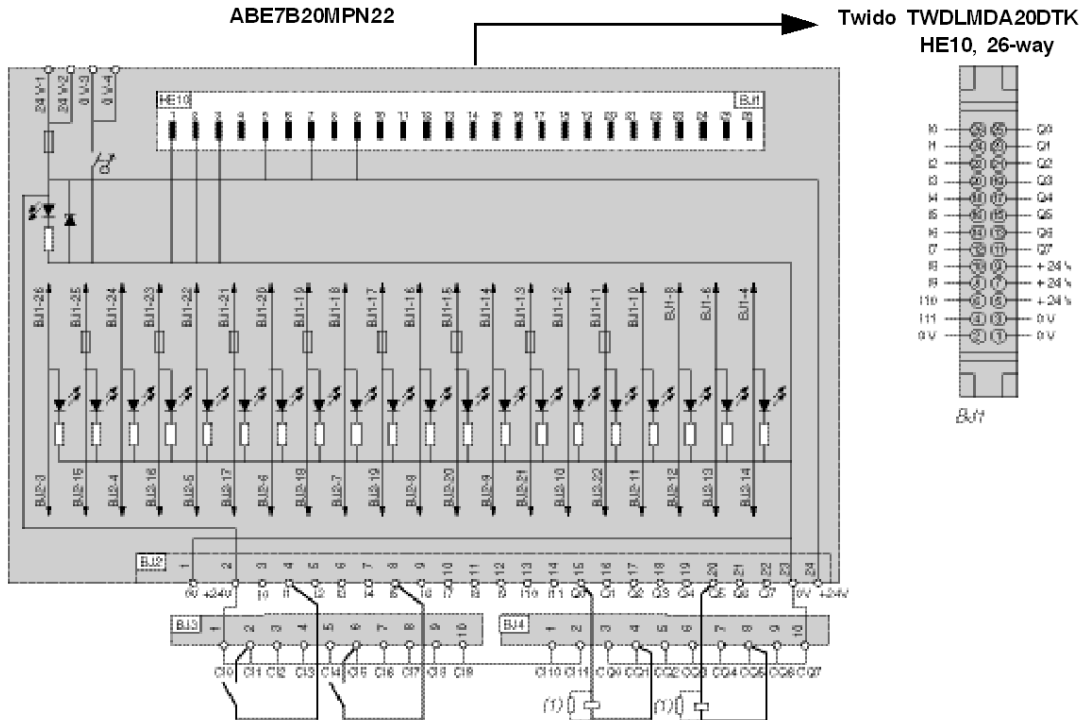

### ABE7B20MRM20


The following diagram provides specifications for the ABE7B20MRM20 Telefast® base wiring.

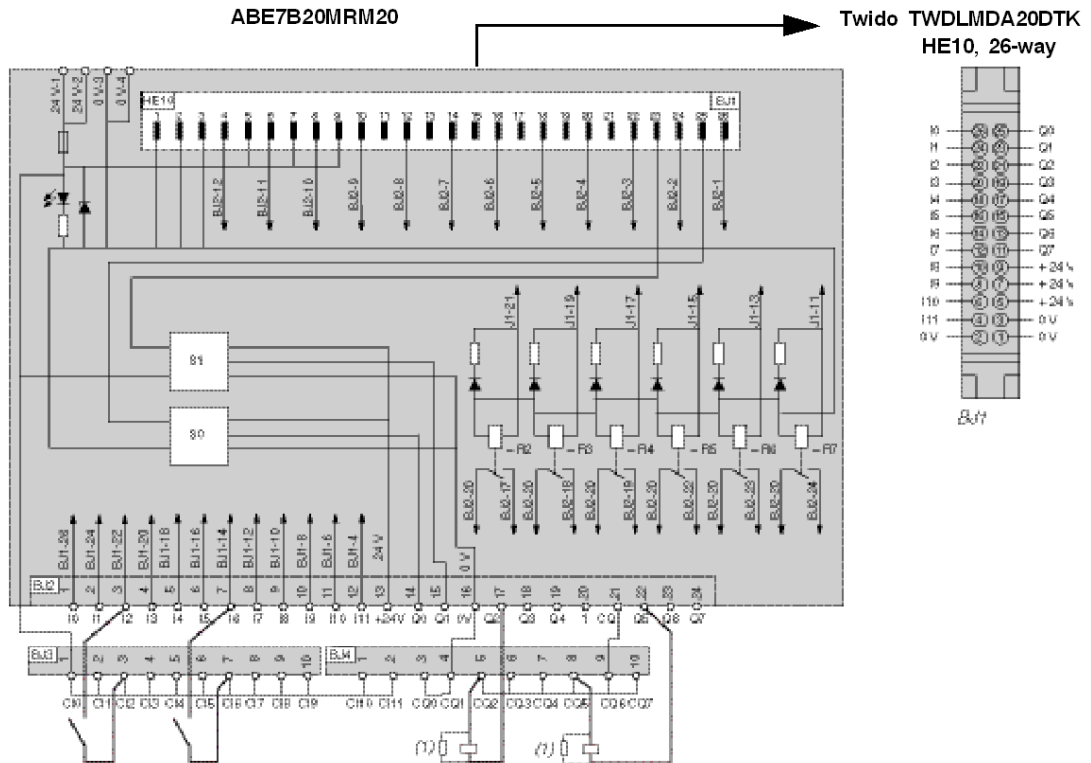

(1) Example of output connections.  
When connecting an inductive load, include a diode or a varistor.

### ABE7E16EPN20


The following diagram provides specifications for the ABE7E16EPN20 Telefast® base wiring.

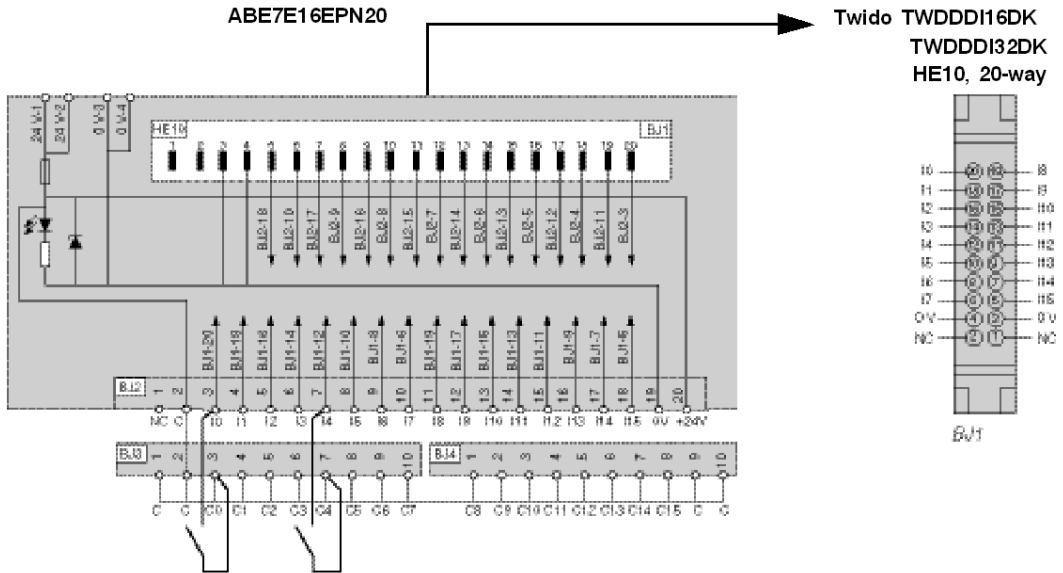

(1) Example of output connections.  
When connecting an inductive load, include a diode or a varistor.

### ABE7E16SPN20

The following diagram provides specifications for the ABE7E16SPN20 Telefast® base wiring.

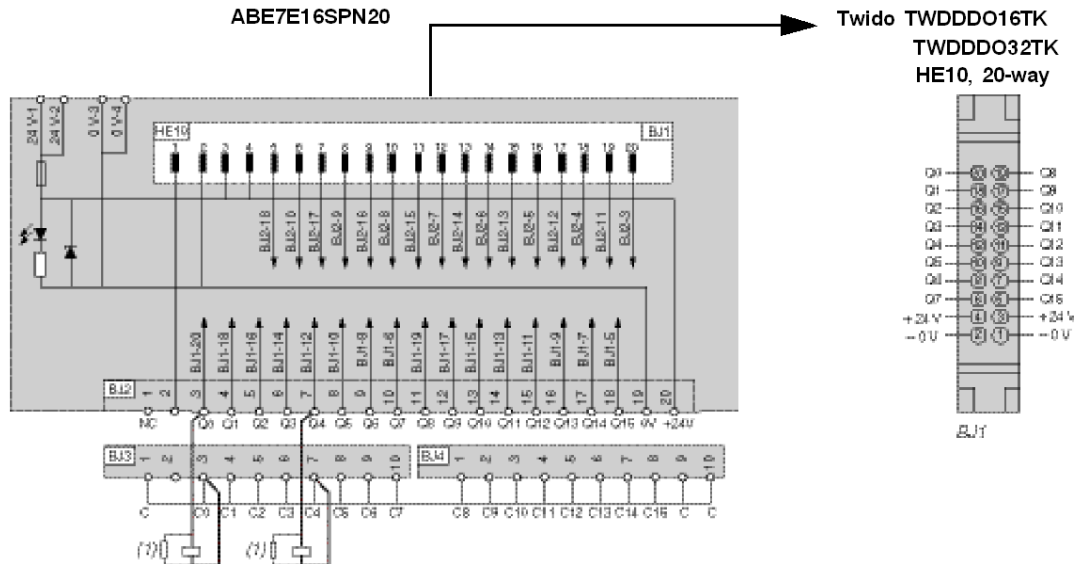


(1) Example of output connections.  
 When connecting an inductive load, include a diode or a varistor.



### ABE7E16SPN22


The following diagram provides specifications for the ABE7E16SPN22 Telefast® base wiring.

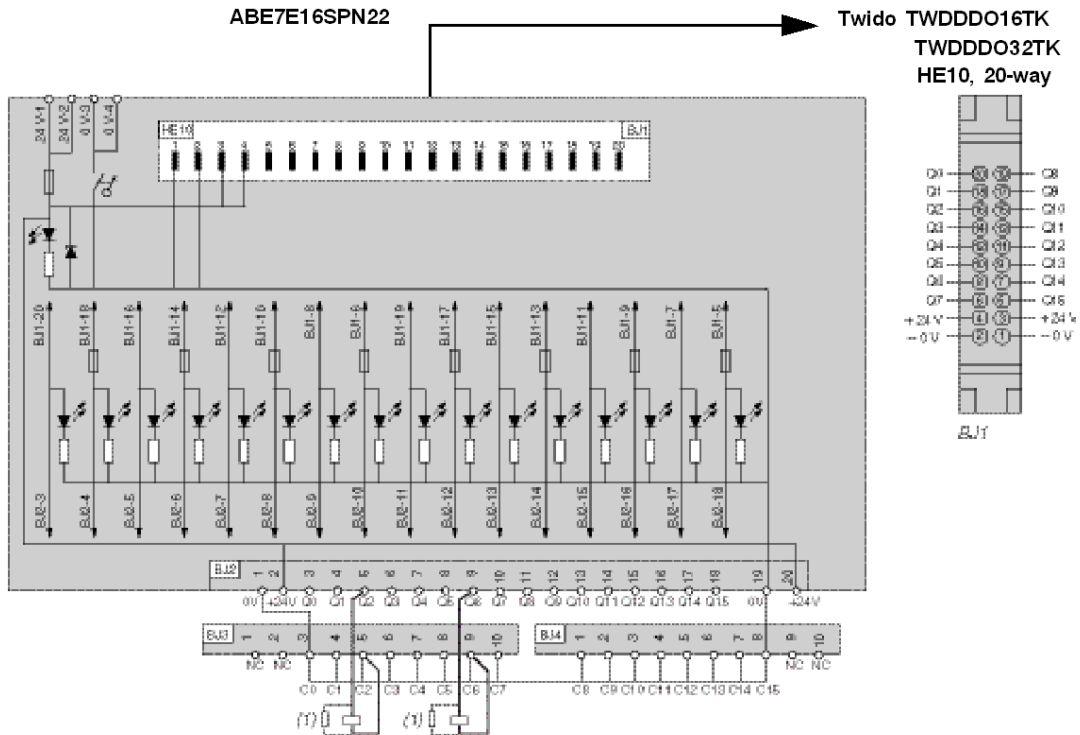

- (1) Example of output connections.  
When connecting an inductive load, include a diode or a varistor.

**ABE7E16SRM20**

The following diagram provides specifications for the ABE7E16SRM20 Telefast® base wiring.

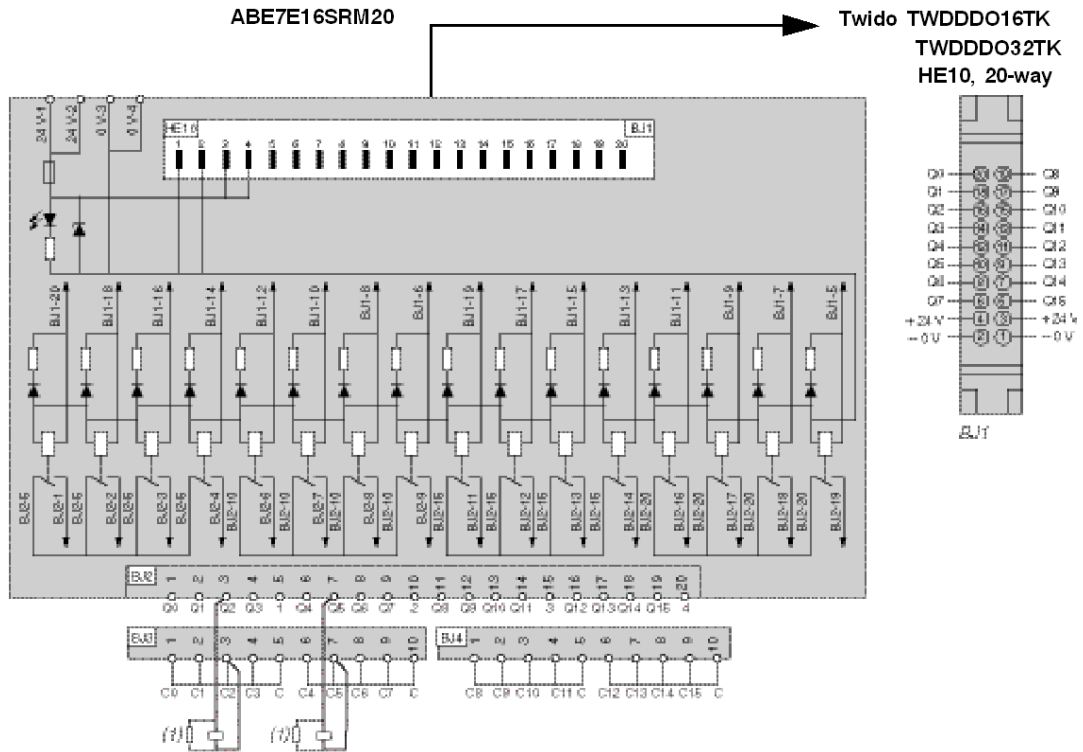

(1) Example of output connections.  
When connecting an inductive load, include a diode or a varistor.

## Wiring Specifications for the TeleFast Cables

### Introduction

This section provides cable wiring specifications for the TWDFCW30K/50K and TWDFCW30M/50M TeleFast cables that connect to Twido controllers discrete I/Os.


### TWDFCW30K/50K

The following table provides specifications for the TWDFCW30K/50K with free wires for 20-pin Modular controller.

Pin Connector A Twido Connector Side	Wire Color
1	White
2	Brown
3	Green
4	Yellow
5	Gray
6	Pink
7	Blue
8	Red
9	Black
10	Violet
11	Gray/Pink
12	Red/Blue
13	White/Green
14	Brown/Green
15	White/Yellow
16	Yellow/Brown
17	White/Gray
18	Gray/Brown
19	White/Pink
20	Pink/Brown

**Illustration**

Illustration of a TWDFCW30K cable:

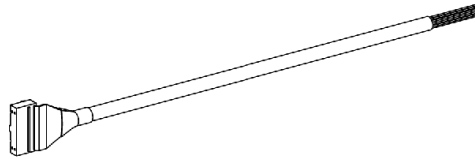

**TWDFCW30M/50M**


The following table provides specifications for the TWDFCW30M/50M cable with free wires for 26-pin Modular controller.

Pin Connector A Twido Connector Side	Wire Color for Input	Wire Color for Output
26	Brown/Black	
24	Brown/Red	
22	Brown/Blue	
20	Pink/Brown	
18	Gray/Brown	
16	Yellow/Brown	
14	Brown/Green	
12	Red/Blue	
10	Violet	
8	Red	
6	Pink	
4	Yellow	
2	Brown	
25		White/Black
23		White/Red
21		White/Blue
19		White/Pink
17		White/Gray
15		White/Yellow
13		White/Green
11		Gray/Pink
9		No Connect

Pin Connector A Twido Connector Side	Wire Color for Input	Wire Color for Output
7		Blue
5		Gray
3		Green
1		White

### Illustration

Illustration of a TWDFCW30M cable:

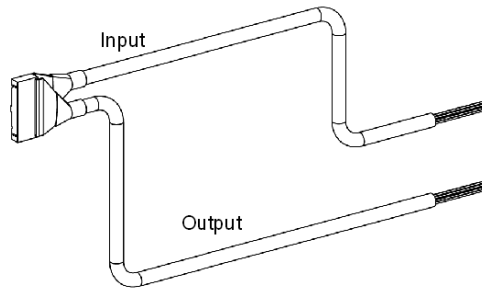



---

# Controller Operation



# 6

---

## Introduction

This chapter provides information about dedicated I/O and the controller operating modes.

## What's in this Chapter?

This chapter contains the following sections:

Section	Topic	Page
6.1	Dedicated I/Os	176
6.2	Controller Operating Modes	186

## 6.1 Dedicated I/Os

---

### Introduction

This section provides information about I/O assignments and capabilities for the RUN/STOP input, controller status output, latching input, counters (FC and VFC), PLS and PWM outputs.

### What's in this Section?

This section contains the following topics:

<b>Topic</b>	<b>Page</b>
RUN/STOP Input	177
Controller Status Output	178
Latching input	179
Fast Counting	180
Very Fast Counters	181
Pulse (PLS) Generator Output	184
Pulse Width Modulation (PWM) Output	185



## RUN/STOP Input

### Introduction

This section provides basic information on the RUN/STOP input special function.

### Principle

The RUN/STOP input is a special function that can be assigned to anyone of the base controller inputs. This function is used to start or stop a program.

### Determining the State of Run/Stop Input

At power up, if configured, the controller state is set by the Run/Stop input:

- if RUN/STOP input is at state 0, controller is in STOP mode.
- if RUN/STOP input is at state 1, controller is in RUN mode.

While the controller is powered, a rising edge on the RUN/STOP input state sets the controller to RUN. The controller is stopped if the RUN/STOP input is at 0. If the RUN/STOP input is at 0, a RUN command from a connected PC is ignored by the controller.

## Controller Status Output

### Introduction

This section provides basic information on the controller status output special function.

### Principle

The controller status output is a special function that can be assigned to 1 of 3 outputs (%Q0.0.1 to %Q0.0.3) on a base or a remote controller.

At power up, if there is no controller error issue *Base status, page 221*, the controller status output changes to 1. This function can be used in circuits external to the controller, for example, to control:

- The power supply to the output devices.
- The controller power supply.

## Latching input

### Introduction

This section provides basic information on the latching inputs special function.

### Principle

The latching inputs is a special function that can be assigned to one of four inputs (%I0.0.2 to %I0.0.5) on a base or a remote controller. This function is used to memorize any pulse with a duration less than the controller scan time. When a pulse is shorter than one scan and has a value greater than or equal to 1 ms, the controller latches the pulse, which is then updated in the next scan.

## Fast Counting

### Introduction

This section provides basic information on the fast counting special function.

### Principle

The base controllers have two fast counter types:

- A single up counter with a maximum frequency of 5 kHz.
- A single down counter with a maximum frequency of 5 kHz.

The single up counter and single down counter functions enable up counting or down counting of pulses (rising edges) on a discrete I/O. The fast counter functions enable counting of pulses from 0 to 65535 in single-word mode and from 0 to 4294967295 in double-word mode.

### Controllers Fast Counting Capabilities

Compact controllers can have up to 3 fast counters, with the exception of the TWDLCA•40DRF series compact controllers that have 4 fast counters. Modular controllers can have up to 2 fast counters. The availability of the double-word counting option depends on the controller model. The following table lists the fast counting capabilities of the Twido line Compact and Modular controllers.

Twido Line Controllers	Compact controllers TWDLC••...				Modular controllers TWDLMDA...	
	10DRF	16DRF	24DRF	40DRF	20D••	40D••
Fast Counters	3	3	3	4	2	2
Single-Word	Yes	Yes	Yes	Yes	Yes	Yes
Double-Word	No	Yes	Yes	Yes	Yes	Yes

### Discrete I/O Assignment for a Fast Counter

The discrete I/O assignment for fast counters depends on whether discrete I/O was assigned for the optional pre-set and catch inputs on the very fast counters. See *Very Fast Counters*, page 181 for more information.

## Very Fast Counters

### Introduction

This section provides basic information on the very fast counting special function.

### Principle

The base controllers have five very fast counter types:

- An up/down counter with a maximum frequency of 20 kHz.
- An up/down 2-phase counter with a maximum frequency of 20 kHz.
- A single up counter with a maximum frequency of 20 kHz.
- A single down counter with a maximum frequency of 20 kHz.
- A frequency meter with a maximum frequency of 20 kHz.

The up/down counter, up/down 2-phase counter, single up counter, and single down counter functions enable counting of pulses from 0 to 65535 in single-word mode and pulses from 0 to 4294967295 in double-word mode. The frequency meter function measures the frequency of a periodic signal in Hz.

### Controllers Very Fast Counting Capabilities

The number of very fast counters supported varies with the Twido controller models, as shown in the table below. Also, the availability of the double-word counting option depends on the controller model. The following table lists the very fast counting capabilities of the Twido line Compact and Modular controllers.

Twido Line Controllers	Compact controllers TWDLC**...				Modular controllers TWDLMDA...	
	10DRF	16DRF	24DRF	40DRF	20D**	40D**
Fast Counters	1	1	1	2	2	2
Single-Word	Yes	Yes	Yes	Yes	Yes	Yes
Double-Word	No	Yes	Yes	Yes	Yes	Yes

### discrete I/O Assignment for a Very Fast Counter on all Controllers

The following tables lists the assigned I/O for one very fast counter on all controllers models.

Functions	First Input (pulses)	Second Input (pulses or Up/Down)	Pre-set Input	Catch Input	First Reflex Output	Second Reflex Output
Up/down counter	%I0.0.1 (pulses)	%I0.0.0*	%I0.0.2**	%I0.0.3**	%Q0.0.2**	%Q0.0.3**
Up/down 2-phase counter	%I0.0.1 (pulses Phase A)	%I0.0.0 (pulses Phase B)	%I0.0.2**	%I0.0.3**	%Q0.0.2**	%Q0.0.3**
Single Up Counter	%I0.0.1 (pulses)	Not used	%I0.0.2**	%I0.0.3**	%Q0.0.2**	%Q0.0.3**
Single Down Counter	%I0.0.1 (pulses)	Not used	%I0.0.2**	%I0.0.3**	%Q0.0.2**	%Q0.0.3**
Frequency Meter	%I0.0.1 (pulses)	Not used	Not used	Not used	Not used	Not used

**NOTE:**

- \* Indicates up/down
- \*\* Optional use

### Discrete I/O Assignment for the Other Very Fast Counter on Modular Controllers

The following tables lists the assigned I/O for the other very fast counter on Modular controllers only.

Functions	First Input (pulses)	Second Input (pulses or Up/Down)	Pre-set Input	Catch Input	First Reflex Output	Second Reflex Output
Up/down counter	%I0.0.7 (pulses)	%I0.0.6*	%I0.0.5**	%I0.0.4**	%Q0.0.4**	%Q0.0.5**
Up/down 2-phase counter	%I0.0.7 (pulses Phase A)	%I0.0.6 (pulses Phase B)	%I0.0.5**	%I0.0.4**	%Q0.0.4**	%Q0.0.5**
Single Up Counter	%I0.0.7 (pulses)	Not used	%I0.0.5**	%I0.0.4**	%Q0.0.4**	%Q0.0.5**

Functions	First Input (pulses)	Second Input (pulses or Up/Down)	Pre-set Input	Catch Input	First Reflex Output	Second Reflex Output
Single Down Counter	%I0.0.7 (pulses)	Not used	%I0.0.5**	%I0.0.4**	%Q0.0.4**	%Q0.0.5**
Frequency Meter	%I0.0.7 (pulses)	Not used	Not used	Not used	Not used	Not used

**NOTE:**

- \* Indicates up/down
- \*\* Optional use

## Pulse (PLS) Generator Output

### Introduction

This section provides basic information on the PLS special function.

### Principle

The PLS is a special function that can be assigned to output %Q0.0.0 or %Q0.0.1 on a base or a peer controller. A user-defined function block generates a signal on output %Q0.0.0 or %Q0.0.1. This signal has a variable period but has a constant duty cycle, or on to off ratio of 50% of the period.

### Controllers PLS Capabilities

The number of PLS generators supported varies with the Twido controller models, as shown in the table below. Note that all controllers that have a PLS generator support both single-word and double-word functions. The following table lists the PLS capabilities of the Twido line Compact and Modular controllers.

Twido Line Controllers	Compact controllers TWDLC**...				Modular controllers TWDLMDA...	
	10DRF	16DRF	24DRF	40DRF	20D**	40D**
PLS Generator	None	None	None	2	2	2
Single-Word	-	-	-	Yes	Yes	Yes
Double-Word	-	-	-	Yes	Yes	Yes



## Pulse Width Modulation (PWM) Output

### Introduction

This section provides basic information on the PWM special function.

### Principle

The PWM is a special function that can be assigned to output %Q0.0.0 or %Q0.0.1 on a base or a peer controller. A user-defined function block generates a signal on output %Q0.0.0 or %Q0.0.1. This signal has a constant period with the possibility of varying the duty cycle, or on to off ratio.

### Controllers PWM Capabilities

The number of PWM generators supported varies with the Twido controller models, as shown in the table below. Note that all controllers that have a PWM generator support both single-word and double-word functions. The following table lists the PWM capabilities of the Twido line Compact and Modular controllers.

Twido Line Controllers	Compact controllers TWDLC**...				Modular controllers TWDLMDA...	
	10DRF	16DRF	24DRF	40DRF	20D**	40D**
PWM Generator	None	None	None	2	2	2
Single-Word	-	-	-	Yes	Yes	Yes
Double-Word	-	-	-	Yes	Yes	Yes

## 6.2 Controller Operating Modes

---

### Introduction

This section provides information about scanning, operating modes, power supply outages and restoration, warm and cold start, and objects initialization.

### What's in this Section?

This section contains the following topics:

Topic	Page
Cyclic Scan	187
Periodic Scan	189
Checking Scan Time	192
Operating Modes	193
Dealing with Power Outages and Restoration	195
Dealing with a Warm Restart	197
Dealing with a Cold Start	199
Initialization of Objects	201

## Cyclic Scan


### Introduction

Cyclic scanning involves linking controller cycles together one after the other. After having effected the output update (third phase of the task cycle), the system executes a certain number of its own tasks and immediately triggers another task cycle.

**NOTE:** The scan time of the user program is monitored by the controller watchdog timer and must not exceed 500 ms. Otherwise an unintended operation occurs causing the controller to stop immediately in Halt mode. Outputs in this mode are forced to their default fallback state.

### Operation

The following drawing shows the running phases of the cyclical scan time.

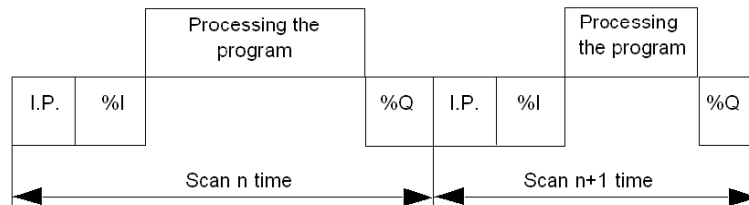

### Description of the phases of a cycle

The following table describes the phases of a cycle.

Address	Phase	Description
I.P.	Internal processing	The system implicitly monitors the controller (managing system bits and words, updating current timer values, updating status lights, detecting RUN/STOP switches, etc.) and processes requests from TwidoSuite (modifications and animation).
%I, %IW	Acquisition of input	Writing to the memory the status of discrete and application specific module inputs.
-	Program processing	Running the application program written by the user.
%Q, %QW	Updating of output	Writing output bits or words associated with discrete and application specific modules.

## Operating mode

**Controller in RUN**, the processor carries out:


- Internal processing
- Acquisition of input
- Processing the application program
- Updating of output

**Controller in STOP**, the processor carries out:

- Internal processing
- Acquisition of input

## Illustration

The following illustration shows the operating cycles.

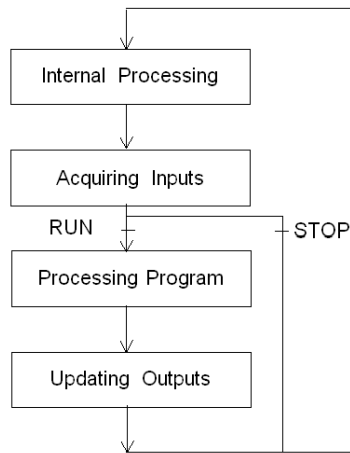

## Check Cycle

The check cycle is performed by watchdog.

## Periodic Scan


### Introduction

In this operating mode, acquiring inputs, processing the application program, and updating outputs are done periodically according to the time defined at configuration (from 2-150 ms).

At the beginning of the controller scan, a timer, the value of which is initialized at the period defined at configuration, starts to count down. The controller scan must end before the timer has finished and relaunches a new scan.

### Operation

The following drawing shows the running phases of the periodic scan time.

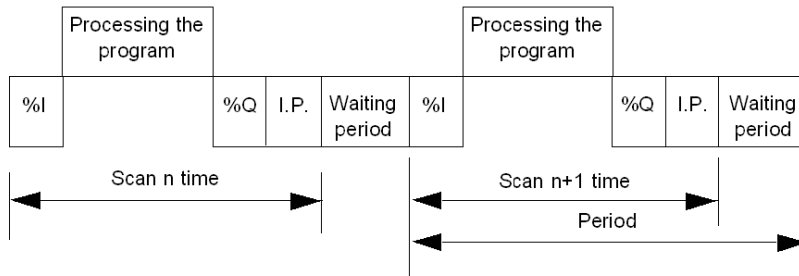

### Description of Operating Phases

The table below describes the operating phases.

Address	Phase	Description
I.P.	Internal processing	The system implicitly monitors the controller (managing system bits and words, updating current timer values, updating status lights, detecting RUN/STOP switches, etc.) and processes requests from TwidoSuite (modifications and animation).
%I, %IW	Acquisition of input	Writing to the memory the status of discrete and application specific module inputs.
-	Program processing	Running the application program written by the user.
%Q, %QW	Updating of output	Writing output bits or words associated with discrete and application specific modules.

## Operating mode

**Controller in RUN**, the processor carries out:

- Internal processing
- Acquisition of input
- Processing the application program
- Updating of output


If the period has not finished, the processor completes its operating cycle until the end of the internal processing period. If the operating time is longer than that allocated to the period, the controller indicates that the period has been exceeded by setting the system bit %S19 to 1. The process continues and is run completely. However, it must not exceed the watchdog time limit. The following scan is linked in after writing the outputs of the scan in progress implicitly.

**Controller in STOP**, the processor carries out:

- Internal processing
- Acquisition of input

**Illustration**

The following illustration shows the operating cycles.

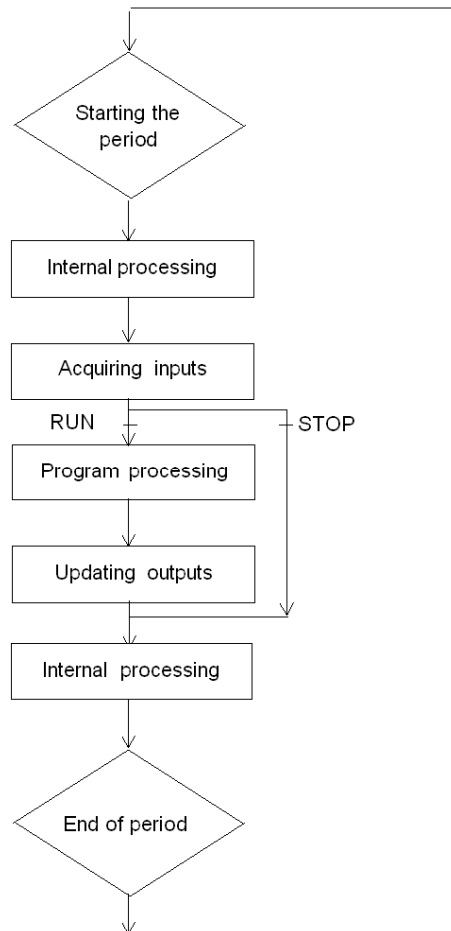**Check Cycle**

Two checks are carried out:

- Period overflow
- Watchdog

## Checking Scan Time

### General

The task cycle is monitored by a watchdog timer called Tmax (a maximal duration of the task cycle). It allows the detection of application errors (infinite loops, and so on.) and specifies a maximal duration for output refreshing.

### Software WatchDog (Periodic or Cyclic Operation)

In periodic or cyclic operation, the triggering of the watchdog causes a software message. The application passes into a HALT state and sets system bit%S11 to 1. The relaunching of the task necessitates a connection to Trotskyite in order to analyze the cause of the detected error, modification of the application to correct the error, then reset the program to RUN.

**NOTE:** The HALT state is when the application is stopped immediately because of detection of an application software error such as a scan overrun. The data retains the current values, which allows for an analysis of the cause of the error. The program stops on the instruction in progress. Communication with the controller is open.

### Check on Periodic Operation

In periodic operation an additional check is used to detect the period being exceeded:

- **%S19** indicates that the period has been exceeded. It is set to:
  - 1 by the system when the scan time is greater than the task period,
  - 0 by the user.
- **%SW0** contains the period value (0-150 ms). It is:
  - Initialized when starting from a cold start by the value selected on the configuration,
  - Able to be modified by the user.

### Using Master Task Running Time

The following system words are used for information on the controller scan cycle time:

- **%SW11** initializes to the maximum watchdog time (10 to 500 ms).
- **%SW30** contains the execution time for the last controller scan cycle.
- **%SW31** contains the execution time for the longest controller scan cycle since the last cold start.
- **%SW32** contains the execution time for the shortest controller scan cycle since the last cold start.

**NOTE:** This different information can also be accessed from the configuration editor.



## Operating Modes

### Introduction

TwidoSuite is used to take into account the three main operating mode groups:

- Checking
- Running or production
- Stopping

### Starting through Grafcet

These different operating modes can be obtained either starting from or using the following Grafcet methods:

- Grafcet initialization
- Presetting of steps
- Maintaining a situation
- Freezing charts

Preliminary processing and use of system bits provide effective operating mode management without complicating and overburdening the user program.

### Grafcet System Bits

Use of bits %S21, %S22 and %S23 is reserved for preliminary processing only. These bits are automatically reset by the system. They must be written by Set Instruction **S** only.

The following table provides Grafcet-related system bits:


Bit	Function	Description
%S21	GRAF CET initialization	Normally set to 0, it is set to 1 by: <ul style="list-style-type: none"> <li>● a cold-start, %S0=1;</li> <li>● The user, in the pre-processing program part only, using a Set Instruction <b>S</b> %S21 or a set coil <b>-(S)-</b> %S21.</li> </ul> Result: <ul style="list-style-type: none"> <li>● Deactivation of all active steps.</li> <li>● Activation of all initial steps.</li> </ul>
%S22	GRAF CET RESET	Normally set to 0, it can only be set to 1 by the program in pre-processing.           Result: <ul style="list-style-type: none"> <li>● Deactivation of all active steps.</li> <li>● Scanning of sequential processing stopped.</li> </ul>

Bit	Function	Description
%S23	Preset and freeze GRAFCET	<p>Normally set to 0, it can only be set to 1 by the program in pre-processing.</p> <ul style="list-style-type: none"><li>● Prepositioning by setting %S22 to 1.</li><li>● Preposition the steps to be activated by a series of S Xi instructions.</li><li>● Enable prepositioning by setting %S23 to 1.</li></ul> <p>Freezing a situation:</p> <ul style="list-style-type: none"><li>● In initial situation: by maintaining %S21 at 1 by program.</li><li>● In an "empty" situation: by maintaining %S22 at 1 by program.</li><li>● In a situation determined by maintaining %S23 at 1.</li></ul>

## Dealing with Power Outages and Restoration

### Illustration

The following illustration shows the various power restarts detected by the system. If the duration of the outage is less than the power supply filtering time (about 10 ms for an alternating current supply or 1 ms for a direct current supply), this is not noticed by the program which runs normally.

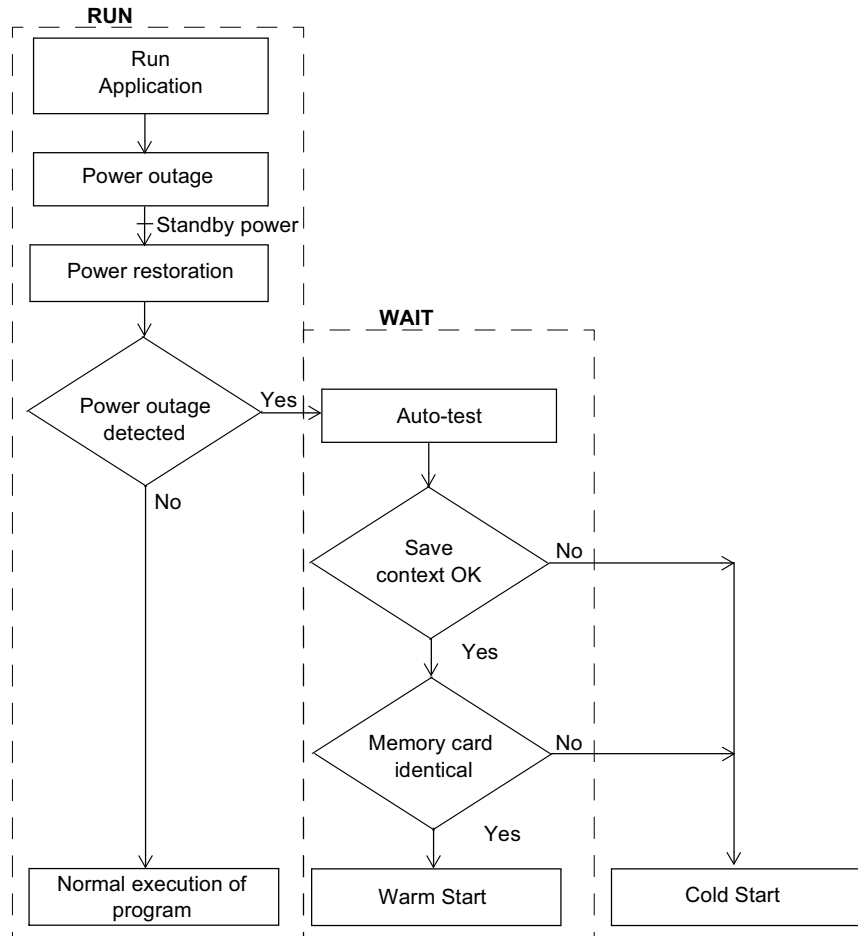

**NOTE:** The context is saved in a battery backed-up RAM. At power up, the system checks the state of the battery and the saved context to decide if a warm start can occur.

## Run/Stop Input Bit Versus Auto Run

The Run/Stop input bit has priority over the "Automatic Start in Run" option that is available from the Scan Mode dialog box. If the Run/Stop bit is set, then the controller will restart in the Run Mode when power is restored.

The mode of the controller is determined as follows:

Run/Stop Input Bit	Auto Start in Run	Resulting State
Zero	Zero	Stop
Zero	One	Stop
Rising edge	No effect	Run
One	No effect	Run
Not configured in software	Zero	Stop
Not configured in software	One	Run

**NOTE:** For all Compact type of controllers of software version V1.0, if the controller was in Run mode when power was interrupted, and the "Automatic Start in Run" flag was not set from the Scan Mode dialog box, the controller will restart in Stop mode when power is restored. Otherwise it will perform a cold restart.

**NOTE:** For all Modular and Compact type of controllers of software version V1.11, if the battery in the controller is operating normally when power was interrupted, the controller will startup in the mode that was in effect at the time the power was interrupted. The "Automatic Start in Run" flag, that was selected from the Scan Mode dialog, will have no effect on the mode when the power is restored.

## Operation

The table below describes the processing phases for power outages.

Phase	Description
1	In the event of a power outage the system stores the application context and the time of the outage.
2	All outputs are set to fallback status (0).
3	When power is restored, the context saved is compared with the one in progress which defines the type of start to run: <ul style="list-style-type: none"> <li>• If the application context has changed (loss of system context or new application), the controller initializes the application: Cold restart (systematic for compact).</li> <li>• If the application context is the same, the controller restarts without initializing data: warm restart.</li> </ul>

## Dealing with a Warm Restart


### Cause of a Warm Restart

A warm restart can occur:

- When power is restored without loss of application context,
- When bit %S1 is set to state 1 by the program,
- From the Operator Display when the controller is in STOP mode

### Illustration

The drawing below describes a warm restart operation in RUN mode.

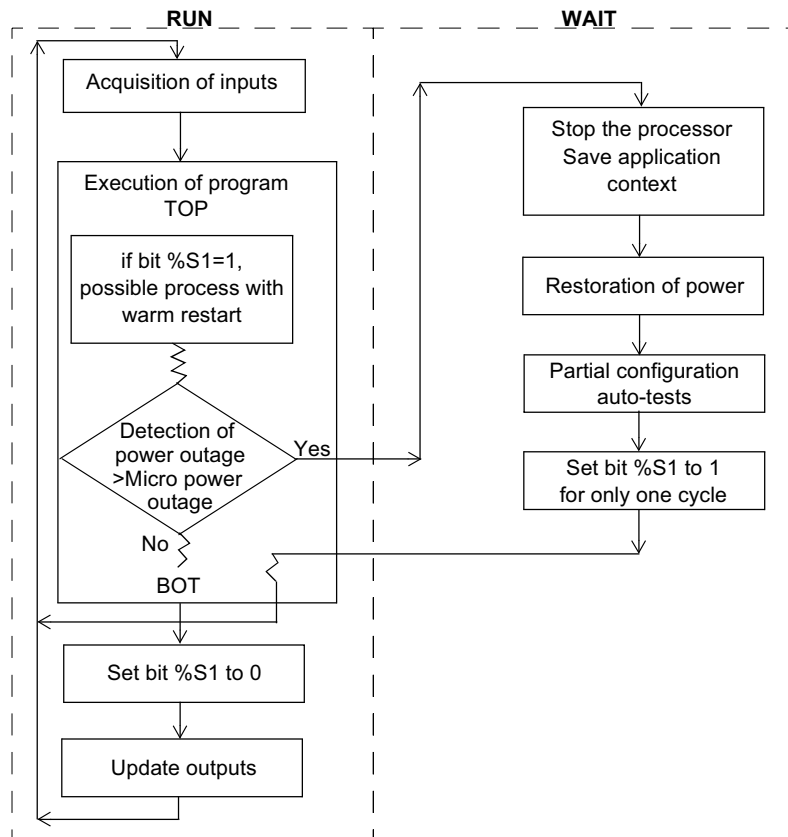

## Restart of the Program Execution

The table below describes the restart phases for running a program after a warm restart.

Phase	Description
1	The program execution resumes from the same element where it was prior to the power outage, without updating the outputs. <b>Note:</b> Only the same element from the user code is restarted. The system code (for example, the updating of outputs) is not restarted.
2	At the end of the restart cycle, the system: <ul style="list-style-type: none"> <li>● Unreserves the application if it was reserved (and provokes a STOP application in case of debugging)</li> <li>● Reinitializes the messages</li> </ul>
3	The system carries out a restart cycle in which it: <ul style="list-style-type: none"> <li>● Relaunches the task with bits %S1 (warm-start indicator) and %S13 (first cycle in RUN) set to 1</li> <li>● Resets bits %S1 and %S13 to 0 at the end of the first task cycle</li> </ul>

## Processing of a Warm-Start

In the event of a warm-start, if a particular application process is required, bit %S1 must be tested at the start of the task cycle, and the corresponding program called up.

## Outputs after Power Outage

Once a power outage is detected, outputs are set to (default) fallback status (0).

When power is restored, outputs are at last state until they are updated again by the task.

## Dealing with a Cold Start


### Cause of a Cold Start

A cold-start can occur:

- When loading a new application into RAM
- When power is restored with loss of application context
- When system bit **%S0** is set to state 1 by the program
- From the Operator Display when the controller is in STOP mode

### Illustration

The drawing below describes a cold restart operation in RUN mode.

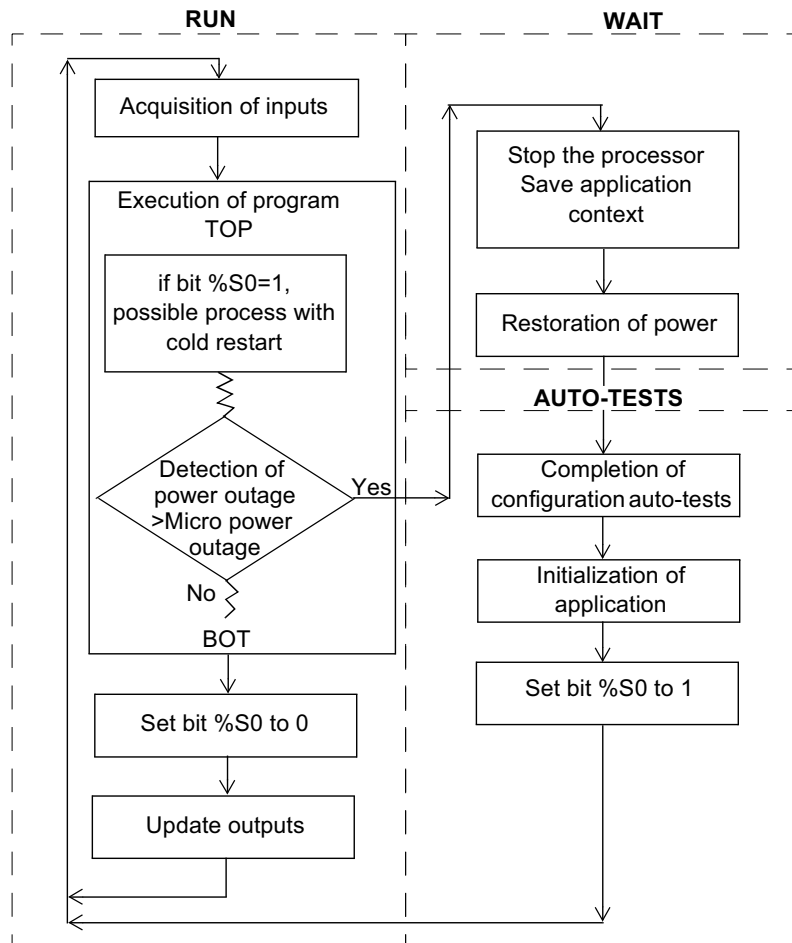

## Operation

The table below describes the restart phases for running a program after a cold restart.

Phase	Description
1	At start up, the controller is in RUN. At a cold restart after a stop due to a detected error, the system forces a cold restart. The program execution restarts at the beginning of the cycle.
2	The system: <ul style="list-style-type: none"><li>● Resets internal bits and words and the I/O images to 0</li><li>● Initializes system bits and words</li><li>● Initializes function blocks from configuration data</li></ul>
3	For this first restart cycle, the system: <ul style="list-style-type: none"><li>● Relaunches the task with bits <b>%S0</b> (cold-start indicator) and <b>%S13</b> (first cycle in RUN) set to 1</li><li>● Resets bits <b>%S0</b> and <b>%S13</b> to 0 at the end of this first task cycle</li><li>● Sets bits <b>%S31</b> and <b>%S38</b> (event control indicators) to their initial state 1.</li><li>● Resets bits <b>%S39</b> (event control indicator) and word <b>%SW48</b> (counts all events executed except periodic events).</li></ul>

### Processing of a Cold-Start

In the event of a cold-start, if a particular application process is required, bit **%S0** (which is at 1) must be tested during the first cycle of the task.

### Outputs after Power Outage

Once a power outage is detected, outputs are set to (default) fallback status (0).

When power is restored, outputs are at zero until they are updated again by the task.



## Initialization of Objects

### Introduction

The controllers can be initialized by TwidoSuite by setting system bits **%S0** (a cold restart) and **%S1** (a warm restart).


### Cold Start Initialization

For a cold start initialization, system bit **%S0** must be set to 1.

### Initialization of Objects (Identical to Cold Start) on Power-up using %S0 and %S1

To initialize objects on power-up, system bit **%S1** and **%S0** must be set to 1.

The following example shows how to program a warm restart object initialization using system bits.

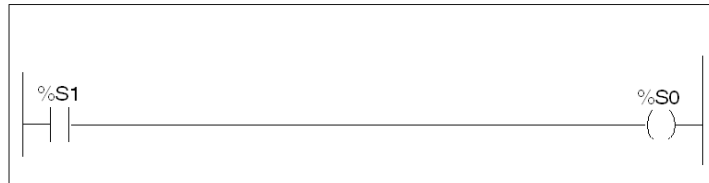

LD %S1 If %S1 = 1 (warm restart), set %S0 to 1 initialize the controller.  
ST %S0 These two bits are reset to 0 by the system at the end of the following scan.



---

# Operator Display Operation



---

## Introduction

This appendix provides an overview, information about operator display controller ID, system objects, serial port settings, time of day clock, and real-time correction .

## What's in this Chapter?

This chapter contains the following topics:

Topic	Page
Operator Display	204
Controller Identification and State Information	207
System Objects and Variables	209
Serial Port Settings	216
Time of Day Clock	217
Real-Time Correction Factor	218

## Operator Display

### Introduction

The Operator Display is a Twido option for displaying and controlling application data and some controller functions such as operating state and the Real-Time Clock (RTC). This option is available as a cartridge (TWDXCPODC) for the Compact controllers or as an expansion module (TWDXCPODM) for the Modular controllers.

The Operator Display has two operating modes:

- Display Mode: only displays data.
- Edit mode: allows you to change data.

**NOTE:** The operator display is updated at a specific interval of the controller scan cycle. This can cause confusion in interpreting the display of dedicated outputs for %PLS or %PWM pulses. At the time these outputs are sampled, their value will be zero, and this value will be displayed.

### Displays and Functions

The Operator Display provides the following separate displays with the associated functions you can perform for each display.


- Controller Identification and State Information: Operations Display  
Display firmware revision and the controller state. Change the controller state with the Run, Initial, and Stop commands.
- System Objects and Variables: Data Display  
Select application data by the address: %I, %Q, and all other software objects on the base controller. Monitor and change the value of a selected software data object.
- Serial Port Settings: Communication Display  
Display and modify communication port settings.
- Time of Day Clock: Time/Date Display  
Display and configure the current date and time (if the RTC is installed).
- Real Time Correction: RTC Factor  
Display and modify the RTC Correction value for the optional RTC.

**NOTE:**

1. The TWDLC••40DRF series of compact controllers have RTC onboard.
2. On all other controllers, time of day clock and real-time correction are only available if the Real-Time Clock (RTC) option cartridge (TWDXCPRTC) is installed.

## Illustration

The following illustration shows a view of the Operator Display, which consists of a display area (here in Normal mode) and four push-button input keys.

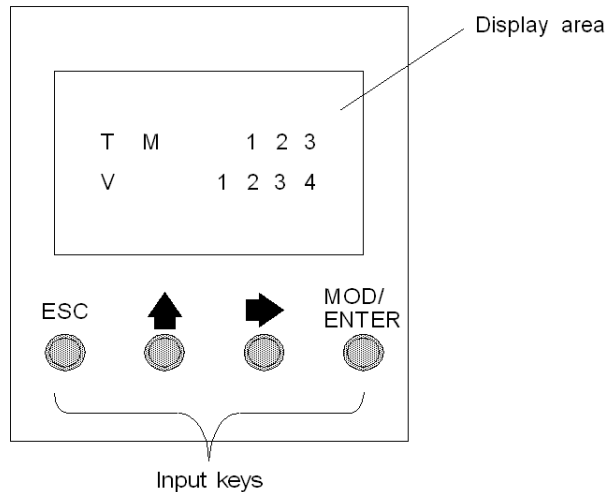

## Display area

The Operator Display provides an LCD display capable of displaying two lines of characters:

- The first line of the display has three 13-segment characters and four 7-segment characters.
- The second line has one 13-segment character, one 3-segment character (for a plus/minus sign), and five 7-segment characters.

**NOTE:** If in Normal mode, the first line indicates an object name and the second line displays its value. If in Data mode, the first line displays %SW68 value and the second line displays %SW69 value.

## Input keys

The functions of the four input push-buttons depend on the Operator Display mode.

Key	In Display Mode	In Edit Mode
ESC		Discard changes and return to previous display.
▲		Go to the next value of an object being edited.

Key	In Display Mode	In Edit Mode
▶	Advance to next display.	Go to the next object type to edit.
MOD/ENTER	Go to edit mode.	Accept changes and return to previous display.

### Selecting and Navigating the Displays

The initial display or screen of the Operator Display shows the controller identification and state information. Press the ▶ push-button to sequence through each of the displays. The screens for the Time of Day Clock or the Real-Time Correction Factor are not displayed if the optional RTC cartridge (TWDXCPRTC) is not detected on the controller.

As a shortcut, press the ESC key to return to the initial display screen. For most screens, pressing the ESC key will return to the Controller Identification and State Information screen. Only when editing System Objects and Variables that are not the initial entry (%l0.0.0), will pressing ESC take you to the first or initial system object entry.

To modify an object value, instead of pressing the ▶ push-button to go to the first value digit, press the MOD/ENTER key again.

## Controller Identification and State Information

### Introduction

The initial display or screen of the Twido optional Operator Display shows the Controller Identification and State Information.

### Example

The firmware revision is displayed in the upper-right corner of the display area, and the controller state is displayed in the upper-left corner of the display area, as seen in the following:



### Controller States

Controller states include any of the following:

- **NCF: Not Configured**

The controller is in the NCF state until an application is loaded. No other state is allowed until an application program is loaded. You can test the I/O by modifying system bit S8. (see the Programming Guide for additional information about System Bits and System Words.)

- **STP: Stopped**

Once an application is present in the controller, the state changes to the STP or Stopped state. In this state, the application is not running. Inputs are updated and data values are held at their last value. Outputs are not updated in this state.

- **INI: Initial**

You can choose to change the controller to the INI or initial state only from the STP state. The application is not running. The controller's inputs are updated and data values are set to their initial state. No outputs are updated from this state.

- **RUN: Running**

When in the RUN or running state the application is running. The controller's inputs are updated and data values are set according to the application. This is the only state where the outputs are updated.

- **HLT: Halted (User Application Error Detected)**



If the controller has entered an ERR or error state, the application is halted. Inputs are updated and data values are held at their last value. From this state, outputs are not updated. In this mode, the error code is displayed in the lower-right portion of the Operator Display as an unsigned decimal value.

- **NEX: Not Executable (not executable)**

An online modification was made to user logic. Result: The application is no longer executable. It will not go back into this state until all causes for the Non-Executable state have been resolved.

### Displaying and Changing Controller States

Using the Operator Display, you can change to the INI state from the STP state, or from STP to RUN, or from RUN to STP. Do the following to change the state of the controller:

Step	Action
1	Press the  key until the Operations Display is shown (or press ESC). The current controller state is displayed in the upper-left corner of the display area.
2	Press the MOD/ENTER key to enter edit mode.
3	Press the  key to select a controller state.
4	Press the MOD/ENTER key to accept the modified value, or press the ESC key to discard any modifications made while in edit mode.



## System Objects and Variables

### Introduction

The optional Operator Display provides these features for monitoring and adjusting application data:

- Select application data by address (such as %I or %Q).
- Monitor the value of a selected software object/variable.
- Change the value of the currently displayed data object (including forcing inputs and outputs).

### System Objects and Variables

The following table lists the system objects and variables, in the order accessed, that can be displayed and modified by the Operator Display.

Object	Variable/Attribute	Description	Access
Input	%Ix.y.z	Value	Read/Force
Output	%Qx.y.z	Value	Read/Write/Force
Timer	%TMX.V %TMX.P %TMX.Q	Current Value Preset value Done	Read/Write Read/Write Read
Counter	%Cx.V %Cx.P %Cx.D %Cx.E %Cx.F	Current Value Preset value Done Empty Full	Read/Write Read/Write Read Read Read
Memory Bit	%Mx	Value	Read/Write
Word Memory	%MWx(3)	Value	Read/Write
Constant Word	%KWx	Value	Read
System Bit	%Sx	Value	Read/Write
System Word	%SWx(4)	Value	Read/Write
Analog Input	%IWx.y.z	Value	Read
Analog Output	%QWx.y.z	Value	Read/Write
Fast Counter	%FCx.V %FCx.VD(1) %FCx.P %FCx.PD(1) %FCx.D	Current Value Current Value Preset value Preset value Done	Read Read Read/Write Read/Write Read

Object	Variable/Attribute	Description	Access
Very Fast Counter	%VFCx.V	Current Value	Read
	%VFCx.VD(1)	Current Value	Read
	%VFCx.P	Preset value	Read/Write
	%VFCx.PD(1)	Preset value	Read/Write
	%VFCx.U	Count Direction	Read
	%VFCx.C	Catch Value	Read
	%VFCx.CD(1)	Catch Value	Read
	%VFCx.S0	Threshold 0 Value	Read/Write
	%VFCx.S0D(1)	Threshold 0 Value	Read/Write
	%VFCx.S1	Threshold Value1	Read/Write
	%VFCx.S1D(1)	Threshold Value1	Read/Write
	%VFCx.F	Overflow	Read
	%VFCx.T	Timebase	Read/Write
%VFCx.R	Reflex Output Enable	Read/Write	
%VFCx.S	Reflex Input Enable	Read/Write	
Input Network Word	%INWx.z	Value	Read
Output Network Word	%QNWx.z	Value	Read/Write
Grafcet	%Xx	Step Bit	Read
Pulse Generator	%PLS.N	Number of Pulses	Read/Write
	%PLS.ND(1)	Number of Pulses	Read/Write
	%PLS.P(5)	Preset value	Read/Write
	%PLS.D	Done	Read
	%PLS.Q	Current Output	Read
Pulse Width Modulator	%PWM.R	Ratio	Read/Write
	%PWM.P	Preset value	Read/Write
Drum Controller	%DRx.S	Current Step Number	Read
	%DRx.F	Full	Read
Step counter	%SCx.n	Step Counter bit	Read/Write
Register	%Rx.I	Input	Read/Write
	%Rx.O	Output	Read/Write
	%Rx.E	Empty	Read
	%Rx.F	Full	Read
Shift bit register	%SBR.x.yy	Register Bit	Read/Write
Message	%MSGx.D	Done	Read
	%MSGx.E	Error Detected	Read
AS-Interface slave input	%IAx.y.z	Value	Read/Force
AS-Interface analog slave input	%IWAx.y.z	Value	Read
AS-Interface slave output	%QAx.y.z	Value	Read/Write/Force

Object	Variable/Attribute	Description	Access
AS-Interface analog slave output	%QWAx.y.z	Value	Read/Write
CANopen slave PDO input	%IWCx.y.z	Single-word value	Read
CANopen slave PDO output	%QWCx.y.z	Single-word value	Read/Write







## Notes:

1. 32-bit double word variable. The double word option is available on all controllers with the exception of the Twido TWDLC•A10DRF controllers.
2. Variables will not be displayed if they are not used in an application since Twido uses dynamic memory allocation.
3. If the value of %MW is greater than +32767 or less than -32768, the operator display will continue to blink.
4. If the value of %SW is greater than 65535, the operator display continues to blink, except for %SW0 and %SW11. If a value is entered that is more than the limit, the value will return to the configured value.
5. If a value is entered for %PLS.P that is more than the limit, the value written is the saturation value.

## Displaying and Modifying Objects and Variables

Each type of system object is accessed by starting with the Input Object (%I), sequencing through to the Message object (%MSG), and finally looping back to the Input Object (%I).

To display a system object:

Step	Action
1	Press the  key until the Data Display screen is shown. The Input object ("I") will be displayed in the upper left corner of the display area. The letter " I " (or the name of the object previously viewed as data) is not blinking.
2	Press the MOD/ENTER key to enter edit mode. The Input Object "I" character (or previous object name viewed as data) begins blinking.
3	Press the  key to step sequentially through the list of objects.
4	Press the  key to step sequentially through the field of an object type and press the  key to increment through the value of that field. You can use the  key and  key to navigate and modify all fields of the displayed object.

Step	Action
5	Repeat steps 3 and 4 until editing is complete.
6	Press the MOD/ENTER key to accept the modified values. Note: The object's name and address have to be validated before accepting any modifications. That is, they must exist in the configuration of the controller prior to using the operator display. Press ESC to discard any changes made in edit mode.

## Data Values and Display Formats

In general, the data value for an object or variable is shown as a signed or unsigned integer in the lower-right of the display area. In addition, all fields suppress leading zeros for displayed values. The address of each object is displayed on the Operator Display in one of the following 8 formats:

- Input/Output format
- AS-Interface slaves I/O format
- CANopen slaves I/O format
- Function block format
- Simple format
- Network I/O format
- Step Counter Format
- Shift Bit Register format

## Input/Output Format

The input/output objects (%I, %Q, %IW and %QW) have three-part addresses (e.g.: %IX.Y.Z) and are displayed as follows:

- Object type and controller address in the upper-left
- Expansion address in the upper-center
- I/O channel in the upper-right

In the case of a simple input (%I) and output (%Q), the lower-left portion of the display will contain a character that is either "U" for unforced or "F" for a forced bit. The force value is displayed in the lower-right of the screen.

The output object %Q0.3.11 appears in the display area as follows:

Q	0	3	1	1
F				1

### AS-Interface Slaves I/O Format

AS-Interface slave I/O objects (%IA, %QA, %IWA and %QWA) have four-part addresses (e.g.: %IAx.y.z) and are displayed as follows:

- The object type in the upper-left
- AS-Interface master address on the expansion bus in the upper-left center
- Address of the slave on the AS-Interface bus in the upper-right center
- Slave I/O channel in the upper-right.

In the case of a simple input (%IA) and output (%QA), the lower-left portion of the display will contain a character that is either "U" for unforced or "F" for a forced bit. The force value is displayed in the lower-right of the screen.

The output object %QA1.3A.2 appears in the display area as follows:

QA	1	3A	2
F			1

### CANopen Slaves I/O Format

CANopen slave PDO I/O objects (%IWC and %QWC) have four-part addresses (e.g.: %IWCx.y.z) and are displayed as follows:

- The object type in the upper-left
- CANopen master address on the expansion bus in the upper-left center
- Address of the slave on the CANopen bus in the upper-right center
- Slave PDO I/O channel in the upper-right.
- Signed value for the object in the lower portion

In the following example, the PDO output object %QWC1.3.2 contains the signed value +24680:

QWC	1	3	2
	+	24680	

### Function Block Format

The function blocks (%TM, %C, %FC, %VFC, %PLS, %PWM, %DR, %R, and %MSGj) have two-part addresses containing an object number and a variable or attribute name. They are displayed as follows:

- Function block name in the upper-left
- Function block number (or instance) in the upper-right

- The variable or attribute in the lower-left
- Value for the attribute in the lower-right

In the following example, the current value for timer number 123 is set to 1,234.

T	M		1	2	3
V			1	2	3 4

### Simple Format

A simple format is used for objects %M, %MW, %KW, %MD, %KD, %MF, %KF, %S, %SW and %X as follows:

- Object number in the upper-right
- Signed value for the objects in the lower portion

In the following example, memory word number 67 contains the value +123.

M	W		6	7
		+	1	2 3

### Network I/O Format

The network input/output objects (%INW and %QNW) appear in the display area as follows:

- Object type in the upper-left
- Controller address in the upper-center
- Object number in the upper-right
- Signed value for the object in the lower portion

In the following example, the first input network word of the remote controller configured at remote address #2 is set to a value -4.

I	N	W	2	0
			-	4

### Step Counter Format

The step counter (%SC) format displays the object number and the step counter bit as follows:

- Object name and number in the upper-left
- Step counter bit in the upper right
- The value of the step counter bit in the lower portion of the display

In the following example, bit number 129 of step counter number 3 is set to 1.

S	C	3	1	2	9
					1

### Shift Bit Register Format

The shift bit register (%SBR) appears in the display area as follows:

- Object name and number in the upper-left
- Register bit number in the upper-right
- Register bit value in the lower-right

The following example shows the display of shift bit register number 4.

S	B	R	4	9
				1

## Serial Port Settings




### Introduction

The operator display allows you to display the protocol settings and change the addresses of all serial ports configured using TwidoSuite. The maximum number of serial ports is two. In the example below, the first port is configured as Modbus protocol with an address 123. The second serial port is configured as a remote link with an address of 4.

M	1 2 3
R	4

### Displaying and Modifying Serial Port Settings

Twido controllers can support up to two serial ports. To display the serial port settings using the operator display:

Step	Action
1	Press the  key until the Communication Display is shown. The single letter of the protocol setting of the first serial port ("M", "R", or "A") will be displayed in the upper left corner of the operator display.
2	Press the MOD/ENTER key to enter the edit mode.
3	Press the  key until you are in the field that you wish to modify.
4	Press the  key to increment the value of that field.
5	Continue steps 3 and 4 until the address settings are complete.
6	Press the MOD/ENTER key to accept the modified values or ESC to discard any modifications made while in edit mode.
<p><b>Note:</b> The address is part of the configuration data on the Controller. Changing its value using the operator display means that you can no longer connect using TwidoSuite as equal. TwidoSuite will require that you do a download to become equal again.</p>	



## Time of Day Clock

### Introduction

You can modify the date and time using the operator display if the RTC option cartridge (TWDXCPRTC) is installed on your Twido controller. The Month is displayed in the upper-left side of the HMI Display. Until a valid time has been entered, the month field will contain the value "RTC". The day of the month is displayed in the upper-right corner of the display. The time of day is in military format. The hours and minutes are shown in the lower-right corner of the display and are separated by the letter "h". The example below shows that the RTC is set to March 28, at 2:22 PM.




M	A	R	2	8
			1	4 h 2 2

### NOTE:

1. The TWDLC••40DRF series of compact controllers have RTC onboard.
2. On all other controllers, time of day clock and real-time correction are only available if the Real-Time Clock (RTC) option cartridge (TWDXCPRTC) is installed.

### Displaying and Modifying Time of Day Clock

To display and modify the Time of Day Clock:

Step	Action
1	Press the  key until the Time/Date Display is shown. The month value ("JAN", "FEB") will be displayed in the upper-left corner of the display area. The value "RTC" will be displayed in the upper-left corner if no month has been initialized.
2	Press the MOD/ENTER key to enter the edit mode.
3	Press the  key until you are in the field that you wish to modify.
4	Press the  key increment the value of that field.
5	Continue steps 3 and 4 until the Time of Day value is complete.
6	Press the MOD/ENTER key to accept the modified values or ESC to discard any modifications made while in edit mode.

## Real-Time Correction Factor

### Introduction




You can display and modify the Real-Time Correction Factor using the operator display. Each Real-Time Clock (RTC) Option module has a RTC Correction Factor value that is used to correct for inaccuracies in the RTC module's crystal. The correction factor is an unsigned 3-digit integer from 0 to 127 and is displayed in the lower-right corner of the display.

The example below shows a correction factor of 127.

R T C	C o r r
	1 2 7

### Displaying and Modifying RTC Correction

To display and modify the Real-Time Correction Factor:

Step	Action
1	Press the  key until the RTC Factor Display is shown. "RTC Corr" will be displayed in the upper line of the operator display.
2	Press the MOD/ENTER key to enter edit mode.
3	Press the  key until you are in the field that you wish to modify.
4	Press the  key to increment the value of that field.
5	Continue Steps 3 and 4 until the RTC correction value is complete.
6	Press the MOD/ENTER key to accept the modified values or ESC to discard any modifications made while in edit mode.

---

# Appendices



---

## Introduction

This appendix provides information on system diagnostic using LED's, operator display operation, troubleshooting, the DIN rail, common IEC symbols used in this manual, and agency compliance.


## What's in this Appendix?

The appendix contains the following chapters:

Chapter	Chapter Name	Page
A	System Diagnostic using the Front Panel LED's	221
B	Troubleshooting	225
C	The DIN Rail	227
D	IEC Symbols	229
E	Agency Compliance	231



# System Diagnostic using the Front Panel LED's






## System Diagnostic Using the Front Panel LEDs

### Introduction




This section provides information about the base operating status and troubleshooting using the front panel LEDs.













### Status of the Discrete I/O Module






LED state		Discrete I/O Module
I/O LEDs		I/O not active
		I/O active
		

### Base status

The following table displays the different LED statuses on a base controller, peer controller, and remote controller.

LED status	Base Controller or Peer Controller	Remote I/O Controller
RUN green		Application not executed
		Controller is in STOP mode error (HALT)
		Incorrectly or not connected
		Same as base controller

LED status		Base Controller or Peer Controller	Remote I/O Controller
ERR red		OK	OK
		Application not executable, or execution error (HALT)	N/A
		Internal detected errors (watchdog, etc.)	Same as base controller
STAT green		Controlled by the user or application through system bit %S69	Same as base controller
		N/A	N/A
		Controlled by the user or application through system bit %S69	Same as base controller
BAT red	TWDLC•A40DRF and TWDLC•E40DRF Compact bases. (For detailed information about the BAT LED status, please see BAT LED Status ( <i>see page 61</i> .)		
		External battery power is OK or LED has been disabled. (Controlled by the user or system through system bit %S66)	N/A
		N/A	N/A
		No external battery or low battery power. Controlled by the user or system through system bit %S66	N/A
LAN ACT green/amber	TWDLC•E40DRF Compact base. (For detailed information about the LAN ACT LED status, please see "link-TBD".)		
		No Ethernet signal.	N/A
		green: communicating over 10Base-T link. amber: communicating over 100Base-TX link.	N/A
		green: 10Base-T network connection. amber: 100Base-TX network connection.	N/A

LED status	Base Controller or Peer Controller	Remote I/O Controller	
LAN ST green	TWDLC•E40DRF Compact base. (For detailed information about the LAN ACT LED status, please see "link-TBD".)		
		Base controller is powered OFF.	N/A
		Multiple, consecutive flashes of various numbers to provide a visual diagnostic tool of the Ethernet network connection status.	N/A
		Base controller is powered ON. Ethernet port is ready.	N/A
 Off	 On		





---

# Troubleshooting

# B

---

## Checking I/O Connections on the Base Controller

### Introduction

This section provides a procedure for checking the I/O connections.

### WARNING

#### UNINTENDED OPERATION OF EXTERNAL EQUIPMENT

To avoid unintended operation of external equipment, check that:

- Power fuses are removed from the motor controls.
- Pneumatic and hydraulic inputs are closed.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

### Checking I/O Connections Procedure

The following procedure ensures that the I/O connections are connected:

Step	Action
1	To test the I/O connections, the base needs to be in the non-configured state. To accomplish this: <ul style="list-style-type: none"><li>● If an Operator Display is attached, press and hold ESC and cycle the power on the base. After the base restarts, the Operator Display indicates "NCF".</li><li>● From TwidoSuite, issue the <b>Erase all</b> command from the <b>Program →Debug →Memory Cartridge Commands</b> task.</li></ul>
2	With the base in the non-configured state, set system bit %S8 to 0. At state 0, the base outputs are kept in their existing state.
3	Check the inputs by activating each external sensor. To accomplish this: <ul style="list-style-type: none"><li>● Check that each of the input LEDs for the corresponding bit changes state.</li><li>● Using the TwidoSuite <b>Program →Debug →Check PLC</b> task, check that each of the input LEDs for the corresponding bit changes state.</li></ul> <p><b>Note: Check PLC</b> can only be used in connected mode.</p>

Step	Action
4	<p>Check the outputs by setting the bit corresponding to each output state to 1. To accomplish this:</p> <ul style="list-style-type: none"> <li>● Check that each of the output LEDs for the corresponding bit changes state.</li> <li>● Using the TwidoSuite <b>Program</b> → <b>Debug</b> → <b>Check PLC</b> task, check that each of the output LEDs for the corresponding bit changes state.</li> </ul> <p><b>Note:</b> <b>Check PLC</b> can only be used in connected mode.</p>
5	<p>To complete this procedure, set system bit %S8 to 1. This is automatically accomplished by downloading a valid user application.</p>

---

## The DIN Rail

C

---


### The DIN Rail

#### Introduction

You can mount the Twido controller and its expansions on a DIN rail. A DIN rail can be attached to a smooth mounting surface or suspended from a EIA rack or in a NEMA cabinet.

#### Dimensions of the DIN Rail

The DIN rail measures 35 mm (*1.38 in.*) high and 15 mm (*0.59 in.*) deep, as shown below.

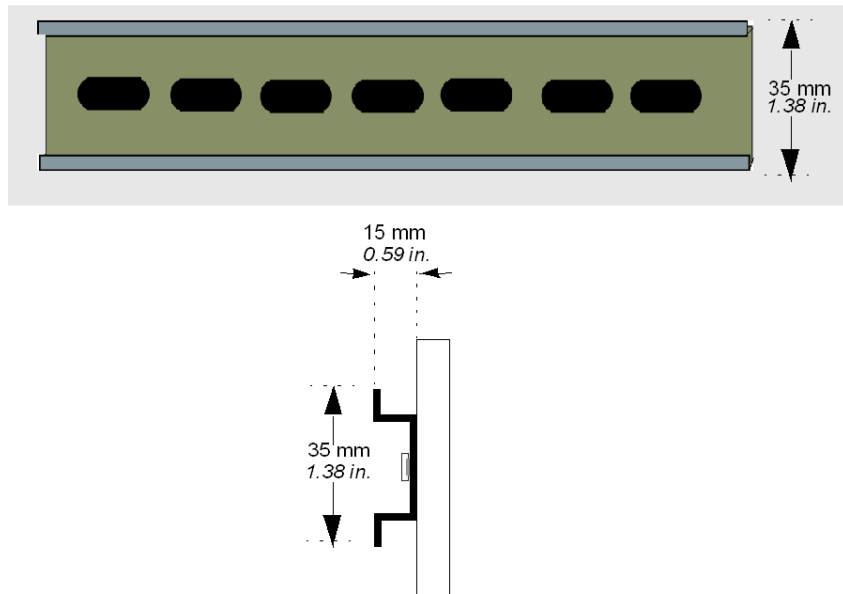

### Recommended Equipment

You can order the suitable DIN rail from Schneider Electric:

<b>Rail depth</b>	<b>Catalogue part number</b>
15 mm ( <i>0.59 in.</i> )	AM1DE200

---

# IEC Symbols



---







## Glossary of Symbols



### Introduction

This section contains illustrations and definitions of common IEC symbols used in describing wiring schematics.

### Symbols

Common IEC symbols are illustrated and defined in the table below:

	Fuse
	Load
	AC power
	DC power
	Discrete sensor/input, for example, contact, switch, initiator, light barrier, and so on.
	Ground

	2-wire sensor
	Thermocouple element

---

# Agency Compliance



---

## Agency Requirements

### Introduction

This section provides agency standards for the Twido products.

### Standards

Twido controllers comply with the main national and international standards concerning electronic industrial control devices.

The following are specific controller requirements:


- EN 61131-2 (IEC 61131-2)
- UL 508
- UL 1604 / CSA 213 Class I Division 2 Groups A, B, C, D





---

# Glossary



---

## A

### Analog potentiometer

It can be used to preset a value for an analog timer. All Modular controllers and Compact 10 and 16 I/O controllers have one analog potentiometer. The Compact 24 I/O controller has two:

### Analog Voltage Input Connector

Connects an analog voltage source of 0 through 10 VDC. The analog voltage is converted to a discrete value and is stored in a system word.

## C

### CAN

**Controller Area Network:** field bus originally developed for automobile applications which is now used in many sectors, from industrial to tertiary.

### Cartridge Connector

A connector to attach an optional memory cartridge or an RTC.

### Catch Input

Verify that you are receiving short input pulses (rising pulse of 40  $\mu$ s or falling pulse of 150  $\mu$ s minimum) from sensors without regard to the scan time.

**CiA**

**CAN in Automation:** international organization of users and manufacturers of CAN products.

**COB**

**Communication Object:** transport unit on CAN bus. A COB is identified by a unique identifier, which is coded on 11 bits, [0, 2047]. A COB contains a maximum of 8 data bytes. The priority of a COB transmission is shown by its identifier - the weaker the identifier, the more priority the associated COB has.

**Communication Adapter**

An optional cartridge that can be attached to any Compact controller or Operator Display Expansion Module to provide an optional Serial Port 2.

**Communication Expansion Module**

An optional module that can be attached to any Modular controllers communications expansion bus to provide an optional Serial Port 2.

**Controller status output**

A special function. This function is used in circuits, external to the controller, to control the power supply to the output devices or the controller power supply.

**E**

**EDS**

**Electronic Data Sheet:** description file for each CAN device (provided by the manufacturers).

**ERR LED**

An LED that illuminates when a detected error is detected in the controller.

**Expansion connector**

A connector to attach expansion I/O modules.

**Expansion Connector Cover**

A cover to protect the expansion connector.

**Expansion I/O Module**

Either a discrete or analog module that adds additional I/O to the base controller.

**F****Fast Counting**

A special function, it is available as a single up counter and single down counter. These functions enable up counting or down counting of pulses (rising edges) on a discrete I/O. Compact controllers can be equipped with three fast counters. Modular controllers can have two fast counters.

**Free Wire**

The end of a discrete I/O cable whose wires do not have a connector. This scheme provides connectivity from Modular I/O to discrete I/O points.

**I****I/O**

Input/Output.

**I/O terminals**

Terminals on all Modular controllers and expansion I/O modules used to connect input and output signals. The input terminals accept both sink and source DC input signals. The output terminals are either transistor source or sink or relay contacts.

**IN LED**

An LED that illuminates when a corresponding input is on. All modules have IN LEDs.

**Input Filter**

A special function that rejects input noises. This function is useful for addressing input noises and chatter in limit switches. All inputs provide a level of input filtering using the hardware. Additional filtering using the software is also configurable through TwidoSuite.

**Input Simulators**

An optional accessory for Compact controllers that is used for debugging. It can simulate input sensors to test application logic.

**Input terminals**

Terminals on the top of all Compact controllers used to connect input signals from input devices such as sensors, push buttons, and limit switches. The input terminals accept both sink and source DC input signals.

**L**

**Latching input**

A special function. This function is used to memorize any pulse with a duration less than the controller scan time. When a pulse is shorter than one scan and has a value greater than or equal to 100  $\mu$ s, the controller latches the pulse, which is then updated in the next scan.

**M**

**Memory Cartridge**

An optional cartridge available in two sizes: 32 KB and 64 KB (64 KB not available on Compact). It can be added to any controller for removable backup of applications or to load an application, if certain conditions exist. The 64 KB cartridge is also used to increase program memory.

**Modbus Master Mode**

Allows the controller to initiate a Modbus query transmission, with a response expected from a Modbus slave.

**Modbus Slave Mode**

Allows the controller to respond to Modbus queries from a Modbus master and is the default communications mode if no communication is configured.

## O

### **Operator display expansion module**

An optional module that can be attached to any Modular controller to display program information.

### **Operator display module**

An optional module that can be attached to any Compact controller to display program information.

### **OUT LED**

An LED that illuminates when a corresponding output is on. All modules have OUT LEDs.

### **Output terminals**

Terminals on the bottom of all Compact controllers used to connect output signals from output devices such as electromechanical relays and solenoid valves. The internal output relay contact is rated up to 240 VAC/2A or 30 VDC/2A.

## P

### **PLS**

A special function. This user-defined function block generates a signal on output %Q0.0.0 or %Q0.0.1. This signal has a variable period but has a constant duty cycle, or on to off ratio of 50% of the period.

### **Power Supply Terminals**

The power supply is connected to these terminals to provide power to the controller. The power voltage for a Compact controller is 100-240 VAC and 24 VDC for a Modular controller.

### **PWM**

A special function. This user-defined function block generates a signal on output %Q0.0.0 or %Q0.0.1. This signal has a constant period with the possibility of varying the duty cycle, or on to off ratio.

**PWR LED**

An LED that illuminates when power is supplied to the controller.

**R**

**Removable Cover**

A cover on all Compact controllers that can be removed to install an optional Operator Display.

**RTC**

Real Time Clock.

**RTD**

Temperature detector of type PT100, PT1000 etc. Resistor Temperature Detector.

**RUN LED**

An LED that illuminates when the controller is executing a program.

**S**

**Sensor power terminals**

Supplies power to the sensors (24 VDC, 400 mA for -40DRF compact controllers and 250 mA for all other controllers). Output terminals are only intended for input devices and not be used as a source for driving external loads.

**Serial Port 1**

An EIA RS-485 connector used to download and monitor the controller operation using TwidoSuite.

**Serial port 2**

An optional port that can be configured as either EIA RS-232 or EIA RS-485.

**STAT LED**

An LED that blinks on and off to indicate a specific status of the user program.

**T****Terminal cover**

A cover on all Compact controllers to protect the input and output terminals.

**V****Very Fast Counting**


A special function available as an up/down counter, an up/down 2-phase counter, a single up counter, a single down counter, and frequency meter. The counter functions enable counting of pulses from 0 to 65,535 in single-word mode and from 0 to 4,294,967,295 in double-word mode. The frequency meter function measures the frequency of a periodic signal in Hz.





---

# Index



---

## Symbols

*%S21, 193*

*%S22, 193*

*%S23, 194*

## A

Accessories, *16*

Adding a second serial port

*Compact, 56*

*Modular, 70*

Agency requirements, *231*

Analog potentiometers, *24, 99*

*Physical description, 136*

Analog voltage input, *24*

*Overview, 137*

AS-Interface bus

*Illustration, 28*

AS-Interface Master module, *14*

AS-Interface V2 bus

*Reminder, 27*

Assembling

*Communication adapter, 56*

*Operator display expansion module, 69*

*Second serial interface expansion module, 71*

## B

Bases

*Analog potentiometers, 99*

*Assembling an expansion I/O module, 42*

*Assembling to a second serial interface expansion module, 71*

*Assembling to a second serial interface expansion module with Operator Display, 72*

*Dimensions, 64*

*Disassembling an expansion I/O module, 44*

*Features, 23*

*How to Install a serial interface adapter, 56*

*Minimum clearance, 46*

*Mounting positions, 40*

*Parts description, 123*

*Specifications, 15*

*Status, 221*

*Wiring diagrams, 107, 145*

Battery

*External battery, 60*

## C

Cables, *14, 17, 158*

CANopen Master module, *14*

Checking I/O connections, *225*

Checking scan time, *192*

Cold start, *199*

Communication architecture, *27*

**Compact**

- Backup external battery specifications, 89
  - Backup internal battery specifications, 89
  - Connect a DC power supply, 59
  - Connect an AC power supply, 58
  - Dimensions, 49
  - How to Install a serial interface adapter, 56
  - I/O usage limits, 94
  - Input internal circuit, 104
  - Installing a memory cartridge, 57
  - Installing an operator display module, 54
  - Installing an RTC, 57
  - Minimum clearance, 46
  - Mounting hole layout, 51
  - Operating range, 104
  - Output delay, 96
  - Parts description, 85, 86
  - Power supply specifications, 59
  - Relay output contact, 96
  - Transistor source output contact, 98
  - Wiring diagrams, 107
- Compact 10 I/O Controllers
- Illustration, 82
- Compact 16 I/O Controllers
- Illustration, 82
- Compact 24 I/O Controllers
- Illustration, 83
- Compact 40 I/O Controllers
- Illustration, 84
- Compact Bases
- Installing on a DIN rail, 52
  - Options, 113, 117
- Compact bases
- Removing from a DIN rail, 53
- Compact Controllers Features
- Overview, 81
- Configuration
- Compact, 18
  - Hardware, 18, 21
  - Modular, 21
- Connect a DC power supply
- Compact, 59

**Connect a power supply**

- Modular, 76
- Connect an AC power supply
- Compact, 58
- Controller status output , 178
- Controllers
- Compact Bases, 14
  - Dimensions, 49
  - Modular Bases, 14
  - Parts description, 85, 86
- Counters
- Fast counters, 180
  - Very fast, 181

**D**

- Dedicated function blocks, 24
- Determining the state of Run/Stop input, 177
- Dimensions
- Base, 64
  - Modular, 64
  - Operator display expansion module, 155
  - Operator display module, 116
  - Second Serial Interface expansion module, 73
- DIN rail
- 15 mm AM1DE200 rail, 228
- Discrete I/O assignment
- Controller status output, 178
  - Fast counters, 180
  - Latching input, 179
  - PLS, 184
  - PWM, 185
  - RUN/STOP input, 177
  - Very fast counters, 182, 182
- Discrete I/O cables, 14
- Double-word
- Fast counters, 180
  - PLS, 184
  - Very fast counters, 181

**E**

- Ethernet port, 86
- Execution time, 23

## Expansion I/O modules

Assembling to a base, *42*

Disassembling from a base, *44*

External battery, *60*

## F

Fast counters, *180*

Double-word, *180*

Single-word, *180*

## G

Grafcet methods, *193*

## H

How to Install

Second serial interface expansion module with operator display, *71*

Serial interface adapter, *70*

Serial Interface adapter, *56*

## I

I/O connections

Checking, *225*

I/O modules

Analog, *14*

Discrete, *14*

I/O usage limits

Compact bases, *94*

Modular bases, *128*

IEC symbols, *229*

Illustration

Compact 10 I/O Controllers, *82*

Compact 16 I/O Controllers, *82*

Compact 24 I/O Controllers, *83*

Compact 40 I/O Controllers, *84*

Initialization of objects, *201*

Input internal circuit

Compact bases, *104*

Input Simulators

Options, *117*

Input simulators

Overview, *117*

Input specifications

Compact base, *93*

Installation preparation, *39*

Installing

Memory cartridge, *57, 57, 75, 75*

Operator display module, *54*

Installing on a DIN rail, *52, 67*

## L

Latching input, *179*

LED

Status, *221*

## M

Main Features, *23*

Maximum hardware configuration, *18, 21*

Memory capacity, *23*

Memory cartridge

Installing in a Compact, *57*

Installing in a Modular, *75*

Overview, *113, 151*

Specifications, *113, 151*

Minimum clearance

Bases, *46*

Compact, *46*

Modular, *47*

Modular

Assembling to a second serial interface expansion module, *71*

Assembling to a second serial interface expansion module with Operator Display, *72*

Connect a power supply, *76*

Dimensions, *64*

Disassembling of an operator display ex-

- ansion module, *69*
- I/O usage limits, *128*
- Installing a memory cartridge, *75*
- Installing an RTC, *75*
- Minimum clearance, *47*
- Mounting hole layout, *66*
- Output delay, *130, 133*
- Overview, *122*
- Parts description, *123*
- Power supply specifications, *77*
- Relay output contact, *131, 133*
- Removing the terminal block, *74*
- Transistor sink output contact, *131, 135*
- Transistor source output contact, *131, 135*
- Wiring diagrams, *145*

Modular Bases

- Disassembling of an operator display expansion module, *69*

Modular bases

- Installing on a DIN rail, *67*

Modular Bases

- Options, *151*
- Removing from a DIN rail, *68*

Modular Bases Features

- Overview, *121*

Mounting hole layout

- Compact base, *51*
- Modular base, *66*

## O

- Operating modes, *193*
- Operating range
  - Compact bases, *104*
- Operator Display
  - Controller ID and states, *207*
  - Overview, *204*
  - Real-Time correction, *218*
  - Serial port settings, *216*
  - System objects and variables, *209*
  - Time of day clock, *217*

- Operator display expansion module
  - Assembling, *69*
  - Dimensions, *155*
  - How to Install a serial interface adapter, *70*
  - Overview, *153*
  - Parts description, *153*
  - Specifications, *154*
- Operator display expansion modules
  - Disassembling from a Modular base, *69*
- Operator display module
  - Dimensions, *116*
  - Installing in a Compact, *54*
  - Overview, *115*
  - Parts description, *115*
  - Specifications, *116*
- Options, *14*
  - Communication adapters, *16*
  - Communication expansion modules, *16*
  - Compact Bases, *114*
  - Connectors, *16*
  - Input simulators, *16*
  - Input Simulators, *117*
  - Memory Cartridge, *113, 151*
  - Memory cartridges, *16*
  - Modular Bases, *152*
  - Operator display expansion module, *16*
  - Operator display module, *16*
  - Real Time Clock cartridge, *114, 152*
  - RTC, *16*
  - Terminal blocks, *16*
- Output delay
  - Compact controllers, *96*
  - Modular controllers, *130, 133*
- Output transistor specifications
  - Compact base, *97*
- Overview
  - Compact Controllers Features, *81*
  - Input simulators, *117*
  - Memory cartridge, *113, 151*
  - Modular, *122*
  - Modular Bases Features, *121*
  - Operator display expansion module, *153*
  - Operator display module, *115*
  - Real Time Clock cartridge, *114, 152*

**P**

- Parts description
  - Bases, 123
  - Modular, 123
  - Operator display expansion module, 153
  - Operator display module, 115
- Physical description
  - Analog potentiometer on Compact base, 99
  - Analog potentiometer on Modular base, 136
- PLS, 184
  - Double-word, 184
  - Single-word, 184
- Power cut, 195
- Power restoration, 195
- Power supply
  - Specifications, 59, 77
- Programming cables, 14, 17
- Programming port, 24
- Pulse generator output, 184
- Pulse width modulation, 185
- PWM, 185

**R**

- RAM backup, 23
- Read before starting, 39
- Real Time Clock cartridge
  - Overview, 114, 152
  - Specifications, 114, 152
- Real-Time correction factor, 218
- Relay output contact
  - Compact controllers, 96
  - Modular controllers, 131, 133
- Relay Output specifications
  - Compact base, 95
- Removing
  - Terminal block, 74
- RTC
  - Installing in a Compact, 57
  - Installing in a Modular, 75
- Run/Stop bit, 196
- RUN/STOP input, 177

**S**

- Scan time, 192
- Scanning, 23
  - Cyclic, 187
- Scanning
  - Periodic, 189
- Second serial interface expansion modules
  - Assembling to a Modular, 71
- Second Serial Interface expansion modules
  - Dimensions, 73
- Second serial interface expansion modules with Operator Display
  - Assembling to a Modular, 72
- Serial Interface adapters
  - How to Install in a Compact, 56
- serial interface adapters
  - How to Install in an operator display expansion module, 70
- Single counter
  - Down, 180
  - Up, 180
- Single-word
  - Fast counters, 180
  - PLS, 184
  - Very fast counters, 181
- Software watchdog, 192
- Special functions
  - Controller status output, 178
  - Fast counters, 180
  - Latching input, 179
  - PLS, 184
  - PWM, 185
  - RUN/STOP input, 177
  - Very fast counters, 181
- Special I/O, 25
- Specifications
  - Bases, 15
  - Memory cartridges, 113, 151
  - Operator display expansion module, 154
  - Operator display module, 116
  - Power supply, 59, 77
  - Real Time Clock cartridge, 114, 152
- Standards, 231
- Starting, 39

Status

Base, *221*

LED, *221*

Symbols, *229*

System Diagnostic

Using LEDs, *221*

## T

Task cycle, *192*

Telefast

Bases, *158*

Dimensions, *161*

Pre-wired systems, *14*

Specifications, *162*

System overview, *158*

Wiring schematics, *164*

Transistor sink output contact

Modular bases, *135*

Modular controllers, *131*

Transistor source output contact

Compact bases, *98*

Modular bases, *135*

Modular controllers, *131*

## U

Unintended operation of external equipment,  
*225*

## V

Very fast counters, *181*

Double-word, *181*

Single-word, *181*

## W

Warm restart, *197*

Wiring diagrams

Base, *107, 145*

Compact, *107*

Modular, *145*

Wiring schematics

Telefast bases, *164*